



Test Report: UHP-200-3.3

200W Slim Type with PFC Switching Power Supply

■ DESIGN VERIFY TEST

Output Function Test

Input Function Test

Protection Function Test

Component Stress Test

■ SAFETY & E.M.C. TEST

Safety Test

E.M.C. Test

■ RELIABILITY TEST


Environment Test

DESIGN VERIFY TEST


OUTPUT FUNCTION TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT
1	OUTPUT VOLTAGE ADJUST RANGE	3.2V~3.5V	I/P: 230VAC O/P: NO LOAD Ta: 25°C	3.12V~ 3.71V
2	PEAK LOAD	150% peak load capability(100ms)	I/P: 230VAC O/P: 150% LOAD Ta: 25°C	TEST: OK
3	OUTPUT VOLTAGE TOLERANCE	-2%~+2%	I/P: 90VAC / 264VAC O/P: FULL / NO LOAD Ta: 25°C	- 1.51%~ +1.51%
4	LINE REGULATION	-0.5%~+0.5%	I/P: 100VAC ~ 264VAC O/P: FULL LOAD Ta: 25°C	- 0.3%~+0.3%
5	LOAD REGULATION	-1%~+1%	I/P: 230VAC O/P: FULL~NO LOAD Ta: 25°C	- 0.29%~+0.29%
6	OVER/UNDERSHOOT TEST	<± 15 %	I/P: 230VAC O/P: FULL LOAD Ta: 25°C	<15%
7	RIPPLE & NOISE (Max)	150mVp-p	I/P: 230VAC O/P: FULL LOAD Ta: 25°C	79.6mVp-p

high frequency :

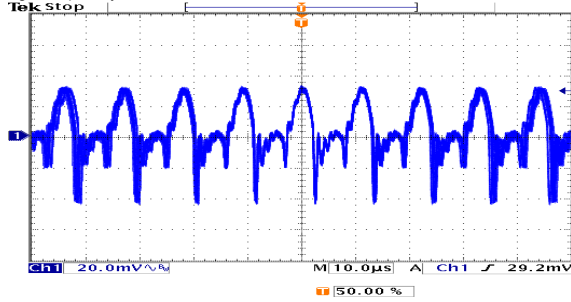


low frequency :

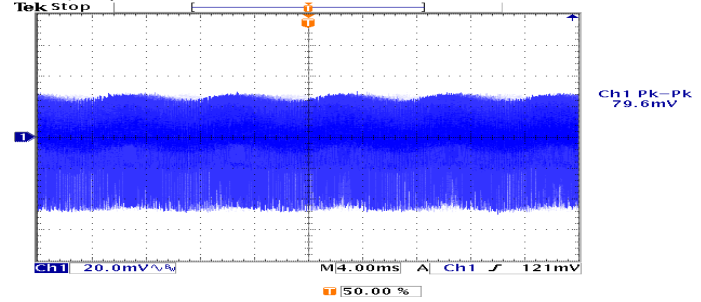

8	SET UP TIME(Max)	230VAC/ 2000ms 115VAC/ 3000ms	I/P: 230 VAC I/P: 115 VAC O/P: FULL LOAD Ta: 25°C	230VAC/536 ms 115VAC/752 ms
---	------------------	----------------------------------	--	--------------------------------


INPUT=230VAC/50HZ @ FULL LOAD

CH1: Output Voltage CH2: AC Input Voltage

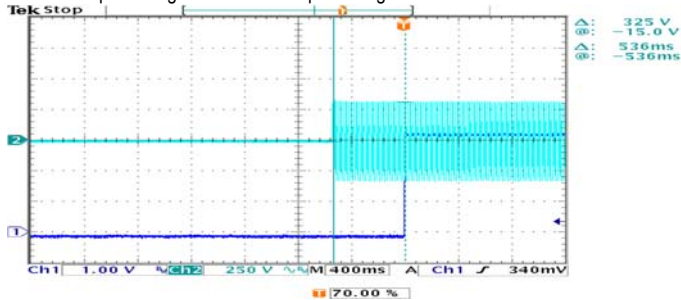

INPUT=115VAC/60HZ @ FULL LOAD



CH1: Output Voltage CH2: AC Input Voltage

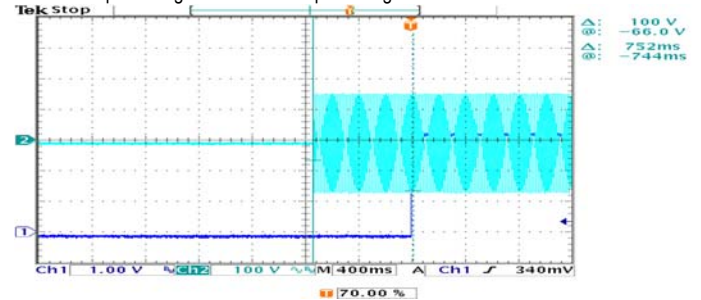



200W Slim Type with PFC Switching Power Supply

UHP-200 series

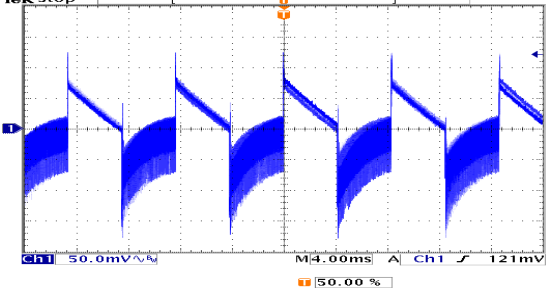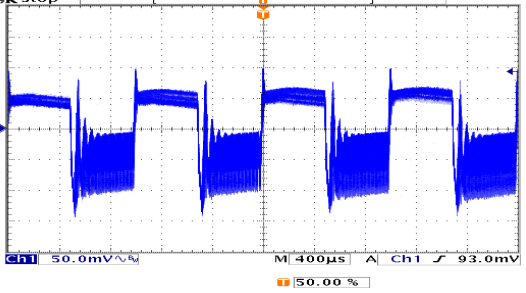
9	RISE TIME (Max)	230VAC/ 80ms 115VAC/ 80ms	I/P: 230 VAC I/P: 115 VAC O/P: FULL LOAD Ta: 25°C	230VAC/4 ms 115VAC/4 ms
INPUT=230VAC/50HZ @ FULL LOAD CH1: Output Voltage		INPUT=115VAC/60HZ @ FULL LOAD CH1: Output Voltage		
10		230VAC/ 10ms 115VAC/ 10ms	I/P: 230 VAC I/P: 115 VAC O/P: FULL LOAD Ta: 25°C	230VAC/29.2 ms 115VAC/29.6 ms
INPUT=230VAC/50HZ @ FULL LOAD CH1: Output Voltage CH2: AC Input Voltage		INPUT=115VAC/60HZ @ FULL LOAD CH1: Output Voltage CH2: AC Input Voltage		
11	DYNAMIC LOAD	V1: 990 mVp-p	I/P: 230VAC O/P: (1)FULL/50% LOAD 50%DUTY / 120HZ (2)FULL/50% LOAD 50%DUTY / 1KHZ Ta: 25°C	(1) 296mVp-p (2) 238mVp-p
FULL /50% LOAD 50%DUTY / 120HZ 		FULL /50% LOAD 50%DUTY / 1KHZ 		

INPUT FUNCTION TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT
1	INPUT VOLTAGE RANGE	90VAC~264VAC	I/P: TESTING O/P: 75%-FULL LOAD Ta: 25°C	87 V~300V
			I/P: (1)LOW-LINE-3V=87 V HIGH-LINE+15%=300 V O/P: 90%/FULL/NO LOAD ON: 30 Sec OFF: 30 Sec 10MIN (2)230VAC ON: 0.5 Sec OFF: 0.5 Sec 20MIN (POWER ON/OFF NO DAMAGE)	TEST: OK
2	Withstand 300VAC Surge	300VAC input for 5 seconds No damage	I/P: 300VAC O/P: FULL LOAD Ta: 25°C	TEST: OK
3	INPUT FREQUENCY RANGE	47HZ ~63 HZ NO DAMAGE	I/P: 90 VAC ~264 VAC O/P: FULL~NO LOAD Ta: 25°C	TEST: OK
4	AC CURRENT	2.2A/115VAC 1.1A/230VAC	I/P: 115 VAC I/P: 230 VAC O/P: FULL LOAD Ta: 25°C	I = 1.33A/ 115VAC I = 0.69A/ 230VAC
5	LEAKAGE CURRENT	< 0.75mA / 240VAC	I/P: 240 VAC O/P: NO LOAD Ta: 25°C	L-FG: 0.282mA N-FG: 0.271mA
6	INRUSH CURRENT(Typ)	230V/ 80A 115V/ 40A COLD START	I/P: 230 VAC/115VAC O/P: FULL LOAD Ta: 25°C	I = 72.8A/ 230VAC I = 32.8A/ 115VAC


INPUT=230VAC/50HZ @ FULL LOAD

CH2: Input current CH1: AC Input Voltage

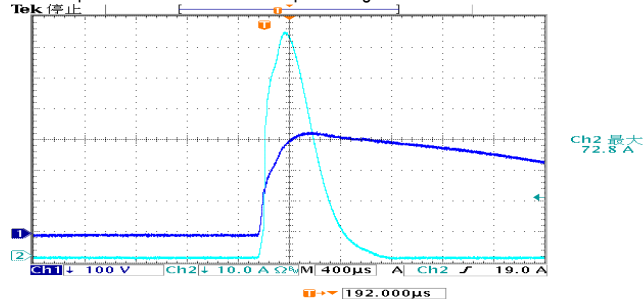

INPUT=115VAC/60HZ @ FULL LOAD


CH2: Input current CH1: AC Input Voltage

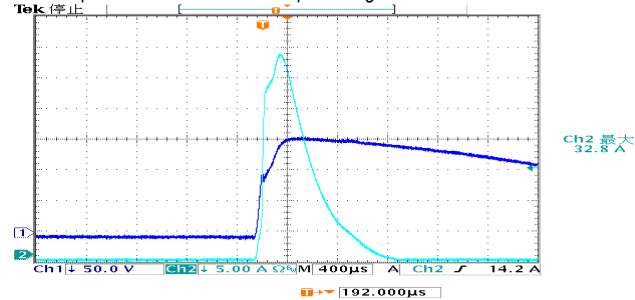




7	EFFICIENCY(Typ)	89%	I/P: 230VAC O/P: FULL LOAD Ta: 25°C	89.05 %
---	-----------------	-----	---	---------

EFFICIENCY vs LOAD

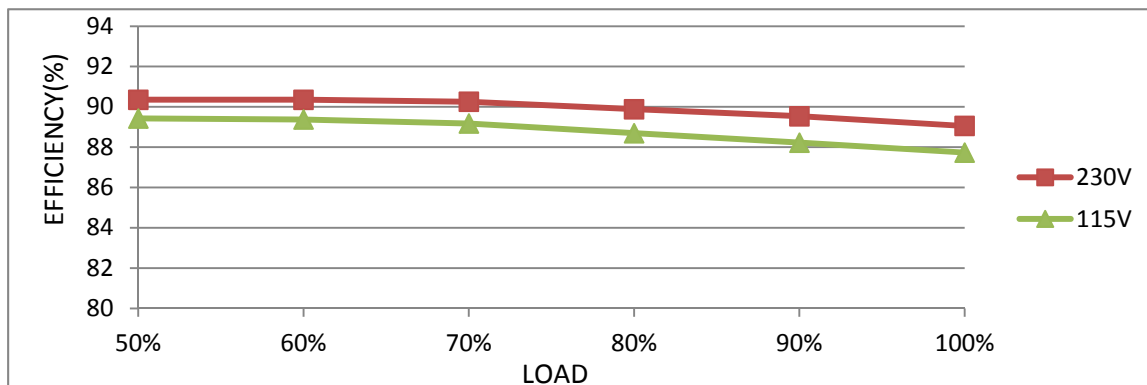

8	POWER FACTOR	0.94/ 230VAC 0.98/115VAC	I/P: 230 VAC I/P: 115 VAC O/P: FULL LOAD Ta: 25°C	PF=0.948/ 230VAC PF=0.992/ 115VAC
---	--------------	-----------------------------	--	--------------------------------------

P.F vs LOAD

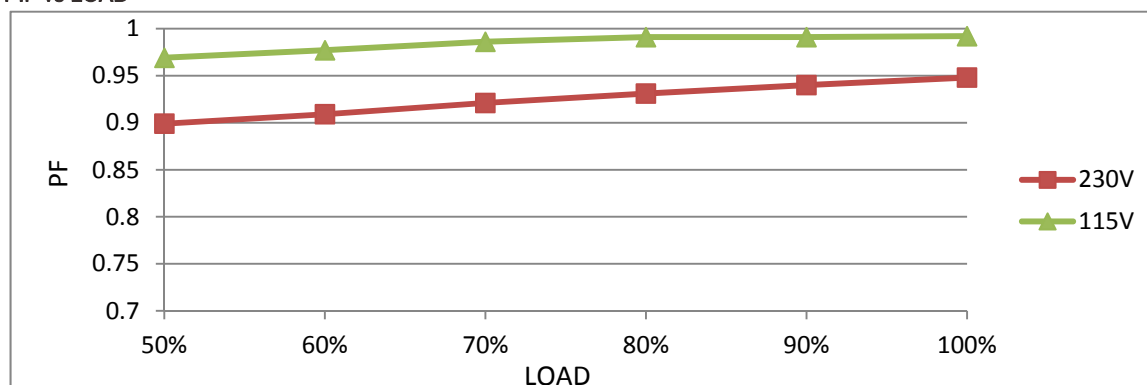

PROTECTION FUNCTION TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT
1	OVER CURRENT PROTECTION	110~140%	I/P: 110VAC I/P: 230VAC I/P: 264VAC O/P: TESTING Ta: 25°C	128.8 %/ 110VAC 128.5 %/ 230VAC 128.8%/ 264VAC Hiccup mode, recovers automatically after fault condition is removed
2	OVER VOLTAGE PROTECTION	3.8V~4.6V	I/P: 90VAC I/P: 230VAC I/P: 264VAC O/P: NO LOAD Ta: 25°C	4.142 V/ 90VAC 4.144 V/ 230VAC 4.179V/ 264VAC Shut down o/p voltage, re-power on to recovery
3	OVER TEMPERATURE PROTECTION	NO DAMAGE	I/P: 100VAC I/P: 230VAC I/P: 264VAC O/P: 90%/FULL LOAD	O.T.P. Active Shut down o/p voltage, recovers automatically after temperature goes down



CONTROL FUNCTION TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT
1	REDUNDANT CONTROL	For parallel connection protection:For parallel applications,when one PSU can not work,the another one will be automatically enabled.This can preven the system crash,and provide the reliability of system	I/P: 230 VAC O/P:FULL LOAD	TEST: OK
2	DCOK CONTACT RATINGS	15VDC/10mA RESISTIVE LOAD	I/P:230VAC O/P:FULL LOAD Ta:25°C	TEST: OK

COMPONENT STRESS TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT
1	PWM Power Transistor	Q5 Rated 18A/500V	I/P: High-Line +3V =267V O/P: (1) FULL LOAD Turn on (2) Output Short (3) FULL LOAD continue Ta: 25°C	(1) 440 V (2) 444 V (3) 438 V
2	O/P Diode (MOSFET)	Q100 Rated 30V/100A	I/P: High-Line +3V =267V O/P: (1) FULL LOAD Turn on (2) Output Short (3) FULL LOAD continue Ta: 25°C	(1) 11.0 V (2) 4.36 V (3) 10.6 V
3	Input Capacitor	C5 Rated 100u/ 450V	I/P: High-Line +3V =267 V O/P: (1) FULL LOAD input on/off (2) NO LOAD input on /Off (3) FULL LOAD /NO LOAD Change Ta: 25°C	(1) 432 V (2) 432 V (3) 430 V
4	Control IC	U1 Rated 38V (MAX.)	I/P: High-Line +3V =267 V O/P: ((1) FULL LOAD (2) Output Short (3) O.L.P (4) O.V.P (5) Low Line No Load Vo(min) Ta: 25°C	(1) 37.8 V (2) 26.2 V (3) 26.4 V (4) 27.2 V (5) 20.2 V
5	PFC Power Transistor	Q 1 Rated 26A/600V	I/P: High-Line +3V =267V O/P: (1) FULL LOAD Turn on (2) Output Short (3) FULL LOAD continue Ta: 25°C	(1) 538 V (2) 530 V (3) 536 V

SAFETY TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT
1	WITHSTAND VOLTAGE	I/P-O/P: 3.75 KVAC/min I/P-FG: 2.0 KVAC/min O/P-FG: 1.25 KVAC/min	I/P-O/P: 4.2 KVAC/min I/P-FG: 2.4 KVAC/min O/P-FG: 1.5 KVAC/min Ta: 25°C	I/P-O/P: 2.345 mA I/P-FG: 2.435 mA O/P-FG: 2.254 mA NO DAMAGE
2	ISOLATION RESISTANCE	I/P-O/P: 500VDC>100MΩ I/P-FG: 500VDC>100MΩ O/P-FG: 500VDC>100MΩ	I/P-O/P: 500 VDC I/P-FG: 500 VDC O/P-FG: 500 VDC Ta: 25°C/70%RH	I/P-O/P: >9999 MΩ I/P-FG: >9999 MΩ O/P-FG: >9999 MΩ
3	GROUNDING CONTINUITY	FG(PE) TO CHASSIS OR TRACE < 100 mΩ	40A / 2min Ta: 25°C	9 mΩ

E.M.C TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT
1	HARMONIC	EN61000-3-2	I/P: 230VAC/50HZ O/P: FULL LOAD Ta: 25°C	PASS
2	CONDUCTION	EN55032 CLASS B	I/P: 230 VAC (50HZ) O/P: FULL LOAD Ta: 25°C	PASS Test by certified Lab
3	RADIATION	EN55032 CLASS B	I/P: 230 VAC (50HZ) O/P: FULL LOAD Ta: 25°C	PASS Test by certified Lab
4	E.S.D	EN61000-4-2 HEAVY INDUSTRY AIR: 8KV Contact: 4KV	I/P: 230 VAC/50HZ O/P: FULL LOAD Ta: 25°C	PASS CRITERIA A
5	E.F.T	EN61000-4-4 HEAVY INDUSTRY INPUT: 2KV	I/P: 230VAC/50HZ O/P: FULL LOAD Ta: 25°C	PASS CRITERIA A
6	SURGE	EN61000-4-5 HEAVY INDUSTRY L-N: 2KV L,N-PE: 4KV	I/P: 230VAC/50HZ O/P: FULL LOAD Ta: 25°C	PASS CRITERIA A
7	Test by certified Lab & Test Report Prepare			

■ **RELIABILITY TEST**

ENVIRONMENT TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT																																																																
1	TEMPERATURE RISE TEST	MODEL: UHP-200-5 1. ROOM AMBIENT BURN-IN: 2 HRS I/P: 230VAC O/P: FULL LOAD Ta=29.4℃ 2. HIGH AMBIENT BURN-IN: 2 HRS I/P: 230VAC O/P: FULL LOAD Ta=49.6℃																																																																		
				<table border="1"> <thead> <tr> <th>NO</th> <th>Position</th> <th>ROOM AMBIENT Ta=29.4 ℃</th> <th>HIGH AMBIENT Ta=49.6 ℃</th> </tr> </thead> <tbody> <tr><td>1</td><td>RT1</td><td>77.6℃</td><td>90.4℃</td></tr> <tr><td>2</td><td>ZR1</td><td>48.9℃</td><td>68.9℃</td></tr> <tr><td>3</td><td>BD1</td><td>56.7℃</td><td>77.0℃</td></tr> <tr><td>4</td><td>Q1</td><td>61.7℃</td><td>82.4℃</td></tr> <tr><td>5</td><td>C5</td><td>54.3℃</td><td>74.5℃</td></tr> <tr><td>6</td><td>U1</td><td>54.1℃</td><td>74.6℃</td></tr> <tr><td>7</td><td>Q5</td><td>55.5℃</td><td>76.4℃</td></tr> <tr><td>8</td><td>Q6</td><td>57.7℃</td><td>78.6℃</td></tr> <tr><td>9</td><td>U3</td><td>52.4℃</td><td>73.2℃</td></tr> <tr><td>10</td><td>T1</td><td>74.4℃</td><td>95.7℃</td></tr> <tr><td>11</td><td>Q101</td><td>68.8℃</td><td>90.2℃</td></tr> <tr><td>12</td><td>Q103</td><td>72.7℃</td><td>95.1℃</td></tr> <tr><td>13</td><td>C105</td><td>68.8℃</td><td>89.5℃</td></tr> <tr><td>14</td><td>TSW1</td><td>49.2℃</td><td>69.5℃</td></tr> <tr><td>15</td><td>TC</td><td>49.1℃</td><td>69.3℃</td></tr> </tbody> </table>	NO	Position	ROOM AMBIENT Ta=29.4 ℃	HIGH AMBIENT Ta=49.6 ℃	1	RT1	77.6℃	90.4℃	2	ZR1	48.9℃	68.9℃	3	BD1	56.7℃	77.0℃	4	Q1	61.7℃	82.4℃	5	C5	54.3℃	74.5℃	6	U1	54.1℃	74.6℃	7	Q5	55.5℃	76.4℃	8	Q6	57.7℃	78.6℃	9	U3	52.4℃	73.2℃	10	T1	74.4℃	95.7℃	11	Q101	68.8℃	90.2℃	12	Q103	72.7℃	95.1℃	13	C105	68.8℃	89.5℃	14	TSW1	49.2℃	69.5℃	15	TC	49.1℃	69.3℃
NO	Position	ROOM AMBIENT Ta=29.4 ℃	HIGH AMBIENT Ta=49.6 ℃																																																																	
1	RT1	77.6℃	90.4℃																																																																	
2	ZR1	48.9℃	68.9℃																																																																	
3	BD1	56.7℃	77.0℃																																																																	
4	Q1	61.7℃	82.4℃																																																																	
5	C5	54.3℃	74.5℃																																																																	
6	U1	54.1℃	74.6℃																																																																	
7	Q5	55.5℃	76.4℃																																																																	
8	Q6	57.7℃	78.6℃																																																																	
9	U3	52.4℃	73.2℃																																																																	
10	T1	74.4℃	95.7℃																																																																	
11	Q101	68.8℃	90.2℃																																																																	
12	Q103	72.7℃	95.1℃																																																																	
13	C105	68.8℃	89.5℃																																																																	
14	TSW1	49.2℃	69.5℃																																																																	
15	TC	49.1℃	69.3℃																																																																	
2	LOW TEMPERATURE TURN ON TEST	TURN ON AFTER 2 HOUR	I/P: 264VAC/90VAC O/P: FULL /75% LOAD Ta= -35℃	TEST: OK																																																																
3	HIGH HUMIDITY HIGH TEMPERATURE HIGH VOLTAGE TURN ON TEST	AFTER 12 HOURS IN CHAMBER ON CONTROL 50℃ NO DAMAGE	I/P: 264VAC O/P: FULL LOAD Ta=50℃ HUMIDITY= 95%R.H	TEST: OK																																																																
4	TEMPERATURE COEFFICIENT	±0.03 %/℃ (0~50℃)	I/P: 230 VAC O/P: FULL LOAD	±0.004%/℃ (0~50℃)																																																																
5	STORAGE TEMPERATURE TEST	1. Thermal shock Temperature: -45℃ ~ +90℃ 2. Temperature change rate : 25℃ / MIN 3. Dwell time low and high temperature : 30 MIN/EACH 4. Total test cycle: 5 CYCLE 5. Input/Output condition: STATIC		TEST: OK																																																																
6	THERMAL SHOCK TEST	1. Thermal shock Temperature: -35℃ ~ +55℃ 2. Temperature change rate : 25℃ / MIN 3. Dwell time low and high temperature : 30 MIN/EACH 4. Total test cycle: 10 CYCLE 5. Input/Output condition: 230VAC/FULL LOAD AC ON/OFF TEST AC on 3 sec/AC off 1 sec TEST		TEST: OK																																																																



200W Slim Type with PFC Switching Power Supply

UHP-200 series

7	VIBRATION TEST	1 Carton & 1 Set (1) Waveform: Sine Wave (2) Frequency: 10~500Hz (3) Sweep Time: 10min/sweep cycle (4) Acceleration: 5G (5) Test Time: 60min in each axes (X.Y.Z) (6) Ta: 25°C	TEST: OK
8	CAPACITOR LIFE CYCLE	UHP-200-5: SUPPOSE C105 IS THE MOST CRITICAL COMPONENT (1) I/P: 230VAC O/P: FULL LOAD Ta= 25 °C LIFE TIME (2) I/P: 230VAC O/P: FULL LOAD Ta= 50 °C LIFE TIME (3) I/P: 230VAC O/P: 75% LOAD Ta= 50 °C LIFE TIME (4) I/P: 230VAC O/P: 50% LOAD Ta= 50 °C LIFE TIME	(1) 78863 HRS (2) 13463 HRS (3) 55660 HRS (4) 148521 HRS
9	MTBF	Conducted by Parts Stress Analysis Prediction 257K hrs min. MIL-HDBK-217F (25°C)	
10	DMTBF/Accelerated Life Test	Demonstration Mean Time Between Failure(Expected Life) : 30,000 hours @ Ta 50°C	

TEST RESULT	TESTER	REVIEW	APPROVAL
PASS	SHENJW/ZHUOKB	SKY	LIUWY