



***Allen-Bradley***

***Bulletin 2705  
RediPANEL  
Keypad  
Modules***

***(Cat. Nos. 2705-K11C1,  
-K11C2, -K12C2, -K12C3,  
-K12C4)***

# User Manual

## Important User Information

Solid state equipment has operational characteristics differing from those of electromechanical equipment. “Safety Guidelines for the Application, Installation and Maintenance of Solid State Controls” (Publication SGI-1.1) describes some important differences between solid state equipment and hard-wired electromechanical devices. Because of this difference, and also because of the wide variety of uses for solid state equipment, all persons responsible for applying this equipment must satisfy themselves that each intended application of this equipment is acceptable.

In no event will the Allen-Bradley Company be responsible or liable for indirect or consequential damages resulting from the use or application of this equipment.

The examples and diagrams in this manual are included solely for illustrative purposes. Because of the many variables and requirements associated with any particular installation, the Allen-Bradley Company cannot assume responsibility or liability for actual use based on the examples and diagrams.

No patent liability is assumed by Allen-Bradley Company with respect to use of information, circuits, equipment, or software described in this manual.

Reproduction of the contents of this manual, in whole or in part, without written permission of the Allen-Bradley Company is prohibited.

Throughout this manual we use notes to make you aware of safety considerations.



**ATTENTION:** Identifies information about practices or circumstances that can lead to personal injury or death, property damage, or economic loss.

---

Attentions help you:

- identify a hazard
- avoid the hazard
- recognize the consequences

**Important:** Identifies information that is especially important for successful application and understanding of the product.

**Using this Manual**

**Chapter 1**

|                                 |     |
|---------------------------------|-----|
| Chapter Objectives .....        | 1-1 |
| What this Manual Contains ..... | 1-1 |
| Audience .....                  | 1-2 |
| Reference Materials .....       | 1-2 |
| Definition of Terms .....       | 1-2 |

**Product Introduction**

**Chapter 2**

|                                 |     |
|---------------------------------|-----|
| Chapter Objectives .....        | 2-1 |
| Features .....                  | 2-1 |
| Functions .....                 | 2-1 |
| Applications .....              | 2-2 |
| Operator Data Input .....       | 2-3 |
| Information Display .....       | 2-3 |
| Remote I/O Communications ..... | 2-3 |

**Installing the Bulletin 2705 Keypad Module**

**Chapter 3**

|  |       |
|--|-------|
| Chapter Objectives   | 3-1   |
| Electrical Precautions   | 3-1   |
| Power Requirements   | 3-1   |
| Grounding  | 3-2   |
| NEMA Enclosures  | 3-2   |
| Mechanical Installation  | 3-3   |
| Connecting to a Remote I/O Link                                      | 3-5   |
| Connecting to a Scanner Module                                       | 3-6   |
| Chapter Objectives .....   | 11-12 |
| SET AUTORUN? Entering the Special Functions Menu,<br>SET PORT? ..... | 1-12  |

**Configuring the Bulletin 2705 Keypad Module with PLC's**

**Chapter 4**

|                               |     |
|-------------------------------|-----|
| Chapter Objectives            | 4-1 |
| Communications                | 4-1 |
| Remote I/O Architecture       | 4-2 |
| Compatible PLC's and Scanners | 4-5 |
| Calculating Rack Size         | 4-7 |
| Remote I/O Configuration      | 4-8 |

## Selecting Options

### Chapter 5

|                         |     |
|-------------------------|-----|
| Chapter Objectives      | 5-1 |
| DIP Switches            | 5-1 |
| Typical Switch Settings | 5-2 |
| Setting Switch Bank #1  | 5-2 |
| Setting Switch Bank #2  | 5-4 |
| Setting Switch Bank #3  | 5-5 |

## Operating Modes

### Chapter 6

|                        |     |
|------------------------|-----|
| Chapter Objectives     | 6-1 |
| Keypad Output Display  | 6-1 |
| Numeric Data           | 6-2 |
| ASCII Data             | 6-2 |
| Display Stored Message | 6-2 |
| ASCII Message Display  | 6-2 |
| Data Entry             | 6-3 |
| Split Display          | 6-4 |
| Decimal Modes          | 6-4 |
| Polarity               | 6-4 |
| Destination Entry      | 6-4 |
| Messages               | 6-5 |
| Keyboard               | 6-6 |
| Entering Messages      | 6-7 |
| Storing                | 6-7 |
| Editing                | 6-7 |
| Editing Commands       | 6-8 |

## Programming

### Chapter 7

|  |      |
|--|------|
| Chapter Objectives   | 7-1  |
| Introduction to Programming with the Keypad<br>Module            | 7-1  |
| PLC-5 Programming Examples                                       | 7-2  |
| System Configuration   | 7-2  |
| Input and Output Image Tables                                    | 7-3  |
| Displaying Numeric Data  | 7-4  |
| Triggering a Stored Message to Describe Data                     | 7-5  |
| Displaying a Full Line Stored Message                            | 7-6  |
| Entering or Changing Data with the Keypad<br>Module              | 7-7  |
| Using the Destination Function to Load Multiple<br>Timer Presets | 7-9  |
| Using PLC-5's and a Sub I/O Scanner with Keypad Modules          | 7-11 |

|   |      |
|---|------|
| Instruction Parameters  | 7-12 |
| Programming Example   | 7-13 |
| Programming Example   | 7-15 |
| PLC-2 Programming Example   | 7-16 |
| PLC-2 Example Program   | 7-17 |
| Program Set-up  | 7-19 |
| Part A: Changing and Examining Accumulated Value of Counter for PLC-2 | 7-21 |
| Part B: Changing and Examining Preset Value of Counter for PLC-2      | 7-22 |
| Part C: Displaying a 16-Character Message for PLC-2                   | 7-23 |
| Part D: Displaying Message and Variable Data Simultaneously for PLC-2 | 7-24 |
| Part E: Using Destination Bits to Retrieve or Change Data for PLC-2   | 7-24 |
| Symbols and Abbreviations for I/O Image Tables                        | 7-25 |
| Decimal Point Control   | 7-26 |
| When to Use the Handshake Mode  | 7-28 |
| Input and Output Image Tables   | 7-30 |
| Integer Data – With Stored Message                                    | 7-30 |
| BCD Data – With Stored Message  | 7-31 |
| Binary Data – With Stored Message                                     | 7-32 |
| Integer Data – No Stored Message                                      | 7-33 |
| BCD Data – No Stored Message  | 7-35 |
| Binary Data – No Stored Message                                       | 7-37 |

## Maintenance and Troubleshooting

### Chapter 8

|   |     |
|---|-----|
| Chapter Objectives                      | 8-1 |
| Using the Comm/Fault LED Indicators     | 8-1 |
| Power-up Sequence Error Message Display | 8-2 |
| Basic Troubleshooting Questions         | 8-3 |

## Specifications

### Chapter 9

|                    |     |
|--------------------|-----|
| Chapter Objectives | 9-1 |
| Specifications     | 9-1 |

## Appendix

### A

|                    |     |
|--------------------|-----|
| Error Messages     | A-1 |
| Display Characters | A-3 |

|                    |            |
|--------------------|------------|
| <b>Index</b> ..... | <b>I-1</b> |
|                    | iii        |

## Using this Manual

### Chapter Objectives

This chapter describes the manual's organization, intended audience, and special terminology.

### What this Manual Contains

This manual describes the equipment, communication protocol, command structure, installation, operation, troubleshooting, and specifications for the Allen-Bradley Bulletin 2705 RediPANEL™ Keypad Modules (Catalog Numbers: 2705-K11C1, -K11C2, -K12C2, -K12C3, -K12C4).

You will want to study this manual before installing, interconnecting, or operating the Keypad Module.

Table 1.A shows the manual's organization.

| Chapter | Title                                    | Purpose   |
|---------|--|---|
| 1       | Using this Manual                        | Gives guidance on how to use this manual properly.  |
| 2       | Product Introduction                     | Describes Keypad features and functions.  |
| 3       | Installing the Keypad Module             | Describes electrical, power and grounding requirements, gives procedures for connecting to remote I/O links and scanners. |
| 4       | Configuring the Keypad Module with PLC's | Provides communication and configuration parameters as well as application considerations.                                |
| 5       | Selecting Options                        | Describes DIP switch settings.  |
| 6       | Operating Modes                          | Explains data input and display modes, and message entering, editing and storing.   |
| 7       | Programming                              | Describes programming, explains sample program, and lists input/output image tables.                                      |
| 8       | Maintenance and Troubleshooting          | Covers basic troubleshooting questions, LED displays, and power-up sequence.  |
| 9       | Specifications                           | Lists the design and operating specifications for the Module.   |

## Audience

To get maximum benefit from this manual and the best use of the Bulletin 2705 Keypad Module in your system, you must be able to operate and program an Allen–Bradley Programmable Logic Controller (PLC) or Small Logic Controller (SLC).

## Reference Materials

We make reference in this manual to several other publications. They are:

- Allen–Bradley Publication 1770–4.1 (for grounding and wiring guidelines).
- *National Electrical Code* published by the National Fire Protection Association of Boston, Massachusetts (wire sizes and types for grounding electrical equipment)
- Programmable Controller and scanner module literature. Refer to page 4–6 for publication numbers.
- Bulletin 2705 Keypad Programming Software User’s Manual

## Definition of Major Terms

We use the following terms and acronyms in this manual:

|               |   |
|---------------|---|
| Keypad Module | -Allen–Bradley Bulletin 2705 RediPANEL Keypad Modules (Catalog Numbers: 2705–K11C1, –K11C2, –K12C2, –K12C3, –K12C4) |
| PLC           | Programmable Logic Controller   |
| SLC           | Small Logic Controller  |

## Product Introduction

### Chapter Objectives

This chapter describes the features, functions and operation of the Bulletin 2705 RediPANEL Keypad Module.

### Features

The Bulletin 2705 RediPANEL Keypad Module is an operator module that connects directly to an Allen–Bradley PLC via the remote I/O link. It provides the capability for operators to input data to and retrieve data from the PLC. It also functions as a single line message display. The Keypad Module supports the following features:

- Sixteen character alphanumeric display
- Numeric keypad with keys for DELETE, ENTER, Decimal and Polarity
- Six programmable function keys with six programmable LED indicators
- Remote I/O networking. Up to 16 modules can be located along a single cable up to 10,000 feet away from the PLC
- On–board message storage and message editor
- NEMA Type 4X rating when panel mounted (indoor use only)
- Security keyswitch
- Security keyswitch option
- Complete diagnostics
- Binary, BCD and integer data types
- Power Source 90–265 Volts AC or 18–30 Volts DC
- Power Source 120/240 Volts AC or 18–30 Volts DC
- UL listed Class I; Division 2 versions available
- Additional data access with Destination Function
- IBM based Keypad Programming Software

### Functions

- Replaces multiple thumbwheels
- Acts like a remote I/O rack:
  - Accepts operator input of numeric data and sends it to the Programmable Logic Controller (PLC)
  - Retrieves data from the PLC
- Displays numeric data with related text
- Allows operators to display messages that can:
  - prompt operators
  - display alarm messages
  - display machine or process status
- Provides alarm annunciator with acknowledgment capabilities

## Applications


The Keypad Module combines the functions of standard thumbwheel or push button devices with the built-in capabilities of a remote I/O rack.

The Keypad Module communicates directly with the programmable controller via the Remote I/O link. You can install a 2705 module anywhere along that link.

To the PLC, the Keypad Module looks like a hardwired remote I/O rack. The function keys and the LED output signals are programmed as discrete I/O in the PLC. Communication occurs through I/O image table updates.

Figure 2.1 shows a typical application.

**Figure 2.1**  
**Typical RediPANEL Keypad Application**

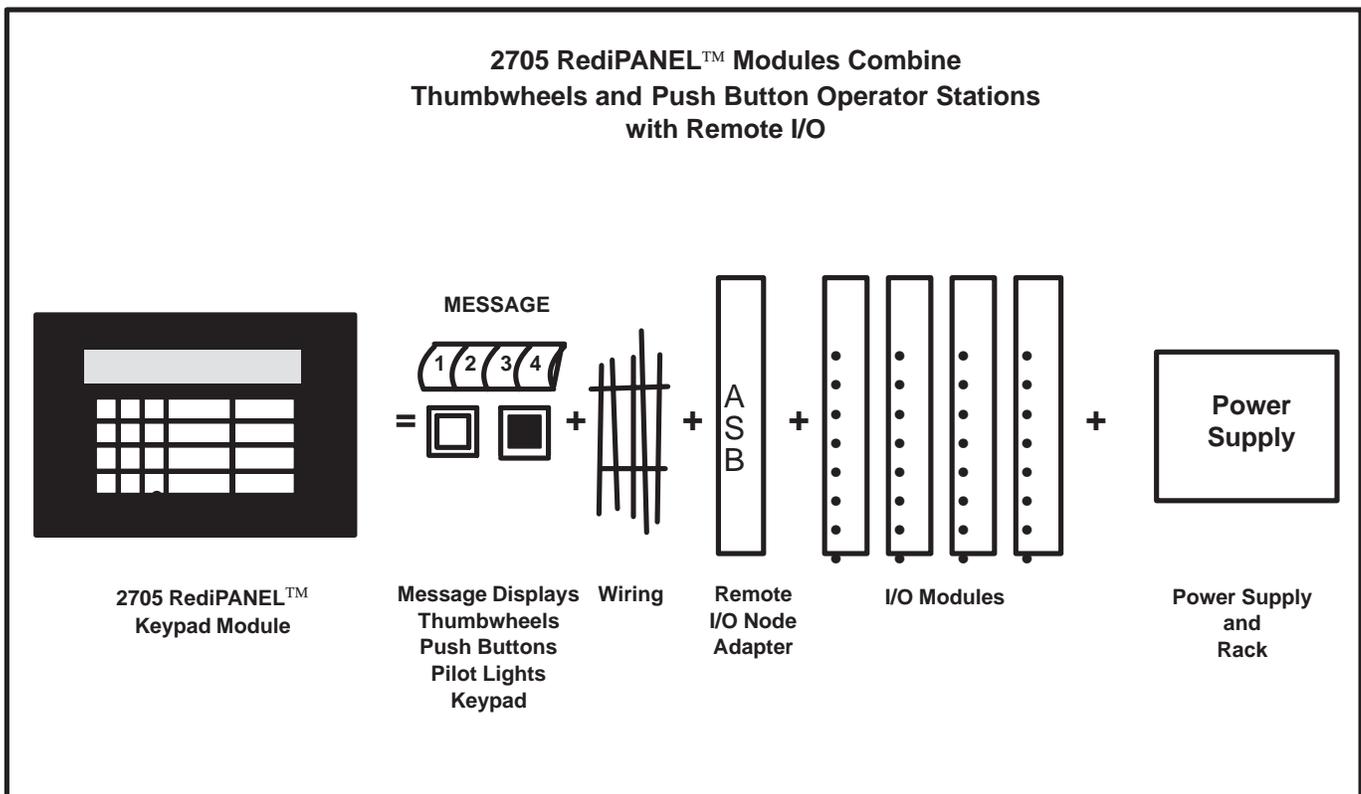

## Operator Data Input

The 2705 RediPANEL Keypad Module features a numeric keypad with DELETE, ENTER, decimal and polarity keys. Using the keypad, operators can enter up to eight (8) digits (seven digits for signed numbers), which appear on the right side of the 16 character display. If an attempt is made to enter more than eight digits, only the first eight are accepted.

If mistakes are made while entering data, the display can be cleared one character at a time by depressing the DELETE key. The data is not transmitted to the PLC until the ENTER key is depressed. The DECIMAL POINT key allows operators to enter decimal numbers.

Six user-definable function keys are also provided. These keys can be used for:

- Any momentary push button function.
- Acknowledging alarm messages.

Each function key features an independent LED.

A terminal block is provided for hardwiring a security keyswitch. When the Normally Open contact is closed, it locks out the functionality of the numeric keypad, but allows the use of the function keys 1 through 6 and destination value functions.

## Information Display

The RediPANEL Keypad Module features a sixteen character, alphanumeric, vacuum fluorescent display. It can display input information from the keypad, ASCII and numeric data from the PLC, and messages that are stored in the module.

The module can display any one of the following combinations of information at any one time:

- 1) All ASCII data. This can consist of either:
  - a) A single-line, 16 character message stored inside the module. Up to 120 single line messages can be stored in the EEPROM inside the module. To create and edit messages, the modules feature a built-in message editor. The editor is accessed by plugging an IBM-XT/AT keyboard (or compatible) into the receptacle located on the back of the module.
  - b) Up to 12 ASCII characters from the PLC.

In this manner, the Keypad Module can display text to inform and prompt operators. It can also be used to display alarm messages that are stored on the keypad's EEPROM inside the module.

- 2) A combination of ASCII and numeric data. Up to 8 characters of ASCII data are displayed on the left side of the display and 8 digits of numeric data are displayed on the right side of the display. This allows you to label numeric data with text.

The ASCII data can consist of either the first 8 characters of a stored message or 8 characters sent from the PLC controller. The 8 digits of numeric data can represent either operator input from the keypad or 8 characters from the PLC controller.

The module can support three data type formats for numeric data: binary, BCD, and integer. The data type is selected via a DIP switch on the module. Binary and BCD modes apply to the PLC-2 family of processors. Data type formats for the PLC-3 and PLC-5 controllers can be either binary, BCD or integer. These data type selections apply only to numeric values that are displayed.

## Remote I/O Communications

2705 RediPANEL Modules combine the functions of standard panel devices with the capabilities of a Remote I/O Rack - all in one package.

2705 RediPANEL Modules connect to remote I/O scanners and sub-scanners just like remote I/O racks. This replaces large wire bundles with a single twin-axial cable that connects the module to the programmable controller. Up to 16 separate modules can be located on a single cable up to 10,000 feet away from the PLC.

The modules are addressed through DIP switch settings, in the same manner as remote I/O racks. Additional DIP switches allow you to select the following features:

- Handshake - Holds an input signal ON until the programmable controller recognizes it.
- Keyswitch - Enables the terminal block for the security lockout keyswitch.
- Data Format - Two DIP switches are used to select either binary, BCD or integer data types.
- Stored Message Display - When enabled determines whether to display ASCII messages from the PLC or messages stored in the module's EEPROM.
- Split Display - Enables the split display feature.

## Installing the Bulletin 2705 Keypad Module

### Chapter Objectives

This chapter lists electrical precautions and power and grounding requirements for installing the Bulletin 2705 RediPANEL Keypad Module. Topics also include selecting NEMA enclosures, the mechanical installation of the module, and connecting to remote I/O links and to scanner modules.

### Electrical Precautions

Install the Bulletin 2705 Keypad Module using publication NFPA 70E, Electrical Safety Requirements for Employee Workplaces. In addition to the NFPA general guidelines, we have added some specific guidelines.



#### **ATTENTION:**

Do not program any of the function keys on the Keypad Module as emergency stop switches. Emergency stop switches must be hard-wired to the master control relay of the system in order to turn off all machine power completely.

---

Careful routing helps cut down on electrical noise. Route incoming power to the module by a separate path from the communication cables.

#### **Do not run communications wiring and power wiring in the same conduit!**

Where wire paths must cross, make their intersection perpendicular.

With solid state systems, grounding helps to limit the effects of noise due to electromagnetic interference (EMI). To avoid problems caused by EMI, use shielded cables.

### Power Requirements

Before connecting the Keypad Module to the incoming power, verify that the power source and module type (AC or DC) are in agreement.

The Keypad Module will operate from these sources:

- 90–265 Volts AC, switch selectable, 47–63Hz
- 18–30 Volts DC

## Grounding

Grounding is an important safety measure in electrical installations. With solid state systems, as we mentioned before, grounding also helps to limit the effect of noise due to EMI (electromagnetic interference).

An authoritative source on grounding requirements is the *National Electrical Code* published by the National Fire Protection Association of Boston, Massachusetts. An article of the *Code* discusses the types and sizes of wire conductors and safe methods of grounding electrical equipment and components.

## NEMA Enclosures

You must use a NEMA enclosure to protect the electronics of the Keypad Module from atmospheric contamination. Standards established by the National Electrical Manufacturer's Association (NEMA) define enclosure types based on the degree of protection an enclosure will provide.

Select an enclosure that meets the requirements of NEMA Type 4.

Within the NEMA enclosure, the Keypad Module (or modules) needs enough room to allow for convection cooling. If the ambient temperature around the enclosure is below +40°C, you may use an unvented enclosure.

To mount several modules in the same enclosure, follow these guidelines (see Figure 3.1 on the following page):

- **Vertical stacking of modules:** The lower edge of the top cutout must be at least 6 inches (15cm) from the top edge of the lower cutout. The enclosure must be at least 8 inches (20cm) deep.
- **Horizontal mounting:** You can mount modules as close together as physically possible. The enclosure must be at least 8 inches (20cm) deep.


In some applications, you may also have to deal with heat produced by other equipment inside (or outside) the enclosure. In such a case, you may place blower fans inside the enclosure to assist in circulating air to reduce hot spots near the components.

Do not bring in unfiltered outside air - it could contain contaminants or dirt harmful to the components.

In extreme cases, you may have to use air conditioning to protect against heat buildup within the enclosure.


Figure 3.1 shows recommended spacing for modules inside the NEMA enclosure.

**Figure 3.1**  
**Spacing for Modules inside the NEMA Enclosure**

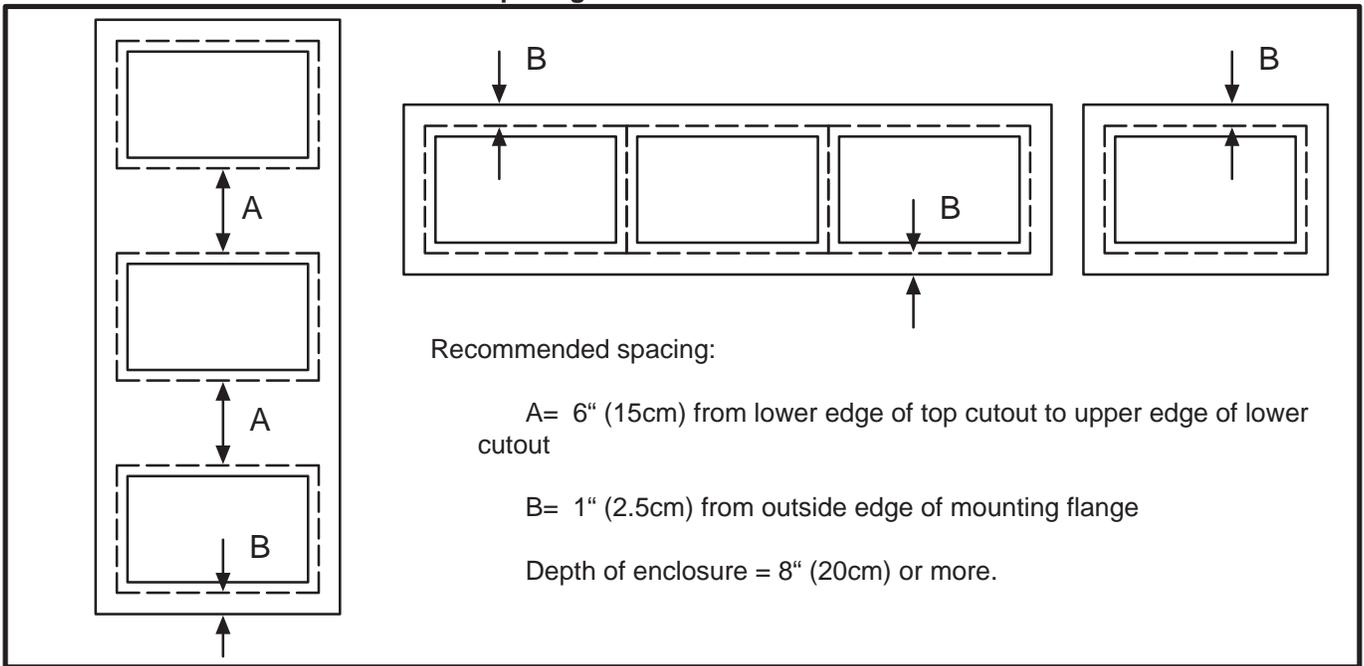

## Mechanical Installation


Mounting tabs are built into the module. After you slide the module into the enclosure, the tabs secure the module to the enclosure. See Figure 3.2. The installation procedure is listed on the following page.

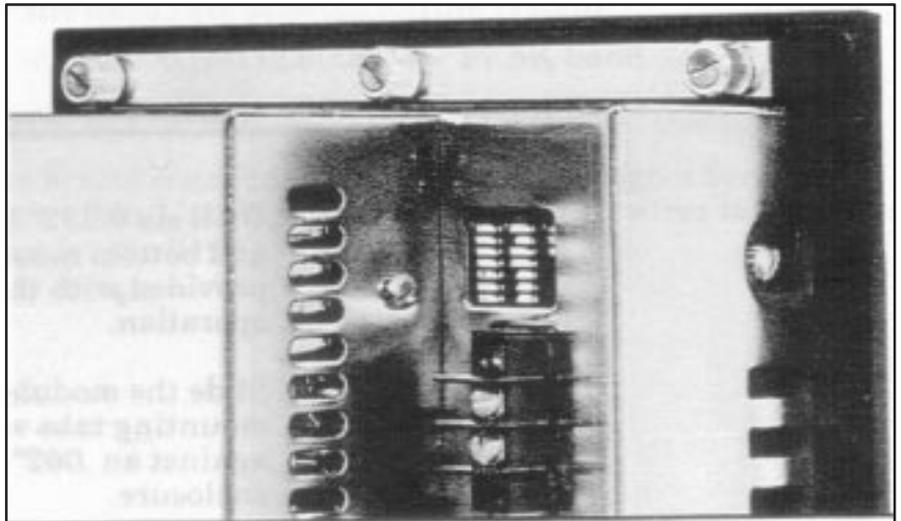

To install the module, follow these guidelines:

**Step 1** - Cut an opening in the panel approximately 5.86" (149mm) H x 8.61" (219mm) W. See Figure 3.3.

**Figure 3.3**  
**Mounting Dimensions of the Module**

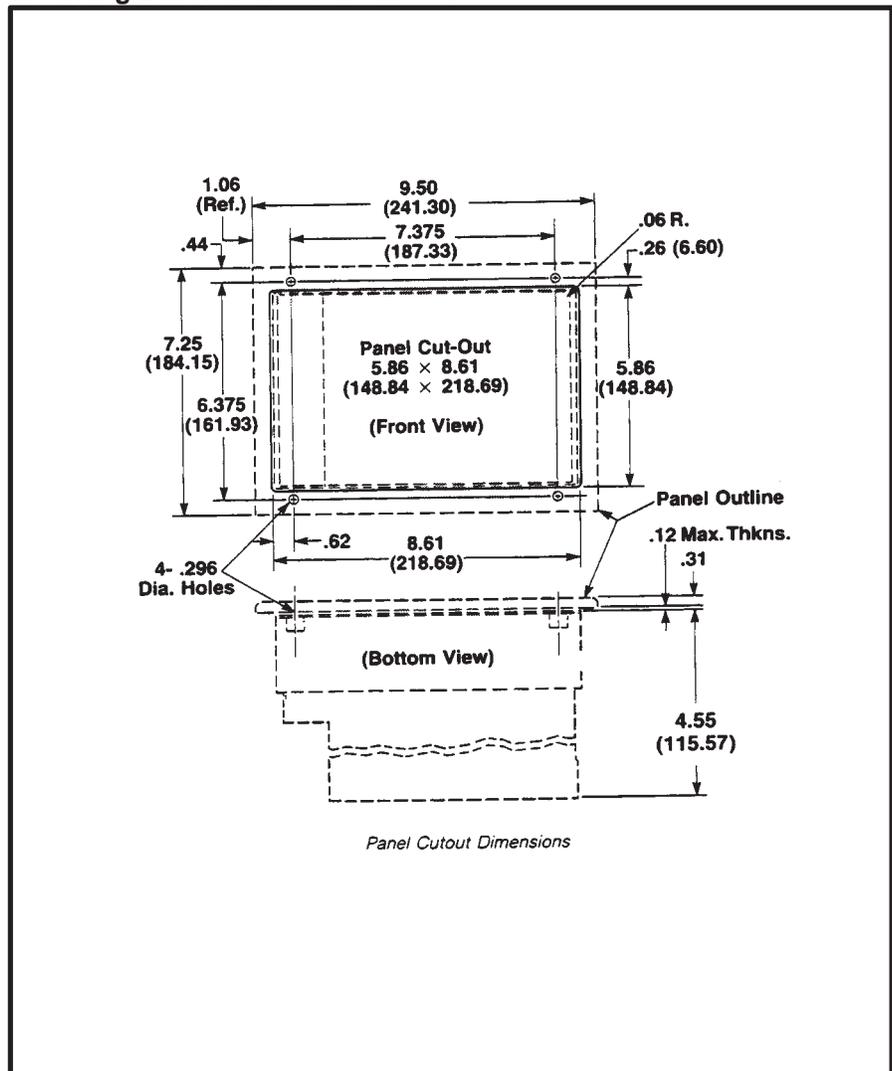


**Step 2** - Drill six 0.312" (7.6mm) diameter holes for the top and bottom mounting brackets. A template is provided with the module to assist in this operation.

**Step 3** - Slide the module through the opening. The mounting tabs will help seat the module tightly against an .062" (1.6mm) to .125" (3.2mm) thick enclosure.

**Step 4** - To complete the mechanical installation, apply the mounting brackets and tighten all the captive knurled thumbscrews to 5 in-lbs. only. A torque screwdriver is recommended for this operation. Figure 3.4 shows the location of these screws.

**Figure 3.4**  
**Mounting Bracket Thumbscrews**

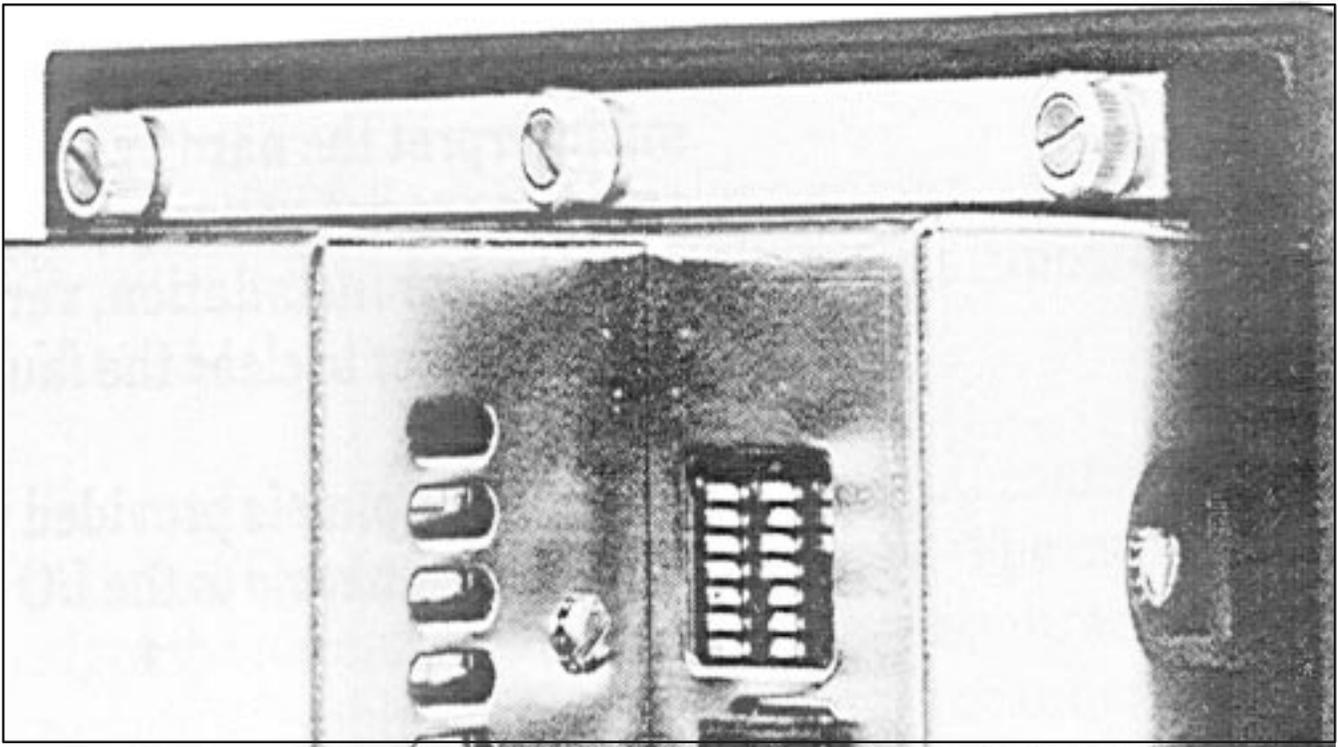

### Connecting to a Remote I/O Link

The remote I/O link begins at the scanner module. The scanner modules and PLC controllers impose physical and logical limitations on the link. You have to know these limitations to avoid exceeding them.

- To the rest of the system, the Keypad Module looks like a remote I/O rack, and is addressed as such.
- You may distribute up to 16 remote I/O devices along the link.
- The maximum cable length (link distance) is limited by the baud rate selected for the system:
  - 10,000 feet (2,800m) for 57.5K baud
  - 5,000 feet (1,400m) for 115.2K baud
  - 2,500 feet (700m) for 230.4K baud

The actual connection to the link is through a Serial Data Link cable (Catalog No. 1770-CD) which wires to a connector plug for the Keypad Module.

## Connecting a Scanner Module

Connect the Keypad Module to the scanner module with Allen–Bradley I/O cable (Catalog No. 1770–CD) or Belden #9463.


Refer to Publication 1770–4.1 for detailed grounding and wiring guidelines. The user’s manual or product data sheet for your scanner module will also provide cabling information.

**Important:** When first installed, the Keypad Module may misinterpret the hardware configuration if the DIP switch settings are not entirely correct. If the FAULT indicator flashes after installation, verify the DIP switch settings and recycle power to clear the fault.

A connector plug is provided with each Keypad Module. Wire the connector to the I/O cable according to Figure 3.5 below.

**Figure 3.5**  
**Wiring Connections for the Communications Cable**

The Belden twin–axial cable is the link that ties the Bulletin 2705 RediPANEL Modules to the Remote I/O communications. It is to be wired from the mating connector of the user’s scanner module to the mating connector of the 2705 modules.

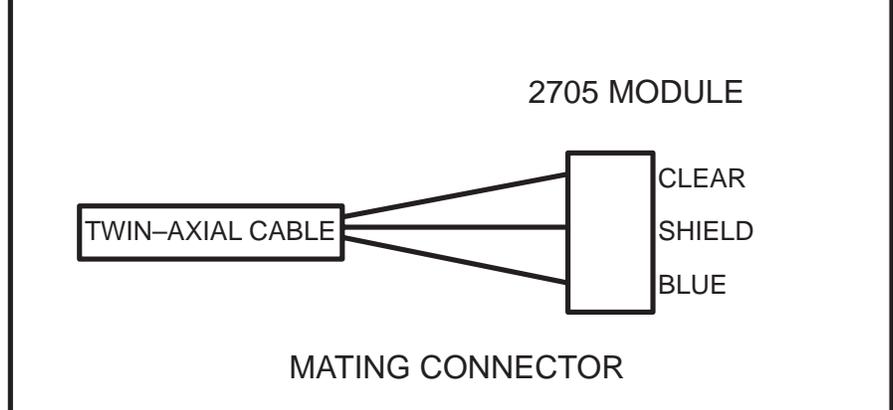

## Configuring the Bulletin 2705 Keypad Module with PLC Controllers

### Chapter Objectives

This chapter lists compatibility considerations for operating the Bulletin 2705 RediPANEL Keypad Module with programmable controllers via the remote I/O link. Topics also include the remote I/O architecture and factors in calculating rack size.

### Communications

Bulletin 2705 Keypad Modules communicate with all Allen–Bradley programmable controllers that support the remote I/O link.

The modules communicate with the PLC controllers through remote I/O scanners and sub-scanners. The modules contain all of the necessary electronics to connect directly to the remote I/O cable that originates from a scanner or sub-scanner module. The scanners have both physical and logical limitations. The physical limitations refer to the number of separate chassis (I/O racks, drive systems, or RediPANEL Modules) the scanner can accommodate. The logical limitations refer to the amount of I/O the scanner can address.

To configure RediPANEL Modules with PLC controllers you need to know:

1. The appropriate scanner module for the PLC controller. This can be found in the next section titled Remote I/O Architecture.
2. The amount of I/O the RediPANEL Module utilizes. This is found in the section titled Calculating Rack Size on Page 4–7.
3. The number of chassis and amount of I/O that the scanner can accommodate. This is found in the section titled Remote I/O Configuration on Page 4–8.

Remote I/O Architecture

The following diagrams show applications using the Bulletin 2705 Keypad Module in systems using applicable PLC's and scanners.

Figure 4.1  
Keypad Module with Mini-PLC (PLC-2/05, PLC-2/15, PLC-2/16, PLC-2/17)



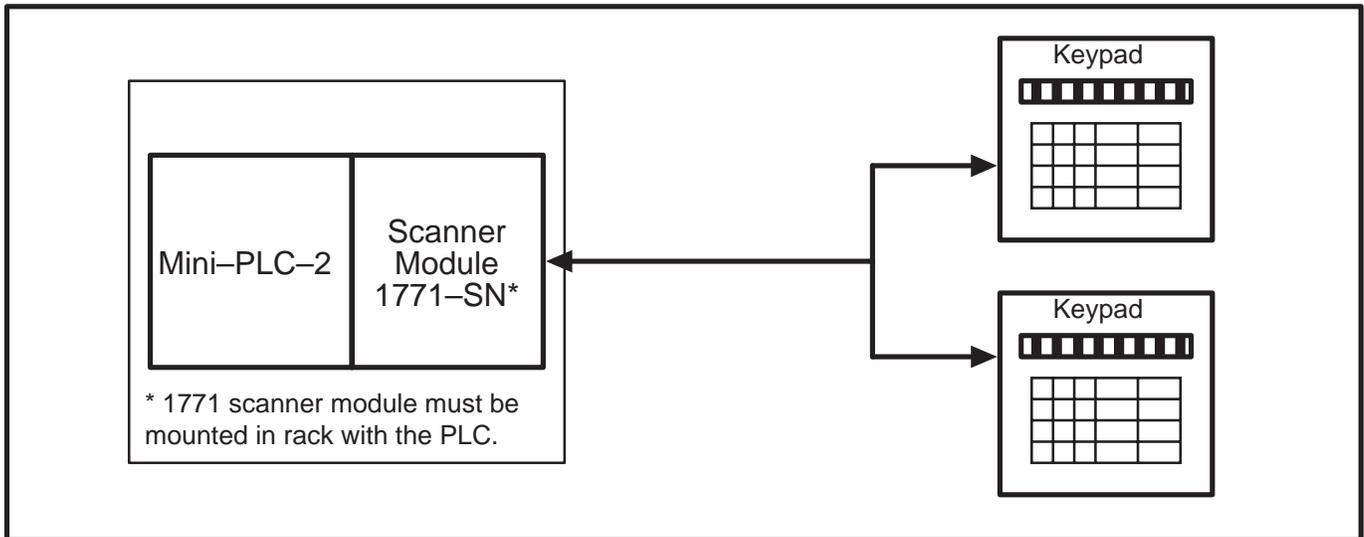


Figure 4.2  
Keypad Module with PLC-2/20 or PLC 2/30

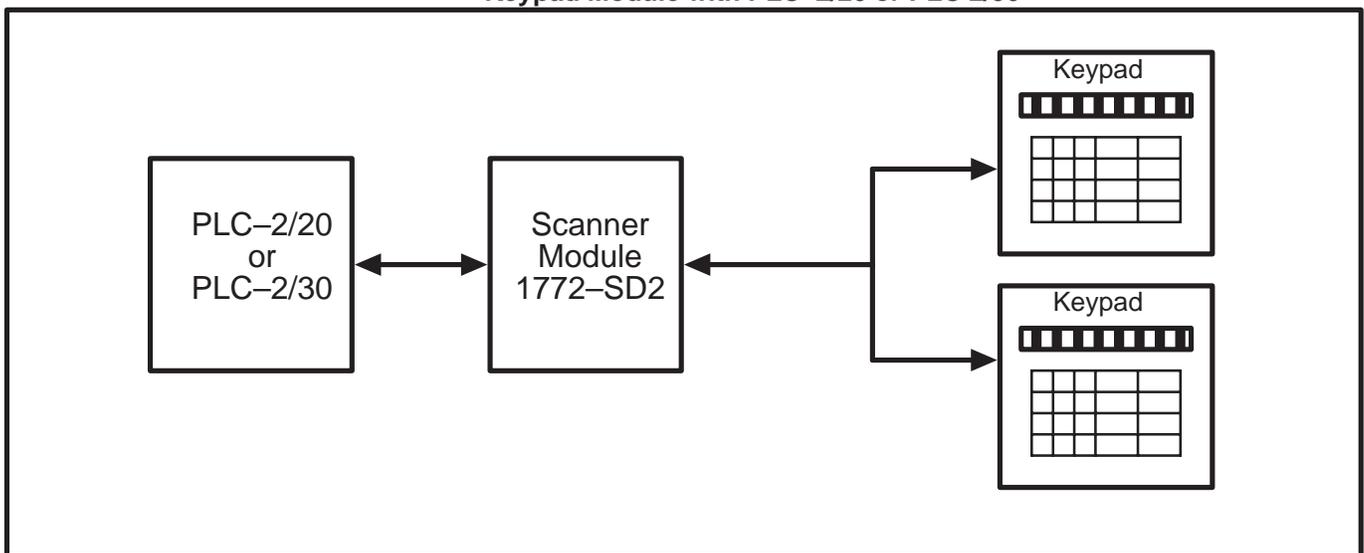


*Remote I/O Architecture (continued)*

**Figure 4.3**  
**Keypad Module with PLC-3**

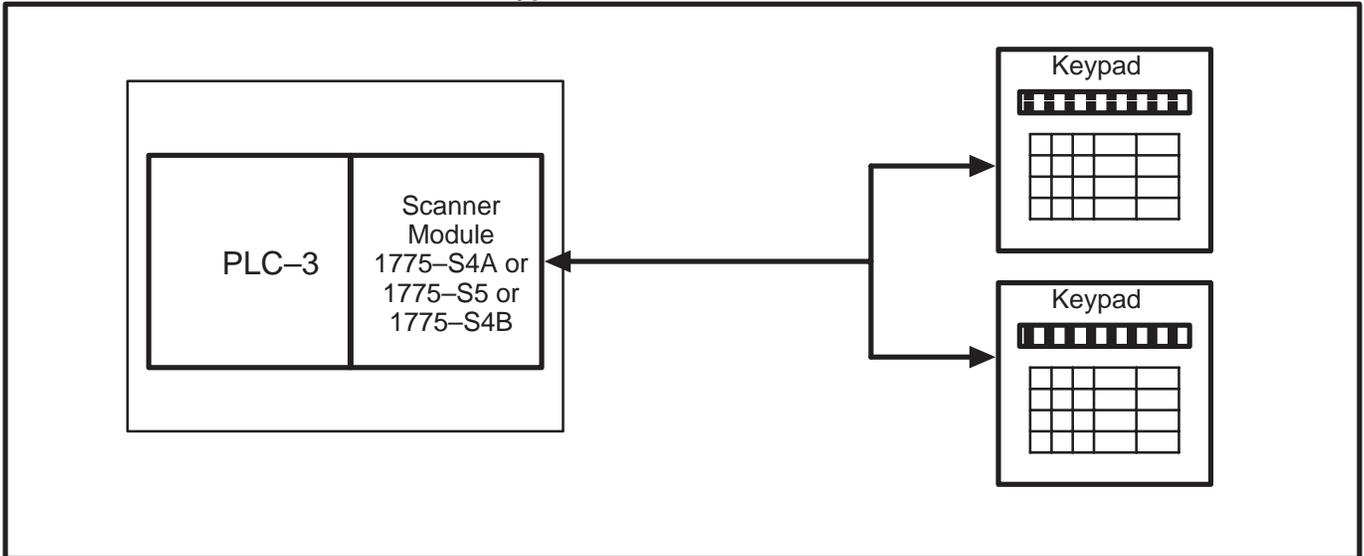


**Figure 4.4**  
**Keypad Module with PLC-3/10**

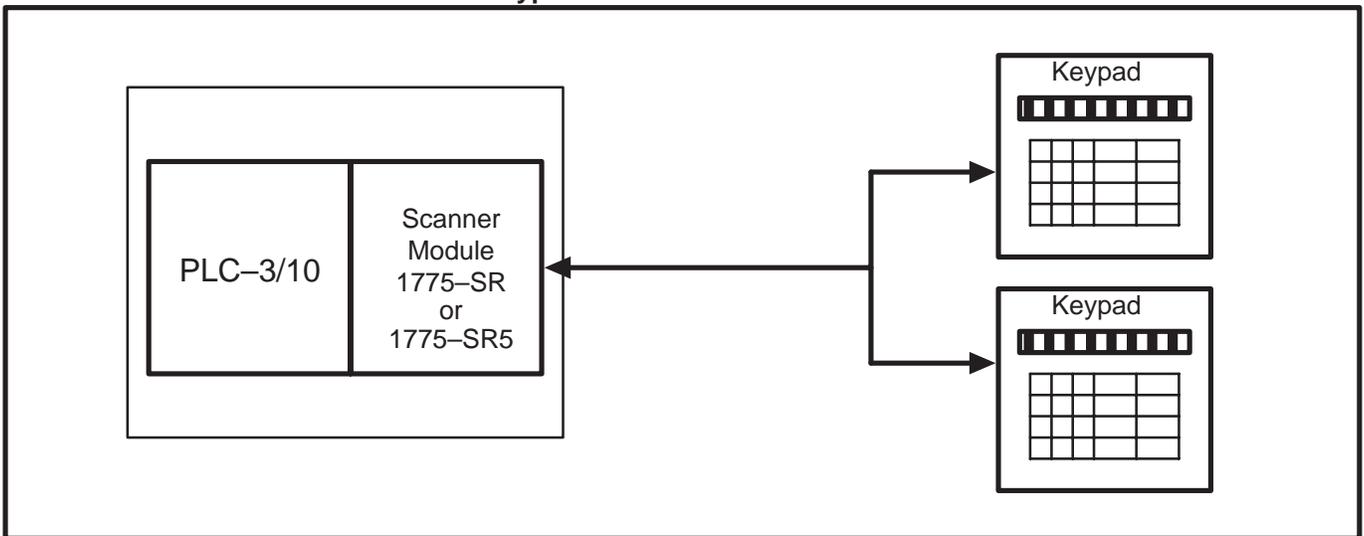


**Chapter 4**

**Configuring the Bulletin 2705 Keypad Modules with PLC Controllers**


**Figure 4.5**  
**Keypad Module with PLC-5/15, 5/25**

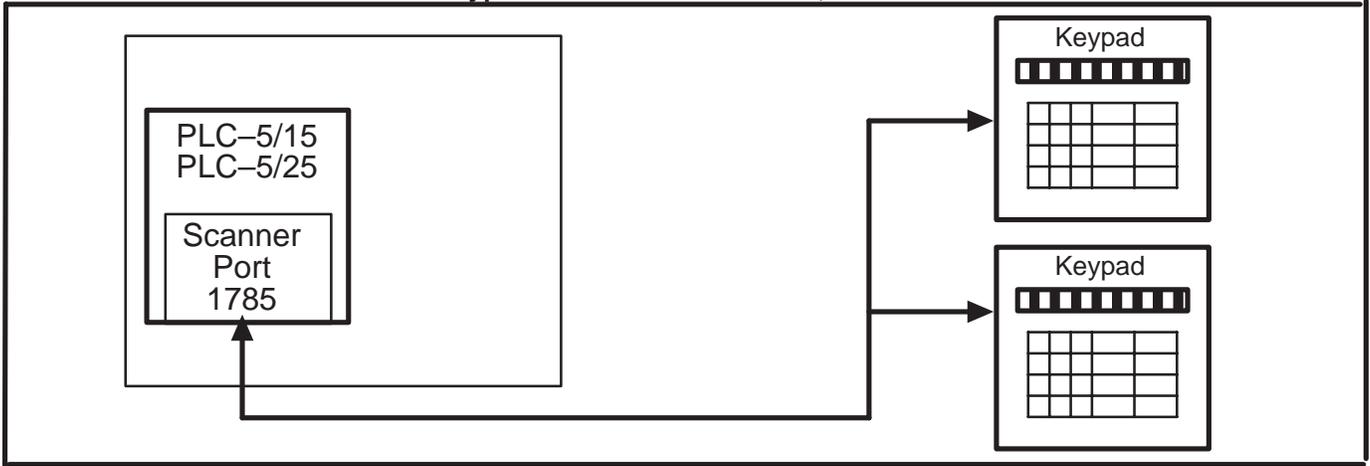

**Figure 4.6**  
**Keypad Module with any PLC-5 and Sub-Scanner**

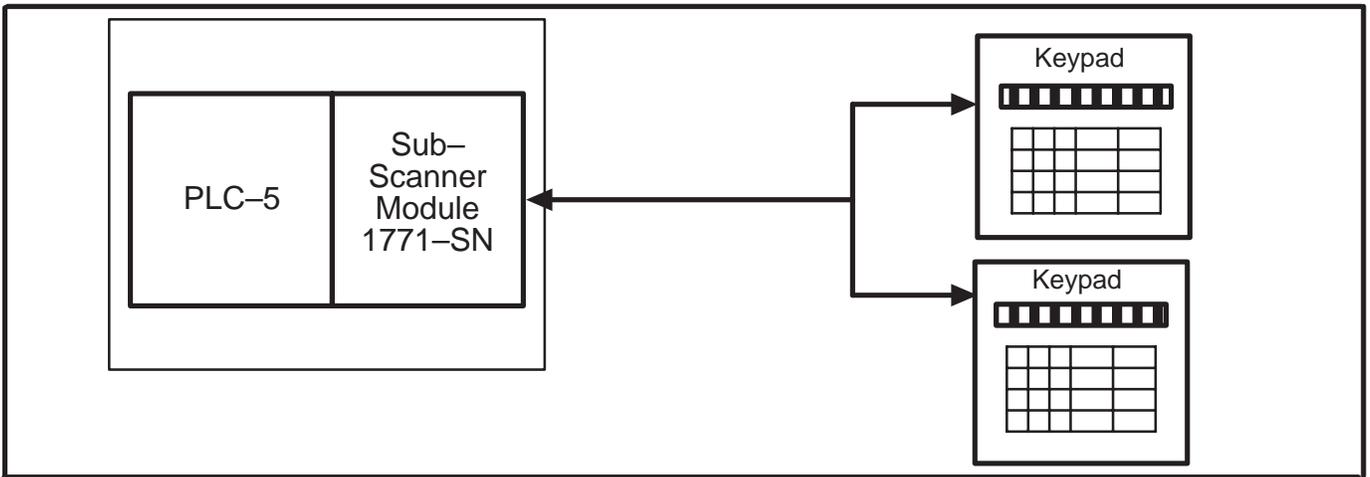

**Figure 4.7**  
Keypad Module with SLC-5/02

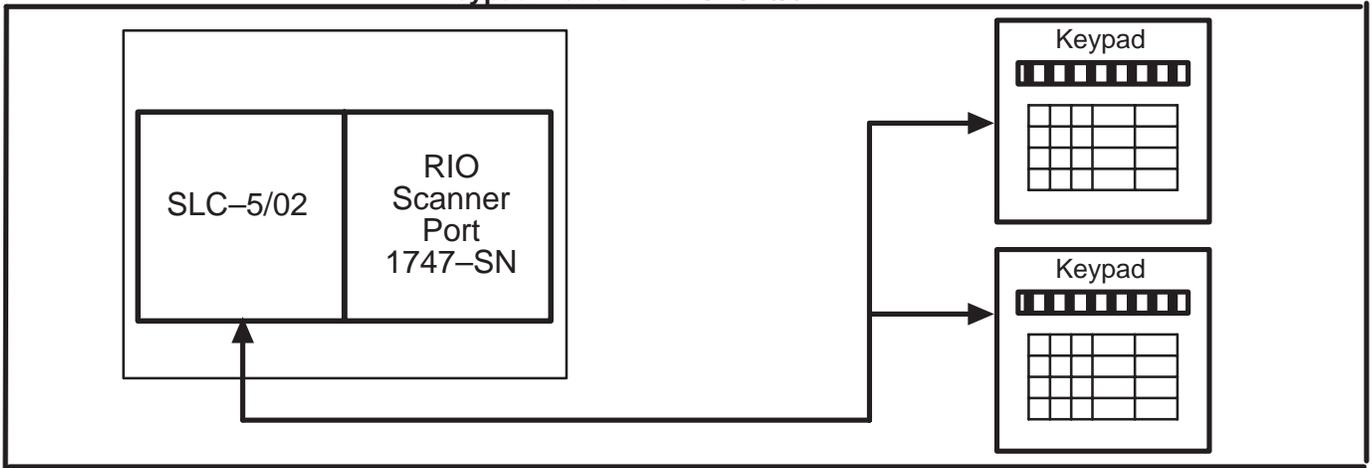

## Compatible PLC Controllers and Scanners

The Bulletin 2705 Keypad Module is compatible with all Allen-Bradley scanners that support remote I/O. Tables 4.A, 4.B and 4.C on this and the following page list applicable PLC's and scanners.

The 1771-SN sub I/O scanner module allows a local PLC-2 or PLC-5 family processor to communicate with one to seven remote I/O racks.

**Table 4.A**  
Applicable Programmable Controllers

| Catalog Number | Description | Related Pub. No. |
|----------------|-------------|------------------|
| 1772-LP1       | PLC-2/20    | 1772-6.8.1       |
| 1772-LP2       | PLC-2/20    | 1772-6.8.1       |
| 1772-LP3       | PLC-2/30    | 1772-6.8.3       |
| 1775-L1, L2    | PLC-3       | 1775-6.4.1       |
| 1775-LP4, LP8  | PLC-3/10    | 1775-2.20-DUI    |
| 1785-LT        | PLC-5/15    | 1785-6.8.2       |
| 1785-LT2       | PLC-5/25    | 1785-6.8.2       |
| 5250-LP1,-LP2  | PLC-5/250   | 5000-2.17        |
| 1785-L40       | PLC-5/40    | 1785-2.1         |
| 1785-L60       | PLC-5/60    | 1785-2.1         |
| 1747-L524      | SLC-5/02    | 1747-804         |

**Table 4.B**  
**Applicable Programmable Controllers Requiring 1771-SN Sub-scanner\***

| Catalog Number | Description   | Related Pub. No. |
|----------------|---------------|------------------|
| 1772-LS, LSP   | Mini-PLC-2/05 | 1772-6.8.6       |
| 1772-LV        | Mini-PLC-2/15 | 1772-6.8.2       |
| 1772-LX, LXP   | Mini-PLC-2/16 | 1772-2.26        |
| 1772-LW, LWP   | Mini-PLC-2/17 | 1772-2.25        |
| 1772-LN        | Mini-PLC-2    | 1772-6.8.4       |
| 1785-LT3       | PLC-5/12      | 1785-6.8.2       |

\* The 1771-SN sub I/O scanner can be used with any PLC-2 or PLC-5 family processor.

**Table 4.BA**  
**Applicable Programmable Controllers Requiring 1747-SN Sub-scanner**

| Catalog Number | Description | Related Pub. No. |
|----------------|-------------|------------------|
| 1747-SN        | SLC-5/02    | 1747-NM005       |

**Table 4.C**  
**Applicable Scanners**

| Catalog Number                  | Description   | Related Pub. No.                       |
|---------------------------------|---|--|
| 1772-SD, SD2*                   | Remote scanner/distribution panel for PLC-2 family.           | 1772-2.18                              |
| 1771-SN                         | Sub I/O scanner module for PLC-2 and PLC-5 families.          | 1771-2.91                              |
| 1775-SR, SR5                    | I/O Scanner Communication Adapter Module for PLC-3/10 family. | 1775-6.5.5                             |
| 1775-S4A<br>1775-S4B<br>1775-S5 | I/O scanner-programmer interface module for PLC-3 family.     | 1775-6.5.2<br>1775-6.5.3<br>1775-6.5.5 |
| 1785                            | I/O scanner-message handling module for PLC-5 /15 & 5/25      | 1785-6.6.1<br>1785-6.8.1               |
| 5250-RS                         | Remote scanner for PLC-5/250                                  | 5000-2.17                              |
| 6008-SI                         | IBM PC I/O Scanner Module                                     | 6008-6.5.3                             |
| 6008-SV                         | VME Bus I/O Scanner Module                                    | 6008-6.5.2                             |
| 1747-SN                         | Remote I/O Scanner  | 1747-NM005                             |

\* Scanner 1772-SD2 Revision 3 or later.

## Calculating Rack Size

The 2705 Keypad Module can be configured for any of four rack sizes:  $\frac{1}{4}$ ,  $\frac{1}{2}$ ,  $\frac{3}{4}$ , and a full rack. Rack sizes relate to the amount of I/O accessible to each rack: 32 I/O bits or points for  $\frac{1}{4}$  rack, 64 for  $\frac{1}{2}$  rack, 96 for  $\frac{3}{4}$  rack and 128 for a full rack. You set DIP switches for the rack size you want in your system design. See Chapter 5 on DIP switch settings.

**IMPORTANT NOTE:** For stored messages, you must configure for  $\frac{1}{2}$  rack or larger. You cannot use stored messages with  $\frac{1}{4}$  rack.

**Note:** Stored message display requires  $\frac{3}{4}$  rack to use the BCD mode. BCD mode can only be configured for  $\frac{1}{4}$  or  $\frac{1}{2}$  rack if message storage is disabled.

Table 4.D shows the functional characteristics of the Keypad Module configured in the available rack sizes:

**Table 4.D**  
**2705 Keypad Module Functions by Rack Size**

| Rack Size          | Stored Message Capability | BCD Mode             |                                     | Binary or Integer Mode (8 Digits)   | Number of Destination Bits |
|--------------------|---------------------------|----------------------|-------------------------------------|-------------------------------------|----------------------------|
|                    |                           | Number of BCD Digits | Number of ASCII Characters from PLC | Number of ASCII Characters from PLC |                            |
| $\frac{1}{4}$ Rack | No                        | 6                    | 0                                   | 0                                   | 0                          |
| $\frac{1}{2}$ Rack | BCD=N<br>Other=Yes        | 8                    | 2                                   | 4                                   | 16                         |
| $\frac{3}{4}$ Rack | Yes                       | 8                    | 8                                   | 8                                   | BCD=32<br>Others=48        |
| Full Rack          | Yes                       | 8                    | 10                                  | 12                                  | BCD=64<br>Others=80        |

## Remote I/O Configuration

Once you have selected the appropriate scanner for the PLC controller, Table 4.E below lists how many separate chassis the scanner can support and how much I/O it can address.

For any given application, the total of all the I/O used by each device (I/O rack, drive system, or RediPANEL Module) connected to the cable gives the amount of full racks of I/O being supported by the scanner or sub-scanner for that application.

For SLC-5/02 applications using the 1747-SN Remote I/O Scanner, refer to Publication 1747-NM005.

| PLC Processors                             | Physical  | Logical   | Physical        | Logical |
|--|---|---|-----------------|---------|
| Mini-PLC's<br>2/05<br>2/15<br>2/16<br>2/17 | —   | —   | 16 Devices<br>① | 7 Racks |
| PLC-5/12                                   | —   | —   | 16 Devices<br>① | 7 Racks |
| PLC-5/15<br>②                              | 12 Devices  | 3 Racks   | 16 Devices<br>① | 7 Racks |
| PLC-5/25<br>③                              | 16 Devices  | 7 Racks   | 16 Devices<br>① | 7 Racks |
| PLC-5/250                                  | 32 Devices/<br>Scanner; 4<br>Scanners/<br>Processor | 8<br>Racks/Scanner;<br>4 Scanners/<br>Processor | 16 Devices<br>① | 7 Racks |
| PLC-2/30                                   | 16 Devices<br>/ channel<br>2 Channels/<br>scanner   | 7 Racks total                                   | 16 Devices<br>① | 7 Racks |
| PLC-3                                      | 16 Devices/<br>channel<br>4 Channels/<br>scanner    | 32 Racks<br>(64 using<br>complimentary<br>I/O)  | 16 Devices<br>① | 7 Racks |
| PLC-3/10                                   | 16 Devices/<br>channel<br>4 Channels/<br>scanner    | 16 Racks total                                  | 16 Devices<br>① | 7 Racks |

① Two of these may be Bulletin 1771 chassis.

② PLC-5/15 Series B Revision H or later have partial rack addressing. Earlier versions were limited to (3) full rack devices.

③ PLC-5/25 Series A Revision D or later have partial rack addressing. Earlier versions were limited to (7) full rack devices.

## Selecting Options


### Chapter Objectives

This chapter describes DIP switch location and functions on the Bulletin 2705 RediPANEL Keypad Module. It also lists the switch bank settings for selecting function and configuration options.

### DIP Switches

See Figure 5.1 to identify the Keypad Module switch banks.

**Figure 5.1**  
**Switch Bank Location and Functions on Bulletin 2705 Keypad Module**

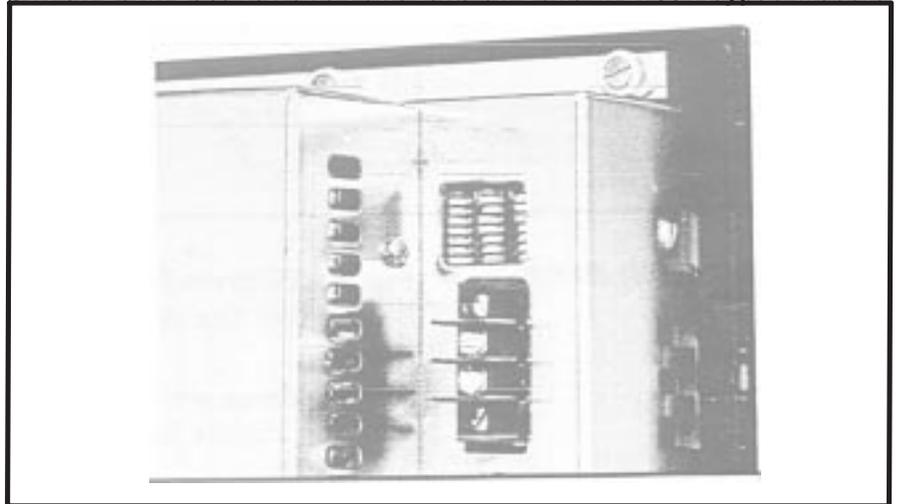

Switch bank #1 (SW-1) sets the rack address.

Switch bank #2 (SW-2) controls format and communication parameters: baud rate, data format, and the modes for Destination Bits, Last Rack, Keyswitch, Handshake and Last State.


Switch bank #3 (SW-3) establishes rack size and the modes for Stored Message Display, Split Display and Keyboard type.

**IMPORTANT NOTE:** Remove power from the module before setting DIP switches. Switch settings are scanned only on power-up.

## Typical Switch Settings

The following figures show examples of DIP switch settings. Figure 5.2 illustrates the “ON” and “OFF” positions of the DIP switches.

**Figure 5.2**  
Setting DIP Switches

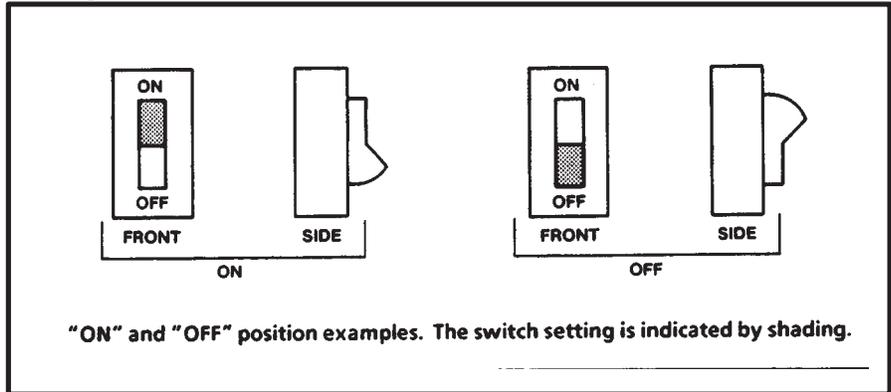

## Setting Switch Bank #1

Figure 5.3 gives functions and settings for Switch Bank #1. Notice that the rack address settings apply only to PLC–2 or any other PLC using a 1771–SN Sub I/O Scanner Module.

Rack address settings for PLC–3, PLC–5/15 and PLC–5/25 are listed in Figure 5.4 on the following page.

**Figure 5.3**  
Setting Switch Bank #1 for PLC–2 or any other PLC using a 1771–SN

**SW–1**

|     |    |                        |
|-----|----|------------------------|
| OFF | ON |                        |
| □   | □  | 1 Rack address, MSB    |
| □   | □  | 2 Rack address         |
| □   | □  | 3 Rack address         |
| □   | □  | 4 Rack address         |
| □   | □  | 5 Rack address         |
| □   | □  | 6 Rack address, LSB    |
| □   | □  | 7 First I/O group, MSB |
| □   | □  | 8 First I/O group, LSB |

**Specifying Rack Address for PLC–2 family or any other PLC using a 1771–SN sub I/O Scanner Module**

| I/O Rack Address | Switch Settings |    |    |     |     |     |
|------------------|-----------------|----|----|-----|-----|-----|
|                  | 1               | 2  | 3  | 4   | 5   | 6   |
| 1                | on              | on | on | on  | on  | on  |
| 2                | on              | on | on | on  | on  | off |
| 3                | on              | on | on | on  | off | on  |
| 4                | on              | on | on | on  | off | off |
| 5                | on              | on | on | off | on  | on  |
| 6                | on              | on | on | off | on  | off |
| 7                | on              | on | on | off | off | on  |

**SW–1**

|     |    |   |
|-----|----|---|
| OFF | ON |   |
| □   | □  | 1 |
| □   | □  | 2 |
| □   | □  | 3 |
| □   | □  | 4 |
| □   | □  | 5 |
| □   | □  | 6 |
| □   | □  | 7 |
| □   | □  | 8 |

**Example**

PLC–2  
I/O rack number 5

First I/O group 6

**Specifying First I/O Group**

| First I/O Group | Switch Settings |     |
|-----------------|-----------------|-----|
|                 | 7               | 8   |
| 0               | on              | on  |
| 2               | on              | off |
| 4               | off             | on  |
| 6               | off             | off |

Figure 5.4 lists the rack address settings on Switch Bank #1 for PLC-3, PLC-5/15, PLC-5/25 and SLC-5/02 controllers.

Figure 5.4 Setting Switch Bank #1 for PLC-3, PLC-5/15, PLC-5/25 and SLC-5/02.

| Specifying Rack Address for PLC-3 or PLC-5 |                 |     |     |     |     |     |
|--|-----------------|-----|-----|-----|-----|-----|
| I/O Rack Address                           | Switch Settings |     |     |     |     |     |
|  | 1               | 2   | 3   | 4   | 5   | 6   |
| 00*  | on              | on  | on  | on  | on  | on  |
| 01   | on              | on  | on  | on  | on  | off |
| 02   | on              | on  | on  | on  | off | on  |
| 03   | on              | on  | on  | on  | off | off |
| 04   | on              | on  | on  | off | on  | on  |
| 05   | on              | on  | on  | off | on  | off |
| 06   | on              | on  | on  | off | off | on  |
| 07   | on              | on  | on  | off | off | off |
| 10   | on              | on  | off | on  | on  | on  |
| 11   | on              | on  | off | on  | on  | off |
| 12   | on              | on  | off | on  | off | on  |
| 13   | on              | on  | off | on  | off | off |
| 14   | on              | on  | off | off | on  | on  |
| 15   | on              | on  | off | off | on  | off |
| 16   | on              | on  | off | off | off | on  |
| 17   | on              | on  | off | off | off | off |
| 20   | on              | off | on  | on  | on  | on  |
| 21   | on              | off | on  | on  | on  | off |
| 22   | on              | off | on  | on  | off | on  |
| 23   | on              | off | on  | on  | off | off |
| 24   | on              | off | on  | off | on  | on  |
| 25   | on              | off | on  | off | on  | off |
| 26   | on              | off | on  | off | off | on  |
| 27   | on              | off | on  | off | off | off |
| 30   | on              | off | off | on  | on  | on  |
| 31   | on              | off | off | on  | on  | off |
| 32   | on              | off | off | on  | off | on  |
| 33   | on              | off | off | on  | off | off |
| 34   | on              | off | off | off | on  | on  |
| 35   | on              | off | off | off | on  | off |
| 36   | on              | off | off | off | off | on  |
| 37   | on              | off | off | off | off | off |
| 40   | off             | on  | on  | on  | on  | on  |
| 41   | off             | on  | on  | on  | on  | off |
| 42   | off             | on  | on  | on  | off | on  |
| 43   | off             | on  | on  | on  | off | off |
| 44   | off             | on  | on  | off | on  | on  |
| 45   | off             | on  | on  | off | on  | off |
| 46   | off             | on  | on  | off | off | on  |
| 47   | off             | on  | on  | off | off | off |
| 50   | off             | on  | off | on  | on  | on  |
| 51   | off             | on  | off | on  | on  | off |
| 52   | off             | on  | off | on  | off | on  |
| 53   | off             | on  | off | on  | off | off |
| 54   | off             | on  | off | off | on  | on  |
| 55   | off             | on  | off | off | on  | off |
| 56   | off             | on  | off | off | off | on  |
| 57   | off             | on  | off | off | off | off |
| 60   | off             | off | on  | on  | on  | on  |
| 61   | off             | off | on  | on  | on  | off |
| 62   | off             | off | on  | on  | off | on  |
| 63   | off             | off | on  | on  | off | off |
| 64   | off             | off | on  | off | on  | on  |
| 65   | off             | off | on  | off | on  | off |
| 66   | off             | off | on  | off | off | on  |
| 67   | off             | off | on  | off | off | off |
| 70   | off             | off | off | on  | on  | on  |
| 71   | off             | off | off | on  | on  | off |
| 72   | off             | off | off | on  | off | on  |
| 73   | off             | off | off | on  | off | off |
| 74   | off             | off | off | off | on  | on  |
| 75   | off             | off | off | off | on  | off |
| 76   | off             | off | off | off | off | on  |


  

| Specifying First I/O Group |                 |     |
|----------------------------|-----------------|-----|
| First I/O Group            | Switch Settings |     |
|                            | 7               | 8   |
| 0                          | on              | on  |
| 2                          | off             | on  |
| 4                          | on              | off |
| 6                          | off             | off |

\*Rack 00 not valid with PLC-5s

Setting Switch Bank #2

Figure 5.5 gives the switch functions and settings for switch bank #2.  
**Setting Switch Bank #2**  
**Figure 5.5**  
**Setting Switch Bank #2**

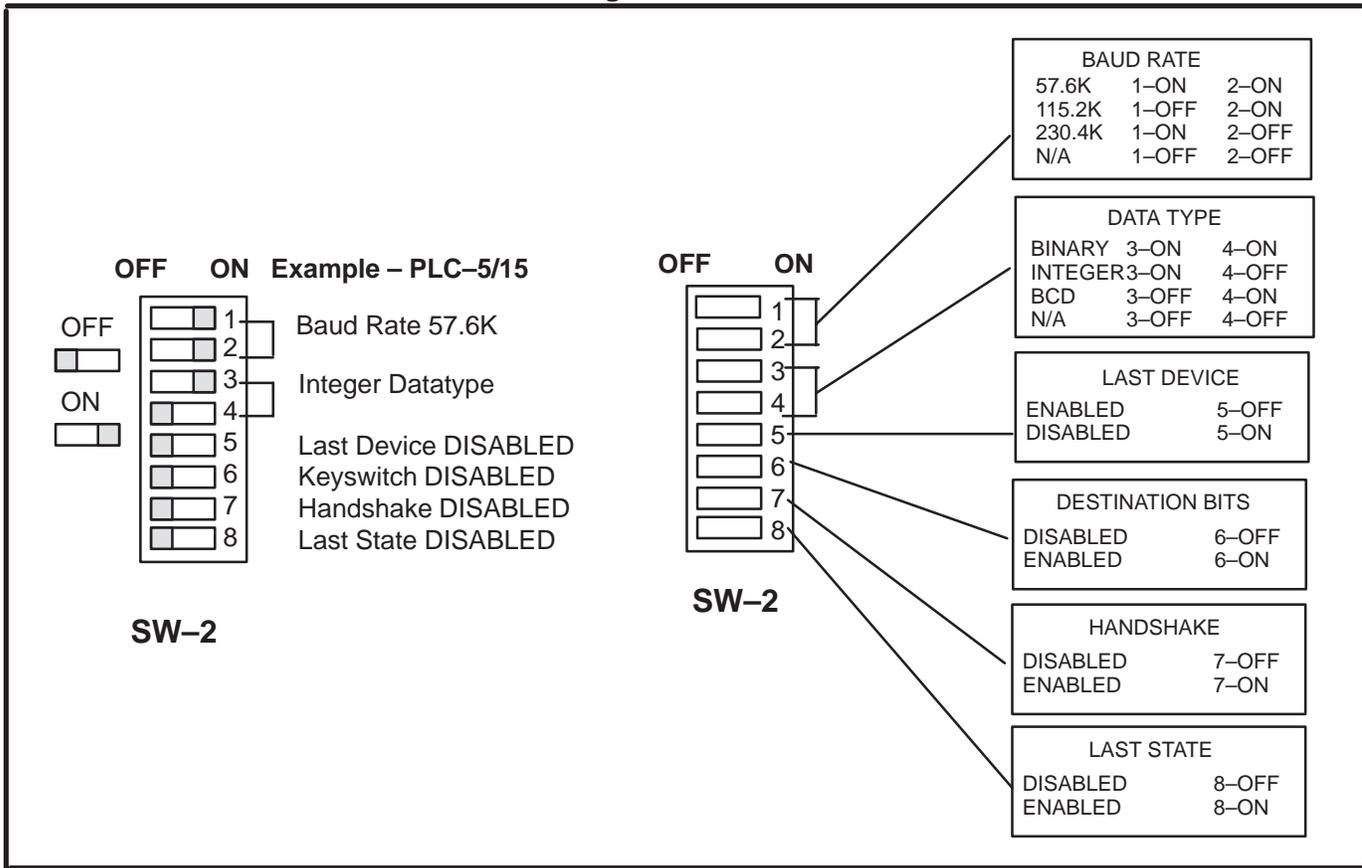

Set BAUD RATE to 57.6K for PLC-5/15 and 5/25 or the module will not communicate with the PLC.


Set LAST DEVICE to OFF position to tell the scanner module that the Keypad module is the last device of that logical rack, not necessarily the last device on the I/O link.

Enable HANDSHAKE to allow the use of the handshake bit which holds an input signal on until the PLC acknowledges data receipt. If you disable HANDSHAKE, the module uses a timed mode (100 millisecond delay) to make sure the PLC reads the input signal. Handshaking is explained in detail in Chapter 7.

Enable LAST STATE to lock the module up (hold the display in its last state) if communication with the PLC is lost. If you disable LAST STATE, the display will clear instead of locking up. When communication is reestablished, the module updates itself, and resumes operation.

### Setting Switch Bank #3

Figure 5.6 gives the switch functions and settings for Switch Bank #3. These switch bank #3 settings are for all PLC's.

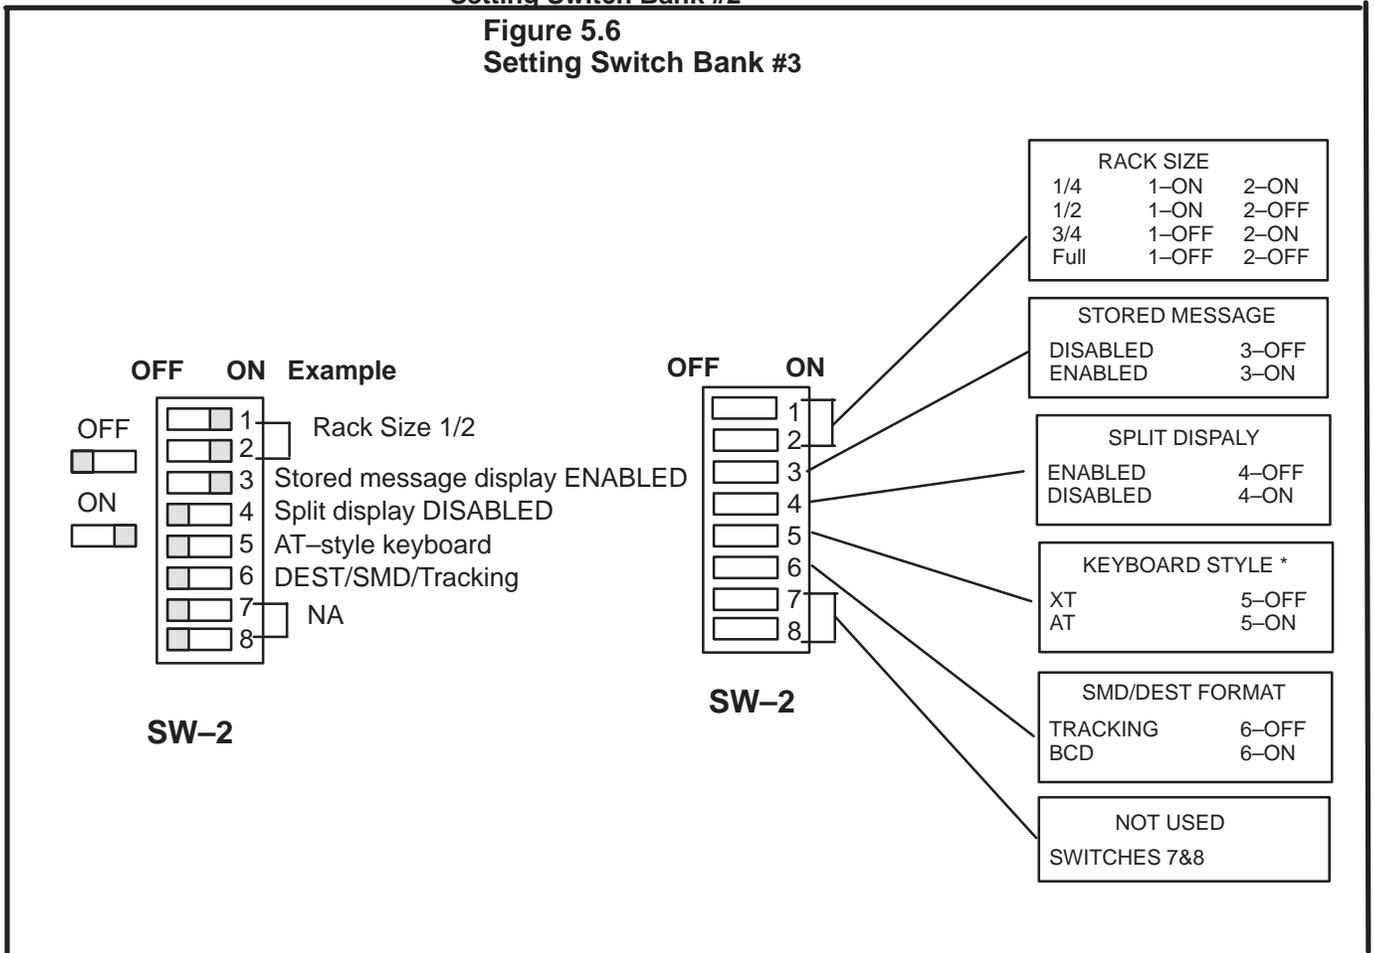

Enable STORED MESSAGE to be able to store and retrieve messages on the EEPROM inside the keypad module. If STORED MESSAGE is disabled, messages can only be retrieved from PLC memory.

Enable SPLIT DISPLAY to control what is displayed during operator entry. Refer to page 6-4 for more information.

The DEST. and SMD FORMAT controls the numeric format for the destination word in the input image table and the SMD word in the output image table.

When BCD is selected the SMD and destination numbers are in BCD format. When TRACKING is selected these values will follow the data type set by DIP switches 3 and 4 on switch bank #2.

**Note:** On Series B Revision D or earlier modules, DIP switch 6 on switch bank #3 is not used and the format is always BCD.

## Operating Modes

### Chapter Objectives

This chapter describes the operating modes of the Bulletin 2705 RediPANEL Keypad Module. Topics include:


- PLC output display of numeric and ASCII data and 16-character messages
- Data entry, decimal modes, split display data entry
- Message entering, storing and editing
- Destination entry

### Keypad Output Display

The Keypad Module's vacuum fluorescent display shows 16 alphanumeric characters. Figure 6.1 shows the features of the display.

**Figure 6.1**

**Keypad Module Display**

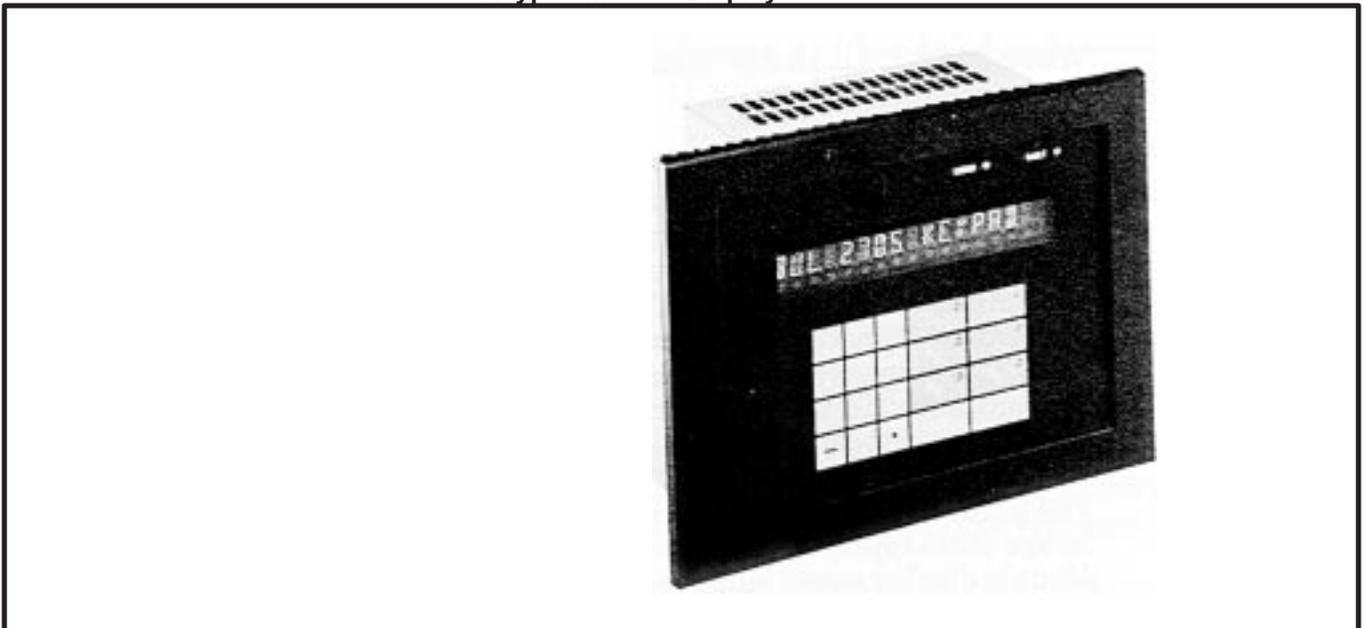

### ***Numeric Data***

Numeric data appears on the right-hand side of the display in the eight right-most character positions. These positions display eight digits (seven for negative numbers). The decimal point, if used, does not require an additional character position.

### ***ASCII Data***

Text starts on the left-most element. Text is displayed left to right.

### ***Display Stored Message***

A maximum of 16 ASCII characters can be displayed when using a stored message. What is shown on the display is controlled by the DM bit in the Output Image table.

When DM=0, only the first eight ASCII characters show up on the left hand side of the display and the right-most positions of the display show the numeric data.

When DM=1, all 16 ASCII characters are displayed and no numeric data is displayed.

### ***ASCII Message Display***


The ASCII message is stored in the PLC and moved to the Output Image table of the Keypad Module to display the message. Each word defined in the Output Image table, as alphanumeric characters, can hold a numbered code for two characters. The PLC program can also be used to send up to 12 ASCII characters to the display. **Note** – Refer to the Appendix for the alphanumeric sub-set that the Keypad Module can support.

The first word of alphanumeric characters in the Output Image table represents position one and two of the Keypad Module display when looking left to right. The rest of the Output Image table words assigned to the alphanumeric characters follow the same pattern, Word 2 = positions 3 and 4, etc. When the DM = 1, more than eight ASCII characters can be displayed on the Keypad Module. See chapter 7 for an example of an I/O Image table.

## Data Entry

The Keypad Module offers a standard numeric keypad interface with a polarity (minus sign) key and a decimal point as shown in Figure 6.2. Additional features are DELETE and ENTER keys, and six programmable function keys with LED's.

**Figure 6.2**  
**Keypad Layout**

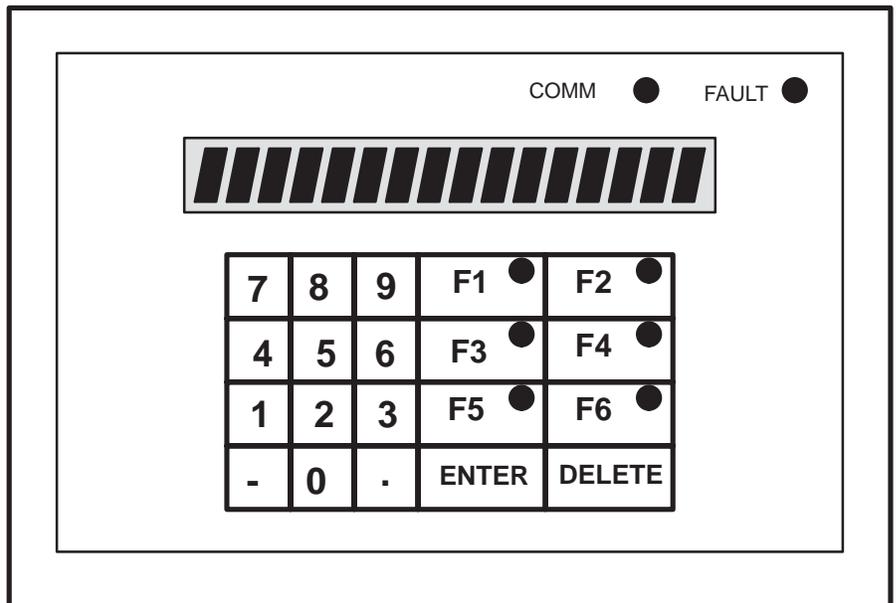

The Keypad Module accepts up to eight digits of data.

- Six digits for  $1/4$  rack BCD (0 to 999,999)
- Eight digits for  $1/2$  rack BCD (0 to 99,999,999)
- Five digits for binary (0 to 65,535)
- Five digits for integer (–32,767 to 32,767)

The module ignores any digits after the first eight. **Note** – For binary and integer the numeric value is checked for being in range before it is sent to the PLC.

The DELETE key clears one character at a time. Each deletion shifts previously entered characters one position to the right.

Each function key and its LED is individually programmable through bits in the PLC image tables.

To enter data you must first key in the desired numbers using the numeric keypad. The data will appear on the right hand side of the display as the numbers are being keyed. To complete data entry you must press the ENTER key. The entered data is placed directly into the data word(s) of the Input Image table. Any ASCII characters in the left hand side of the display remain there during data entry, unless the Split Display feature is enabled.

### ***Split Display***

This feature controls the display during operator entry. Split display must be enabled (DIP switch 4 on switch bank #3) and DM=0.

When the operator starts entering data, the data shown in the right half of display is placed in the left half. The operator can then enter new data in the right half.

### ***Decimal Modes***

The decimal point key allows you to input decimal numbers. You control the position of the decimal point, either fixed or floating, by setting bits in the output image table. See Chapter 7 for input and output image tables.

### ***Polarity***

The polarity key (minus sign) allows you to change the polarity of numbers. The minus sign uses one character position, limiting negative numbers to seven digits.

### ***Destination Entry***

The keypad module has an additional entry feature known as the destination function. This feature is selected by DIP switch 2 on switch bank #2. It is typically used to load data values into multiple locations, such as a series of timer/counter presets, loop setpoints, etc.

This function uses the destination word and destination bits in the Input Image table. The keypad operator enters a destination number that defines which timer, counter, or PLC memory location is to be accessed. The operator can then enter new data or monitor the present data in that timer, counter, or PLC memory location

**Figure 6.3**  
**Display for Destination Entry**



The keypad operator starts by pressing the ENTER key. The present destination is displayed between the >>—>> symbols as shown in Figure 6.3. The flashing >> symbol prompts the operator for a new destination number, followed by another ENTER keystroke. After the second ENTER, the new destination is mapped directly into the destination word.

When the destination number is entered, its corresponding destination bit will be ON and all other destination bits are OFF. If destination “5” is entered, then the 5th destination bit is on and all others off. The PLC program can utilize that “ON” bit to MOV, GET, or PUT data to/from the appropriate timer, counter, memory location, etc.

The DELETE key and Minus (–) key can be used during destination entry. Depress the DELETE key to delete one character at a time. Depress the MINUS (–) key to abort destination entry.

A programming example of the destination function is presented in Chapter 7, Page 7–9.

## Messages

The Keypad Module stores up to 120 (16–character) messages in EEPROM. Refer to Page 6–2 for ASCII Message information. You create, store and edit the messages with an external keyboard. A message is displayed when the program calls the storage identification number assigned to the message. Refer to Page 7–1 for more information.

There are two methods of entering messages:


- IBX–XT/AT style keyboard
- IBM PC or compatible with Keypad Programming Software (Catalog Number 2705–ND1). The user’s manual provided with the software describes how to enter messages using this method.

### **Keyboard**


You enter messages into the module with an IBM–XT/AT or compatible keyboard. The keyboard plugs into a round 5–pin DIN receptacle on back of the Keypad Module. Figure 6.4 shows the location of the receptacle and Figure 6.5 shows pin locations.

The Message Editor inside the module is accessed by the keyboard when any key is depressed. A prompt appears on the display to begin the editing process. The Message Editor contains commands to create, edit and save single line, 16-character alphanumeric messages. Each message is assigned a message number for reference by the PLC or for future editing.

**Figure 6.4**  
**Keyboard Plug Receptacle**

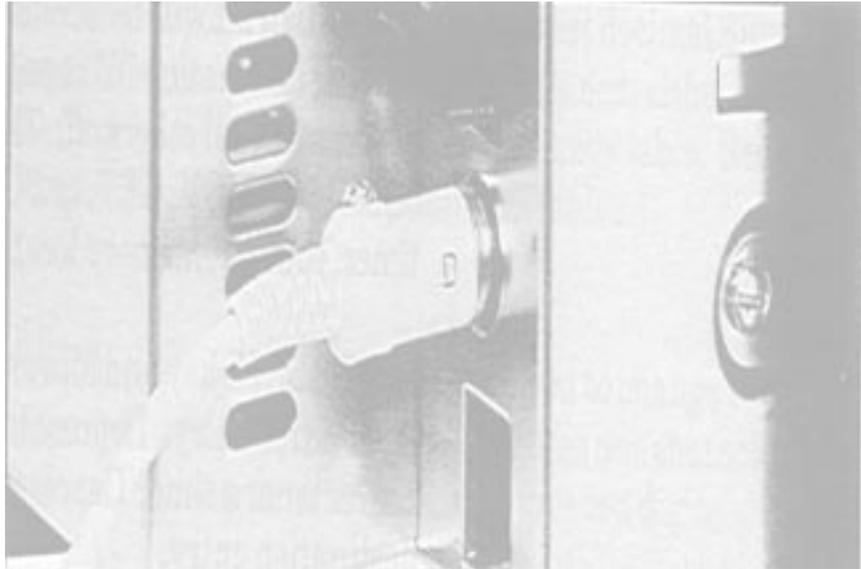

**Figure 6.5**  
**Keyboard Plug Receptacle Pin Locations**

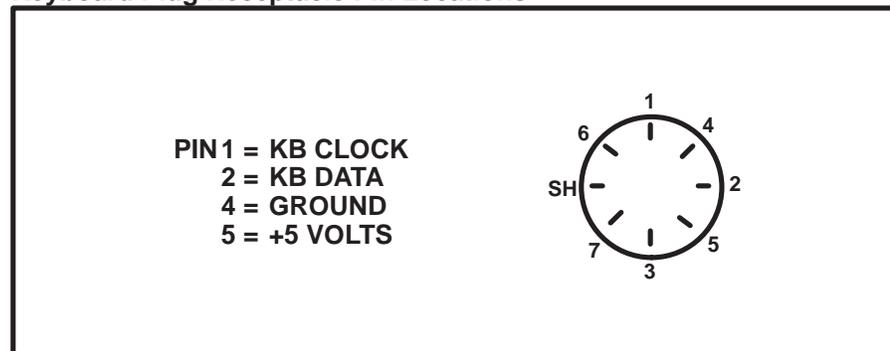

## Entering Messages

The procedure for entering messages into the module is interactive:

**Step 1** - Remove power before plugging keyboard into the module.

**Step 2** - Depress any key to enter the edit mode.

**Step 3** - The module asks you for a message number:

*EDIT MESSAGE 001*

**Step 4** - Type a message number (1 to 120) and depress ENTER or depress ENTER to edit message number displayed.

**Step 5** - If the number you entered has a message assigned to it, the module displays that message for you to edit.

If the number is unassigned, you get a blank display, with the cursor in the left-most position.

**Step 6** - Enter a message by typing the text you want - up to 16 characters. (See the following page for a list of editing commands.)

**Step 7** - Depress ENTER to complete the message and save it in EEPROM.

**Step 8** - The module adds one to the message number, then

**Step 9** - Depress Control-R any time to end the entry / edit session.

### ***Storing***

Messages go into EEPROM as you create them. When you depress ENTER to complete a message, the Module stores the message automatically. No special procedures are needed.

### ***Editing***

The message editing function is exactly the same as the message entry function.

When you have a message on the display, any characters you type will overwrite the characters on the display. Store the message, when you have it to your liking, by depressing ENTER.

## Editing Commands

The editing commands are single key strokes:

- Left arrow** (←) - Move cursor one position to the left.
- Right arrow** (→) - Move cursor one position to the right.
- Down arrow** (↓) - Decrement number of message to be created or edited.
- Up arrow** (↑) - Increment number of message to be created or edited.
- Control-B** - Set message FLASH attribute.
- Control-D** - Delete message and return to run mode.
- Control-F** - Display number of free messages.
- Control-R** - End edit and save current message, then go to RUN mode.
- Control-S** - Select message number.
- ENTER** - Save message being edited, and move on to the next message.
- ESC** - Cancel current edit and return to run mode.
- Control-E** - Correct "EEPROM CRC ERROR" and return to run mode.
- Control-I** - Initialize messages and return to run mode.

**Note** –Messages may also be entered/stored on floppy disk and downloaded using a IBM PC or compatible with the Keypad Programming Software (Catalog Number 2705–ND1). Refer to the Software User’s Manual (Catalog Number 2705–ND003) for additional information.

## Programming

### Chapter Objectives

This chapter describes the process of creating a program for the Bulletin 2705 RediPANEL Keypad module. The detailed listing of the program example explains the ladder logic programming.

### Introduction Of Programming with the Keypad Module

Applications for the Keypad Module are programmed in the Allen–Bradley PLC controller. The module itself has an on–board message editor that can create and store up to 120 single line messages. These messages are triggered from the program in the PLC.

All operations of the module - inputting data, displaying a PLC register value, displaying a message, and using the function keys - correspond to fixed bits and word locations in the Input and Output Image Table of the PLC controller. For example, depressing a Function Key sends a “1” to its corresponding bit in the Input Image Table. Depressing the ENTER key sends the number that the operator has entered through the numeric keypad to a fixed word location in the Input Image Table. To display a register’s contents you put that value into a word in the Output Image Table. To display a message that is stored in the module, you send its message number to a word in the Output Image Table.

The Input and Output Image Tables for the various combinations of Keypad Module features and rack size configurations are listed after the programming examples.

## PLC-5 Programming Examples

The PLC–5 programming examples given on the following pages are based on the system configuration listed below.

## System Configuration

**Note** – System configuration may vary for different applications.

1. A 1784–T45 Portable Terminal
2. A 1785–LT PLC–5/15 Processor (Ser. B Rev. H, Set for Scanner Mode)
3. A 1771–P4 Power Supply
4. A 1771–A1B 4 slot chassis
5. A 2705–K11C1 RediPANEL Keypad Module (Ser. B Rev. E)

The DIP switches on the Keypad Module have been set to:

- A. Rack 2, Module Group 0
- B. 57.6k Baud Rate
- C. Destination Bits - Enabled
- D. Integer Data Type
- E. Last Device
- F. Rack Size - 1/2
- G. Stored Message and Split Screen - Enabled
- H. Keyboard Style - “AT”
- I. Dest and SMD Format – Tracking

Prior to entering the sample program into the PLC–5, four messages were entered into the Keypad Module. The messages are as follows:

MSG.#001 = "C5.1 ACC.="

MSG.#002 = "C5.1 PRE.="

MSG.#003 = "16 CHARACTER MSG."

MSG.#004 = "T4:0 PRE ="

## Input and Output Image Tables

Figure 7.1 below shows the Input and Output Image Tables for the system configuration described on Page 2.

**Figure 7.1**  
**Integer Mode, 1/2 Rack with Stored Message Display**

| Input Image Table |    |    |    |    |    |    |    |    |   |           |   |   |   | INPUT | RACK # | MODULE GROUP (WORD) |    |    |   |
|-------------------|----|----|----|----|----|----|----|----|---|-----------|---|---|---|-------|--------|---------------------|----|----|---|
| Bits              | 17 | 16 | 15 | 14 | 13 | 12 | 11 | 10 | 7 | 6         | 5 | 4 | 3 |       |        |                     | 2  | 1  | 0 |
|                   | H  | EN | F6 | F5 | F4 | F3 | F2 | F1 | - | Dec. Pos. |   | - | - | -     | -      |                     | I: | 02 | 0 |
| Integer Data      |    |    |    |    |    |    |    |    |   |           |   |   |   |       |        |                     | I: | 02 | 1 |
| Destination       |    |    |    |    |    |    |    |    |   |           |   |   |   |       |        |                     | I: | 02 | 2 |
| Destination Bits  |    |    |    |    |    |    |    |    |   |           |   |   |   |       |        |                     | I: | 02 | 3 |

| Output Image Table                  |    |    |    |    |    |    |    |    |   |           |   |    |     | OUTPUT | RACK # | MODULE GROUP (WORD) |    |    |   |
|-------------------------------------|----|----|----|----|----|----|----|----|---|-----------|---|----|-----|--------|--------|---------------------|----|----|---|
| Bits                                | 17 | 16 | 15 | 14 | 13 | 12 | 11 | 10 | 7 | 6         | 5 | 4  | 3   |        |        |                     | 2  | 1  | 0 |
|                                     | H  | DM | L6 | L5 | L4 | L3 | L2 | L1 | - | Dec. Pos. |   | DC | SDP |        |        |                     | O: | 02 | 0 |
| Integer Data                        |    |    |    |    |    |    |    |    |   |           |   |    |     |        |        |                     | O: | 02 | 1 |
| Stored Message Display Number (SMD) |    |    |    |    |    |    |    |    |   |           |   |    |     |        |        |                     | O: | 02 | 2 |
| Two Alphanumeric Characters         |    |    |    |    |    |    |    |    |   |           |   |    |     |        |        |                     | O: | 02 | 3 |

**EXAMPLE** - The address for the function key "F1" in this example would be I:020/10.


The I/O image table shown in Figure 7.1, reflects the Integer data type that the Keypad Module has been configured for. Setting the DIP switches for Integer data type is particularly useful when using the Keypad Module with the PLC-5, because the PLC-5 timer and counter data is stored in an Integer format.

To display the Preset or Accumulated values of these instructions requires only a MOVE instruction. (See Displaying Numeric Data, example #1.) If the Keypad Module had been configured for a Binary or BCD data type, a conversion instruction would have been needed to convert the ACCUM value of the counter to that data type format prior to displaying it on the Keypad Module.

Note: The input image table will only momentarily indicate a state change if F1-F6 is pressed. This change of state may not be displayed in all instances.

## Displaying Numeric Data

Figure 7.2

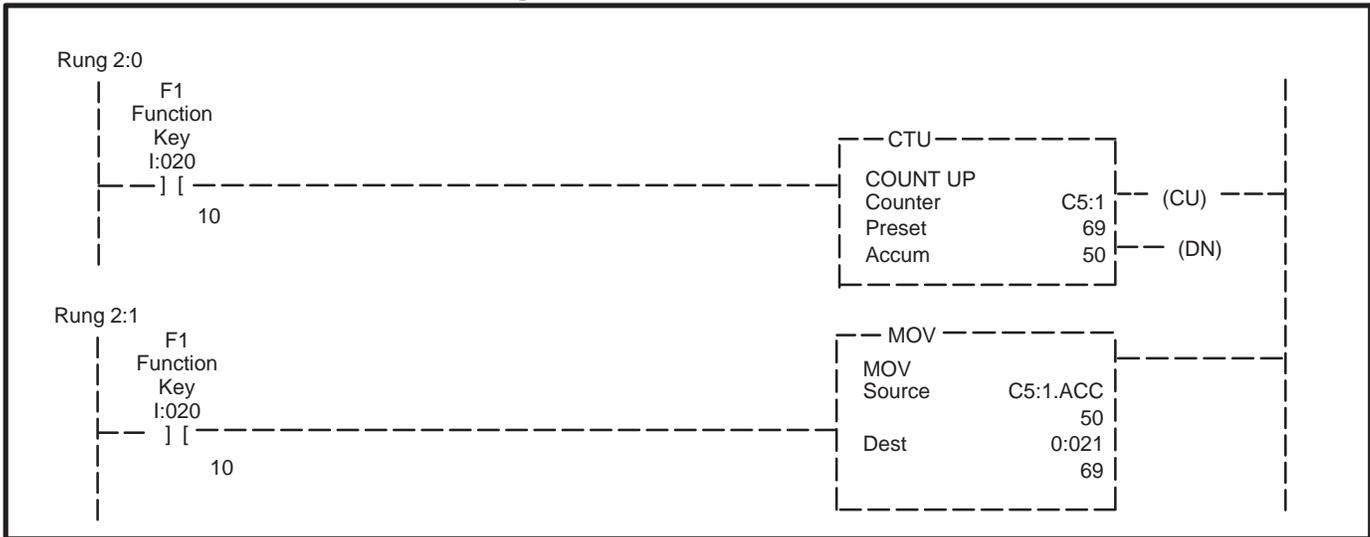

The program example in Figure 7.2 illustrates how the function key, F1, may be used just like a push button or other similar input type device. In this instance, F1 is used to increment the accumulative value of count up counter C5:1 and initiate a MOVE instruction. Each time the F1 function key is pressed, the accumulated value of the counter increases by one and the MOVE instruction moves the new value to the right hand side of the Keypad display.

The Destination address of the MOVE instruction is 0:021 which, for this configuration, is the word in the output image table where integer data is sent to the Keypad Module. (See Figure 7.1, Input and Output Image Tables.) Any integer number sent to this word address will be displayed on the Keypad Module display.

Move instructions aren't the only instructions that may be used to display data on a Keypad Module. Logical, Arithmetic and some File type instructions may also be used. Any method of moving data is acceptable.


## Triggering a Stored Message to Describe Data

The Keypad Module is not only capable of displaying numeric data, but also alphanumeric messages to describe that data. These messages may be stored in the programmable controller and sent to the Keypad Module via ASCII code, or store up to 120 messages in the Keypad Module and trigger them according to their message number. The later method is the most common means of displaying messages on the Keypad Module.

As described earlier in the System Configuration section, several messages have already been entered into the Keypad Module.

Figure 7.3 below shows Rung 2:2 has been added to the sample program. This will trigger a message in the Keypad Module.

**Figure 7.3**

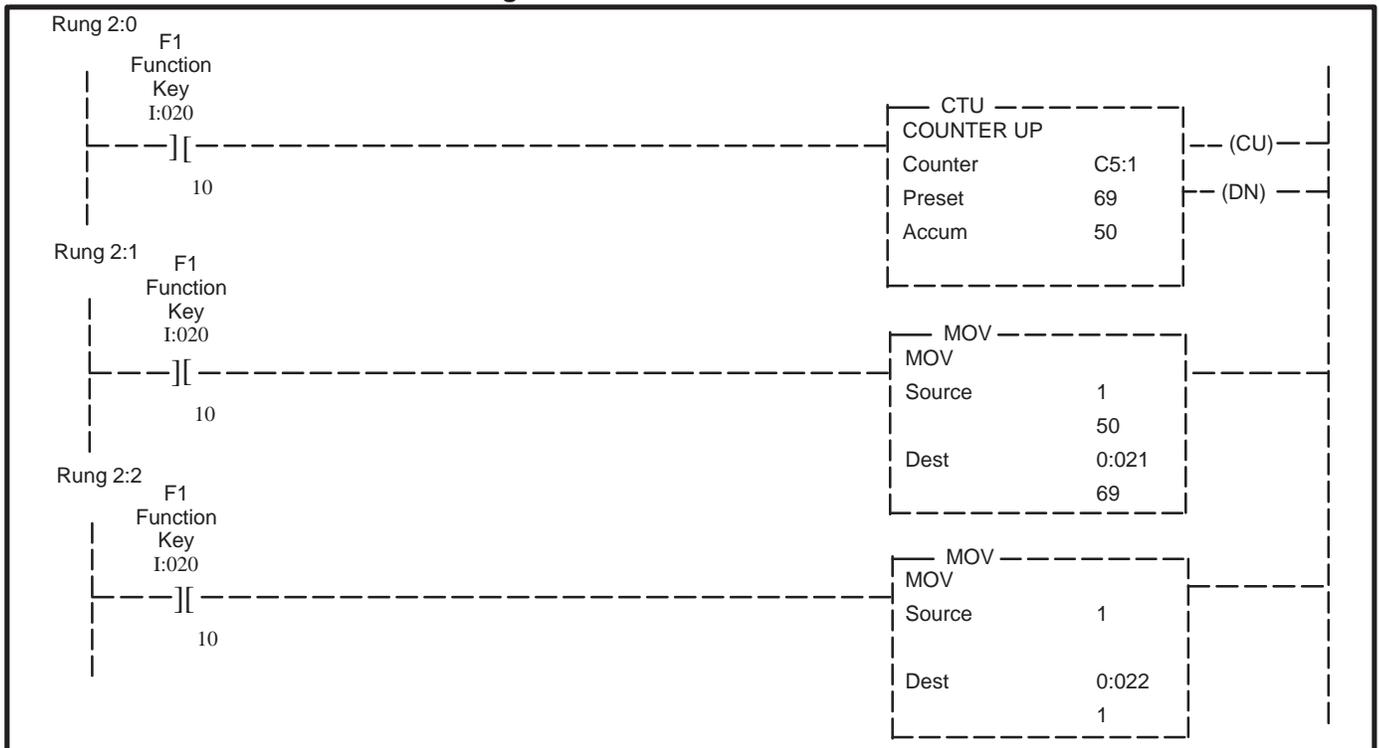

Rung 2:2 shows how the same input, F1, which is used to move the accumulated value of the counter to the Keypad display, can also trigger a stored message. The MOVE instruction in rung 2:2, moves the constant 1 to 0:022, the word in the output image table where the Stored Message Display (SMD) number is sent to the Keypad Module. (See Figure 7.1, Input and Output Image Tables.) In this case when F1 is pressed, message number 1 "C5.1 ACC.=" will appear on the left side of the display and C5:1 accumulated value will appear on the right.


In Series B Rev. D or earlier Keypad Modules, the SMD number must be a BCD number only, regardless of what data type the module has been set for.

### Displaying a Full Line Stored Message

In some instances the application requires a full line 16-character message, to prompt the operator, display machine status, warnings or fault messages. This is accomplished by turning on the DM bit in the output image table at the same time the message number is moved to the SMD word. The DM bit is the 16th bit of the starting module group word in the output image table. (See Figure 7.1, I/O Image Tables.)

Figure 7.4 below shows one example of how to trigger a 16-character message with PLC-5 ladder logic.

Figure 7.4

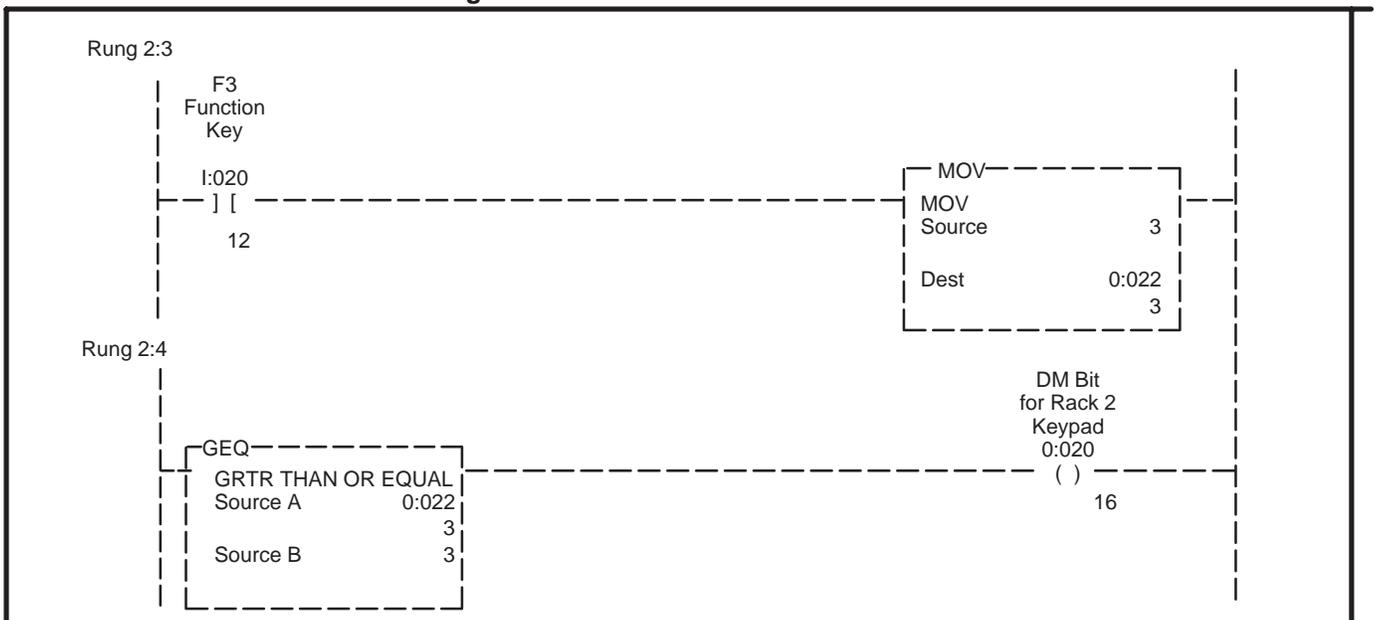

In Figure 7.4, function key F3 is used to initiate a MOVE instruction. The MOVE instruction, moves the constant 3 to the Keypad module's stored message word 0:022. This in turn triggers stored message number 3 "16 CHARACTER MSG."

The second rung in Figure 7.4, Rung 2:4 uses a Greater Than/Equal To instruction (GEQ) to control the DM bit. In this case, if the message number being displayed is 3 or more, the DM bit 16 is turned on to allow all 16 characters of the message to be displayed.


The GEQ or LEQ (Less Than/Equal To) instruction can be very useful in this application. For example, if your application requires (30) 16 character messages, use the stored message numbers between 90 and 120. Then you may use the GEQ instruction to turn on the DM bit anytime a stored message number of greater than or equal to 90 is moved to the Keypad. If you wish to use the LEQ instruction, you would enter those (30) messages using the first available stored message numbers of 1 through 30.

## Entering or Changing Data with the Keypad Module

To enter or change values in the PLC-5 with the keypad data must be moved from the Input Image table of the Keypad Module to the PLC-5.

Figure 7.5 below shows one example of the ladder logic required to change a PLC-5 counter preset value.

Figure 7.5

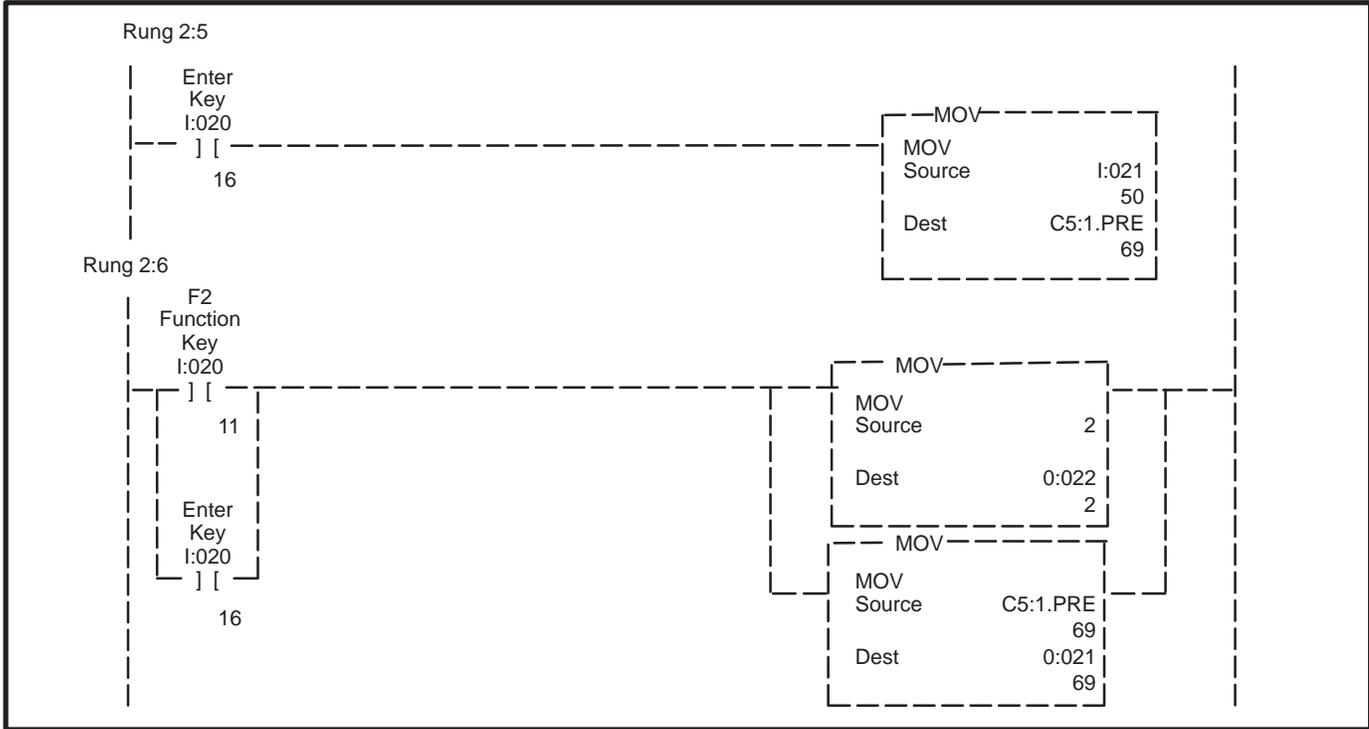


In the example shown in Figure 7.5, rung 2:5 is used to move the value from the input image table, I:021, to counter C5.1 preset, each time the Enter key is pressed.

Rung 2:6 in Figure 7.5 shows how the function key F2 or the Enter key are used to display stored message #2, "C5.1 PRE.=", on the left side of the keypad and the current or new preset value of counter C5.1 on the right. This rung is used strictly to allow the operator to view the value that is about to be changed. To actually change the preset, the new value must first be entered into the input image table. This is accomplished by first punching in the desired preset value using the numeric keys on the Keypad Module, then pressing the ENTER key. The new value is then placed in the input image table or in the case of this particular configuration, word I:021. Placing rung 2:5 before rung 2:6 ensures the new updated preset value will be displayed.

## Using the Destination Function to Load Multiple Timer Presets

The keypad destination function can be used to load data values into multiple timer/counter presets or other PLC memory locations. The example program listed below can be used to load preset values into 17 consecutive timer presets, beginning with T4:0.PRE and ending with T4:16.PRE. Rungs 3 through 16 have been omitted to simplify the example. The keypad is configured for 3/4 Rack, instead of 1/2 Rack as in the previous examples, otherwise all DIP switch settings remain the same. Refer to page 7–30 for an example of a 3/4 rack I/O Image table.

Rungs 1–17 provides a PLC 5/15 example program using the Destination Function.

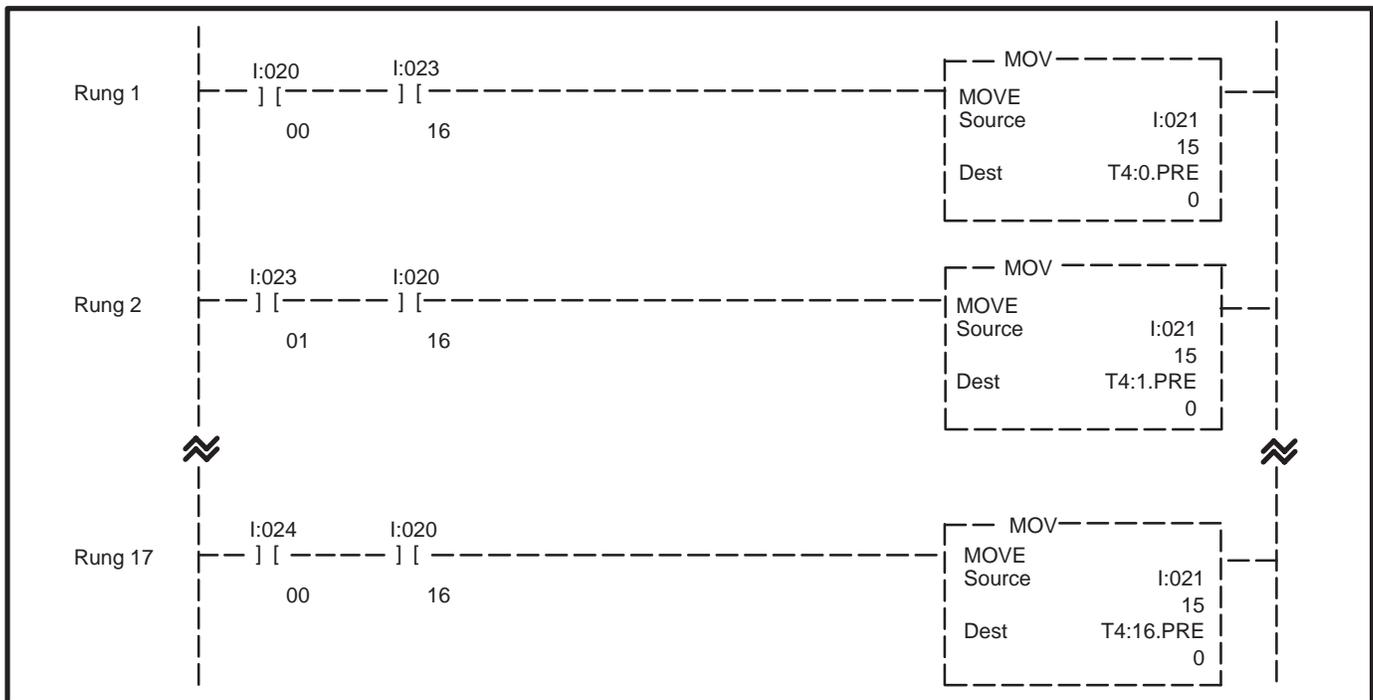

### Rung 1:

Destination bit I:023/00 is “ON” when the keypad operator enters destination number “1”. All other destination bits are “OFF”. The ENTER bit I:020/16 prevents data from being moved until the keypad operator enters a new preset for T4:0. The MOVE instruction takes the integer data in I:021 and transfers it to T4:0.PRE.

### Rung 2:

Destination bit I:023/01 is “ON” when the keypad operator enters destination number “2”. All other destination bits are “OFF”. The ENTER bit I:020/16 prevents data from being moved until the keypad operator enters a new preset for T4:1. The MOVE instruction takes the integer data in I:021 and transfers it to T4:1.PRE.


Rungs 3–16:

Would appear the same but with different timer/destination bit addresses.

Rung 17:

Destination bit I:024/00 is “ON” when the keypad operator enters destination number “17”. All other destination bits are “OFF”. The ENTER bit I:020/16 prevents data from being moved until the keypad operator enters a new preset for T4:16. The MOVE instruction takes the integer data in I:021 and transfers it to T4:16.PRE.

The PLC 5/15 example program could be expanded to display the timer preset along with an 8 character message that identifies each timer preset. The following rungs could be added for each timer.

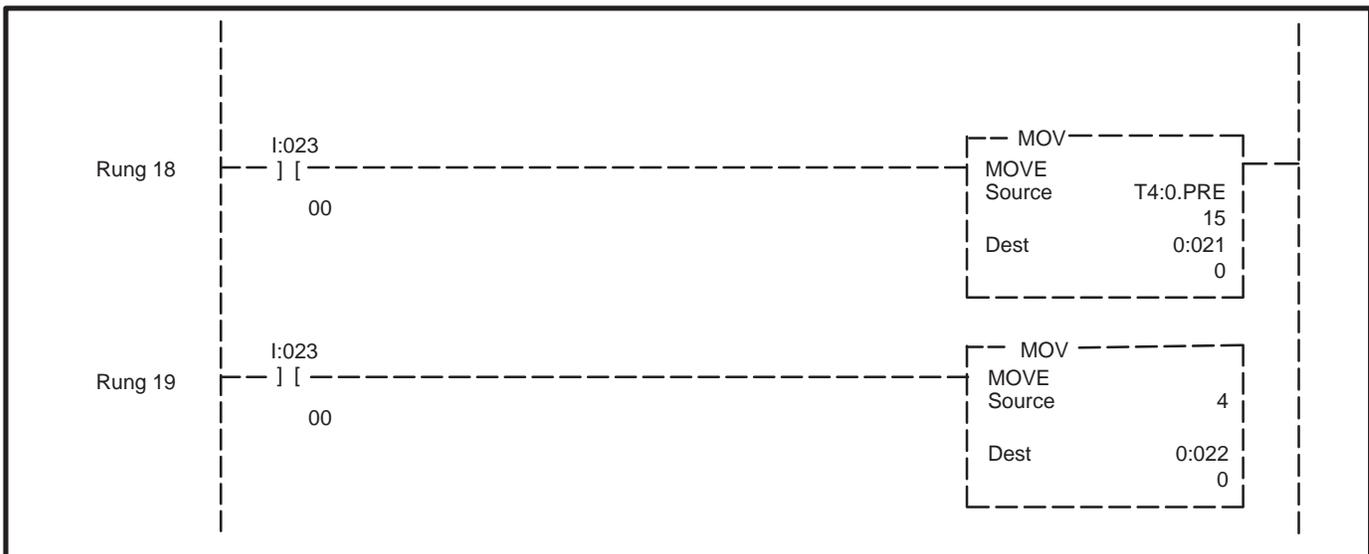

Rung 18:

When destination bit I:023/00 is “ON” the T4:0.PRE value is displayed on the right hand side of the keypad module.

Rung 19:

When destination bit I:023/00 is “ON” the constant “4” is moved to the SMD word, triggering message number 4. “T4:0.PRE=” will be displayed on the left hand side, identifying the data in the right hand side.

## Using PLC-5 Controllers and a Sub I/O Scanner with Keypad Modules

A 1771-SN, Sub I/O scanner may be used with a PLC-5 family processor when the application requires more remote devices than that processor can accommodate. The sub I/O scanner module may be used to communicate to as many as 16 additional remote I/O devices.


The 1771-SN Sub I/O scanner may be located in the same rack as the PLC-5 (the local rack), or in any space of the remote racks supported by the processor. The PLC-5 communicates to the sub I/O scanner using block transfer read and write instructions, this method is called Bidirectional Block Transfers.

The block transfer read instruction, reads input data from the sub I/O scanner and transfers that data to integer files in the PLC. The block transfer write instruction, writes output data to files of the PLC, then transfers that data to the sub I/O scanner. What this means is that instead of input addresses starting with “I:” and output addresses starting with “O:”, both input and output addresses will begin with “N7 or greater:”. The rest of the input addresses will depend on the specific integer file that is designated as the “DATA FILE” in the block transfer read instruction. The rest of the output addresses will depend on the specific integer file that is designated as the “DATA FILE” in the block transfer write instruction.

The Keypad Module must have Bank #1 DIP Switch settings set for PLC-2 even though a 1771-SN scanner is used with a PLC-5. Refer to Page 5-2 for additional information.

The ladder diagram in Figure 7.6 is a simple programming example showing Bidirectional Block Transfers between a sub I/O scanner and PLC-5.

**Figure 7.6**  
**PLC-5 Block Transfer**

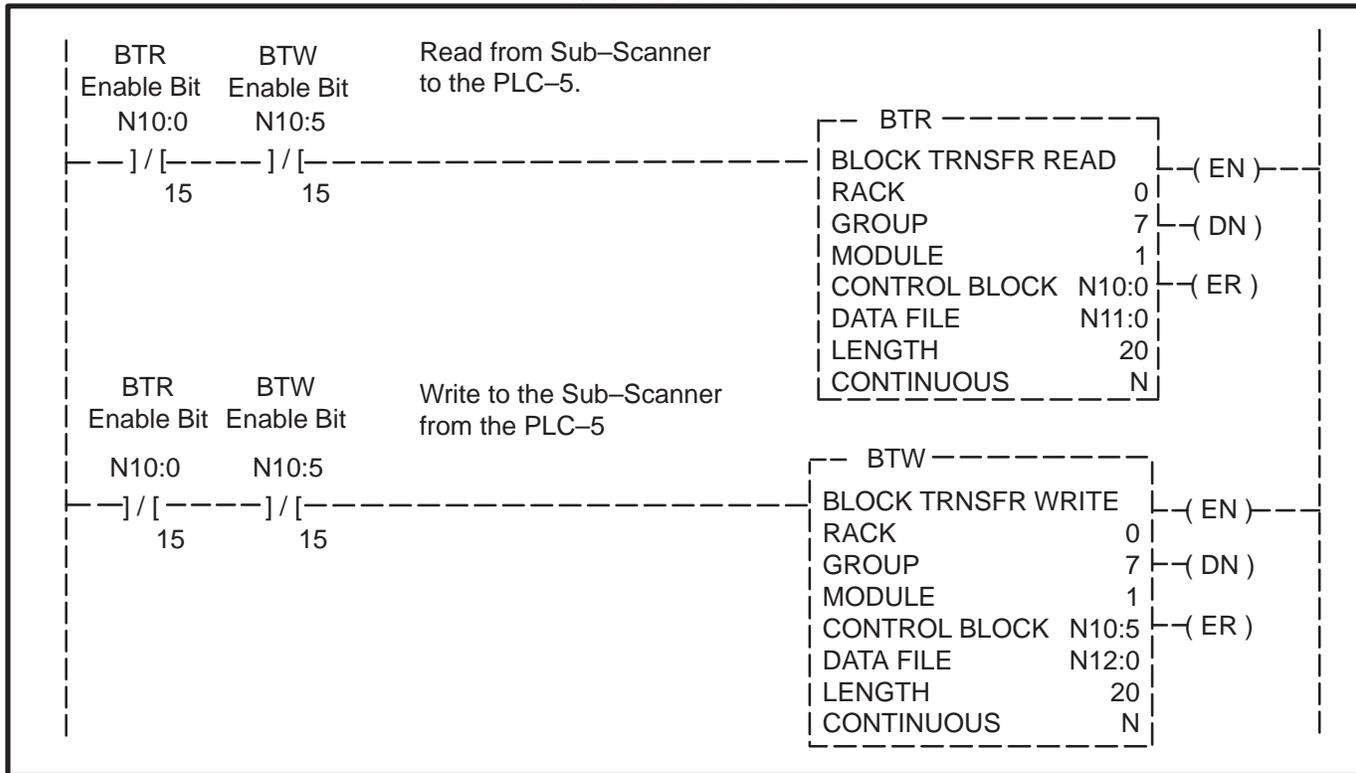

The block transfer read and write instructions have certain parameters that you must enter. The following is a description of these instruction parameters to help you configure your block transfer instructions.

**Instruction Parameters:**

- RACK refers to which I/O rack number that the sub I/O scanner is located in. The number entered here will range from 0-3 if a PLC-5/15 is being used or 0-7 if a PLC-5/25 is being used.
- GROUP refers to which I/O group of the rack, that the sub I/O scanner is located in. The number entered here will range from 0-7.
- MODULE refers to which slot within the I/O group that the sub I/O scanner is located. The number entered here will be 0 or 1.
- CONTROL BLOCK is a 5-word integer file that controls the instruction's operation. Enter this integer file address without the # symbol: for example, N7: (any integer file) not #N7:.. This is not the file type for control elements, R.
- DATA FILE is the address of the block-transfer file that will be written to, or read from, and it is from this file that the processor transfers data. Enter this file address **without** the # symbol. The status of the inputs or outputs of the remote I/O devices connected to the sub I/O scanner, will

be reflected in this file. Therefore, all your input or output addresses for these remote devices will be elements of this file.

- LENGTH is the number of words the sub I/O scanner is transferring. The number entered will be equal to 8 words (reserved for sub I/O scanner utility functions) plus 2 words for each 1/4 rack of I/O the sub I/O scanner will be communicating with. For example: If you are connecting 4 RediPANELs configured for 1/4 rack, plus 1 RediPANEL configured for 1/2 rack to the sub I/O scanner, the number you would enter here would be 20.

8 words (for sub I/O scanner utility functions)  
+8 words (2 words for each 1/4 rack RediPANEL)  
+4 words (for the one, 1/2 rack RediPANEL)  
=20 words

- CONTINUOUS determines the mode of instruction execution. Enter N, for no.

It is important to note, that all block transfer read and write instructions should be programmed in the first rungs of the program. Each instruction may transfer a maximum of 64 words at a time between the processor and the sub I/O scanner. (8 words for the sub I/O scanner utility functions and 8 words for each of the 7 logical racks of RediPANELs the sub I/O scanner is capable of communicating to.)

### Programming Example

In this programming example, we are using block transfer read and write instructions to communicate between a PLC-5/15 and sub I/O scanner. The sub I/O scanner is located in slot 1, module group 7 of the local I/O rack. The sub I/O scanner has a keypad module, configured for 1/2 rack, connected to it.




In the programming example shown in Figure 7.7, you'll notice the length has been set for (12), 8 words for the block transfer utility functions and 4 words for the Keypad Modules configured for 1/2 rack. The DATA FILE for the block transfer read instruction begins at N11:0. This means the addresses in the ladder logic, for the keypad input, will begin with N11:8/00. The DATA FILE for the block transfer write instruction begins at N12:0. This means the addresses in the ladder logic, for the keypad output, will begin with N12:8/00.

### Programming Example

Figure 7.8 shows an example of what the instruction addresses for the RediPANEL Keypad Module would look like in the ladder logic, given the configuration shown in Figure 7.7. The first 8 words of files N11: and N12: have been reserved for the sub I/O scanner utility words.

**Figure 7.8**  
**PLC-5/15 and Sub-Scanner Ladder Logic Example**

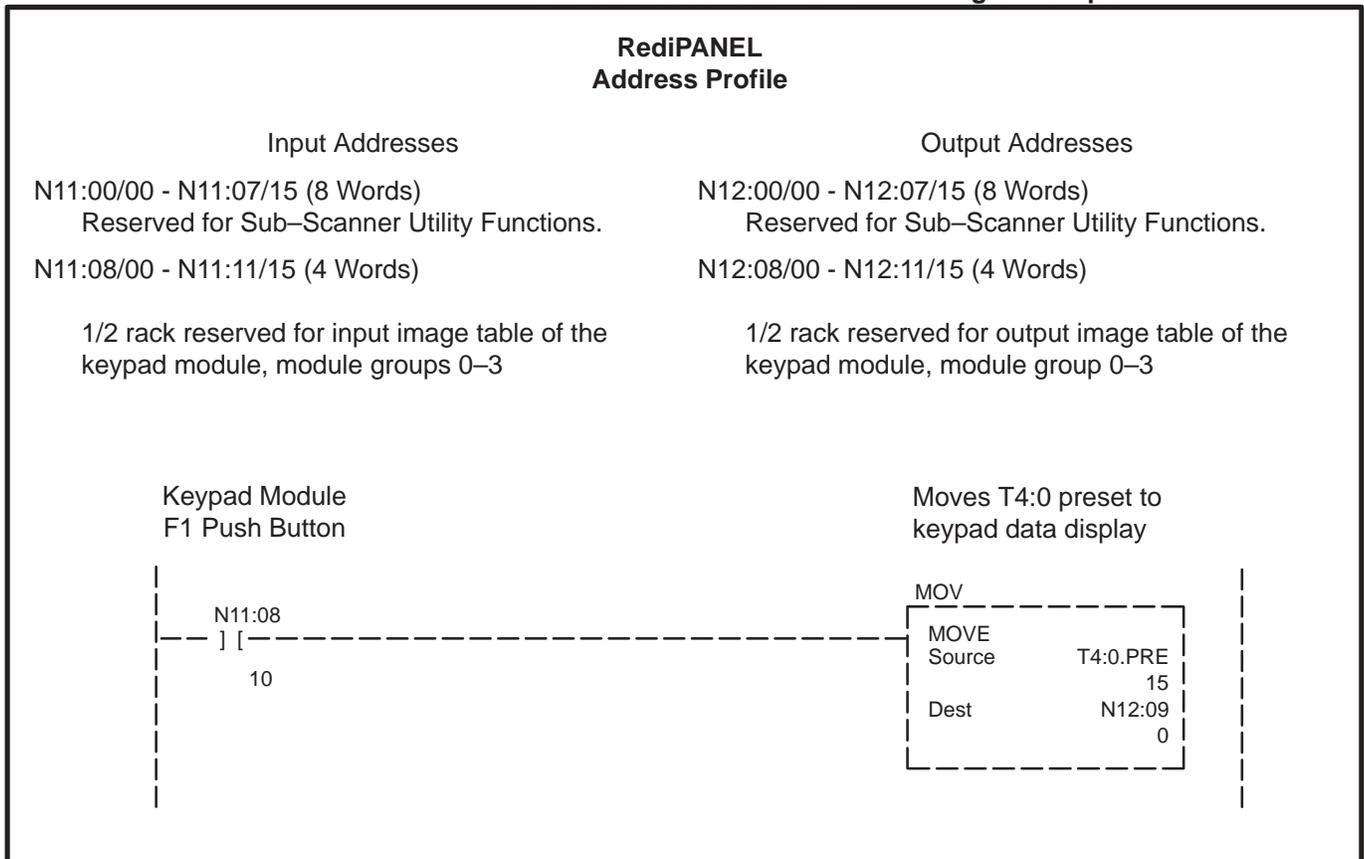

## PLC-2 Programming Example

The following pages contain a PLC-2 example program which utilizes many of the functions of the Keypad Module. Keep in mind that this program is simply an example - your applications may or may not fit this structure.

The programming examples cover the following topics:

- Part A: Examining accumulated values of a counter
- Part B: Changing and examining preset values of a counter
- Part C: Displaying a 16-character message
- Part D: Displaying a message and variable data simultaneously
- Part E: Destination bits for retrieval of data

To operate the following program, set the Keypad Module for:

BCD Mode

Rack 1

$\frac{3}{4}$  Rack Configuration

I/O Group = 0

Baud Rate = 57.6K

Enable:

Destination Bits

Stored Message

Split Display

Disable:

Handshake

Keyswitch

Last State

XT-keyboard

**Note:** A table has been constructed to assign numeric values to word locations.

Word 477=0

Word 511=1 - ①

Word 512=2 - ①

Word 513=3 - ①

Word 510=500 - Destination Bits

① These numbers are used to call up stored messages from EEPROM in the Keypad Module.



```


7  +-] [ 310 ----- ( L )--+
    !   11                540 00  !
    !   540 0137                0412  !
8  +-] [ ---- [ G] ----- ( CTU )--+
    !   00 500                214  !
    !   540 0515                003 0413  !
9  +-] [ ---- [ G] ----- ( PUT )--+
    !   00 002                003  !
    !   540 310 0312                0137  !
10 +-] [ ----] [ ---- [ G] ----- ( PUT )--+
    !   00 16                000  !
    !   310 0137                0412  !
11 +-] [ ---- [ G] ----- ( PUT )--+
    !   16 500                214  !
    !   540 310                540  !
12 +-] [ ----] [ ---- ----- ( U )--+
    !   00 16                00  !
    !   310 511                0413  !
13 +-] [ ---- [ G] ----- ( PUT )--+
    !   15 001                003  !
    !   310                410  !
14 +-] [ ---- ----- ( L )--+
    !   15                16  !
    !   310                410  !
15 +-] [ ---- ----- ( U )--+
    !   14                16  !
    !   310 0477                0413  !
16 +-] [ ---- [ G] ----- ( PUT )--+
    !   14 000                003  !
    !   310 0477                0412  !
17 +-] [ ---- [ G] ----- ( PUT )--+
    !   14 00                214  !

```

END 01107

Program Set-up

Rungs A, B and C set the program up:

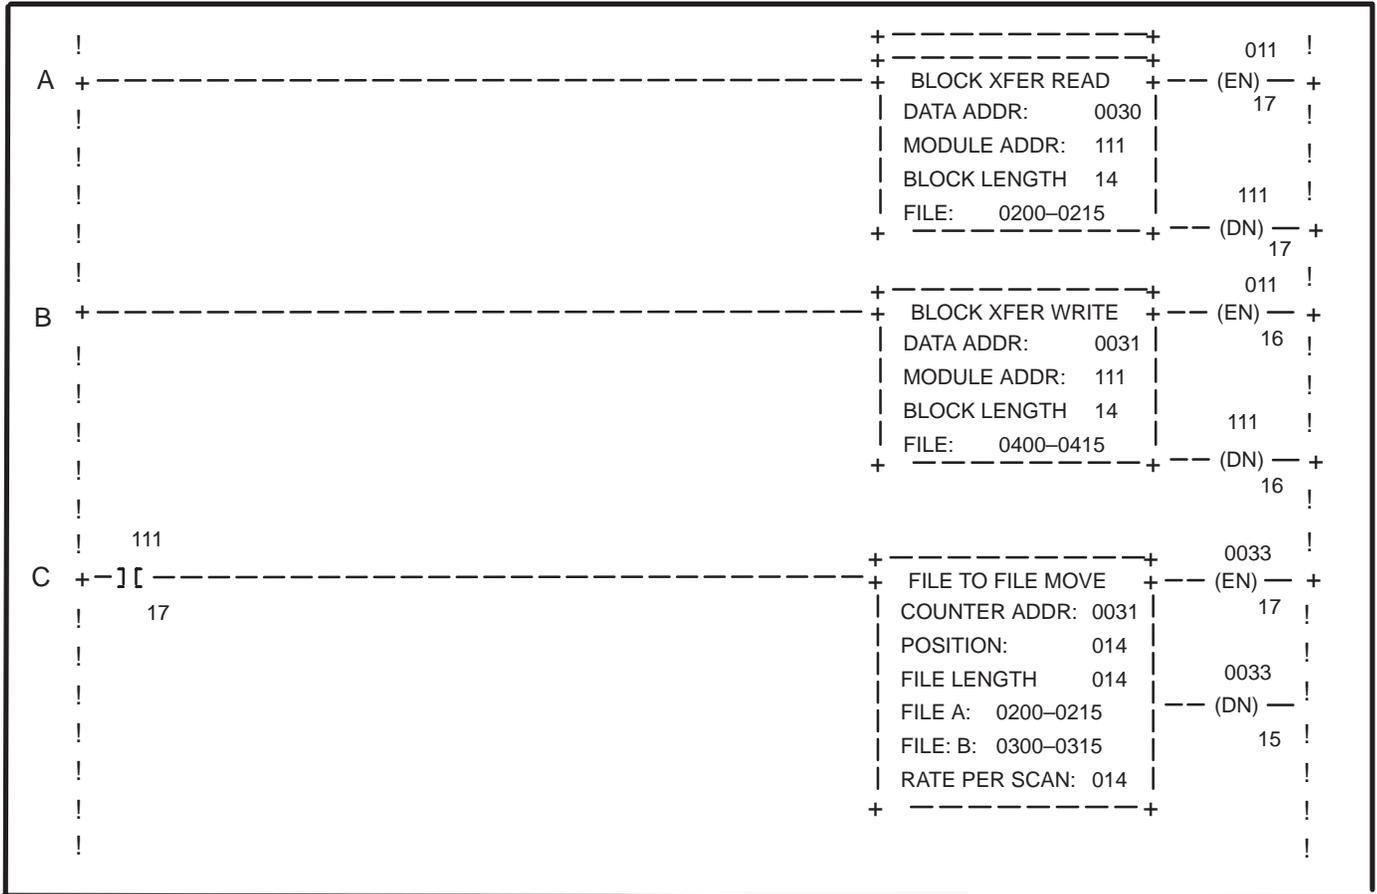

The block transfers and the file-to-file move allow for communications from the sub-scanner to the programmable controller. The block length of 14 allows for 8 utility words needed by the sub-scanner and 6 words (or  $\frac{3}{4}$  rack) for the Keypad Module. The resulting input/output image tables in Figure 7.9, on the following page, go along with this programming example for Keypad Module.

**Figure 7.9**  
**I/O Table for Sample Program: BCD Mode,  $\frac{3}{4}$  Rack**

| Input Image Table |    |    |    |      |    |    |    |      |           |   |   |            |   |   |   |          |          |
|-------------------|----|----|----|------|----|----|----|------|-----------|---|---|------------|---|---|---|----------|----------|
| 17                | 16 | 15 | 14 | 13   | 12 | 11 | 10 | 7    | 6         | 5 | 4 | 3          | 2 | 1 | 0 |          |          |
| H                 | EN | F6 | F5 | F4   | F3 | F2 | F1 | S    | Dec. Pos. |   |   |            | — | — | — | —        | Word 310 |
| BCD1 (MSD)        |    |    |    | BCD2 |    |    |    | BCD3 |           |   |   | BCD4       |   |   |   | Word 311 |          |
| BCD5              |    |    |    | BCD6 |    |    |    | BCD7 |           |   |   | BCD8 (LSD) |   |   |   | Word 312 |          |
| Destination       |    |    |    |      |    |    |    |      |           |   |   |            |   |   |   | Word 313 |          |
| Destination Bits  |    |    |    |      |    |    |    |      |           |   |   |            |   |   |   | Word 314 |          |
| Destination Bits  |    |    |    |      |    |    |    |      |           |   |   |            |   |   |   | Word 315 |          |


  

| Output Image Table                  |     |    |    |      |    |    |    |      |           |   |   |            |    |     |   |          |
|-------------------------------------|-----|----|----|------|----|----|----|------|-----------|---|---|------------|----|-----|---|----------|
| 17                                  | 16  | 15 | 14 | 13   | 12 | 11 | 10 | 7    | 6         | 5 | 4 | 3          | 2  | 1   | 0 |          |
| H                                   | DMM | L6 | L5 | L4   | L3 | L2 | L1 | S    | Dec. Pos. |   |   |            | DC | SDP |   | Word 410 |
| BCD1 (MSD)                          |     |    |    | BCD2 |    |    |    | BCD3 |           |   |   | BCD4       |    |     |   | Word 411 |
| BCD5                                |     |    |    | BCD6 |    |    |    | BCD7 |           |   |   | BCD8 (LSD) |    |     |   | Word 412 |
| Stored Message Display Number (SMD) |     |    |    |      |    |    |    |      |           |   |   |            |    |     |   | Word 413 |
| Two Alphanumeric Characters         |     |    |    |      |    |    |    |      |           |   |   |            |    |     |   | Word 414 |
| Two Alphanumeric Characters         |     |    |    |      |    |    |    |      |           |   |   |            |    |     |   | Word 415 |

The symbols and abbreviations for the bits in these tables are explained on pages 7–25 and 7–26.

**Part A: Changing and Examining Accumulated Value of Counter for PLC-2**

Rungs 1–5 show a procedure for monitoring the accumulated value of counter 037 using the Keypad Module:

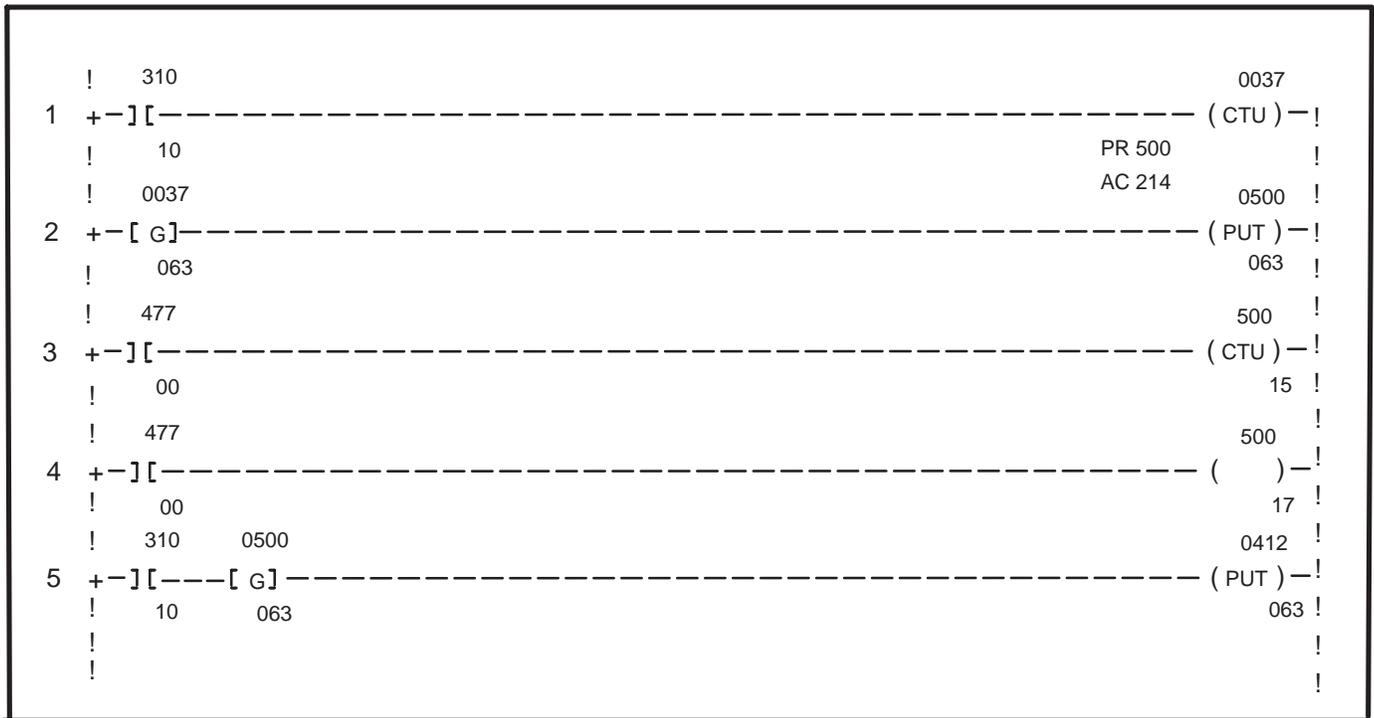

**Rung 1:**  
The input signal, function key F1, is programmed to increment counter 037.

**Rung 2:**  
The counter value cannot be sent directly to the output image table of the Keypad Module because the counter is a 3-digit BCD and word 412 of the keypad output table is designed for a 4-digit BCD value. So, we must first put the counter value in a buffer location and make sure the upper 4 bits of counter 037 are zero before being sent to Keypad Module output image table.


**Rung 3:**  
These rungs guarantee that no number will appear

**Rung 4:**  
in the fourth digit of the Keypad Module. Input signal 477 on both rungs will put a zero into the done bit (500/15) and CTU enable (500/17) bit of the buffer (word 500).

**Rung 5:**  
When function key F1 is depressed, the accumulated value of the counter will be displayed on the right hand side of the Keypad Module.

**Part B: Changing and Examining  
preset Value of Counter for  
PLC-2**

Rungs 7–12 show a programming procedure that will allow you to change the preset values of the counter that was being monitored in rungs 1–5. (Rung 6 and Rung 9 are for message recording, and will be explained later).

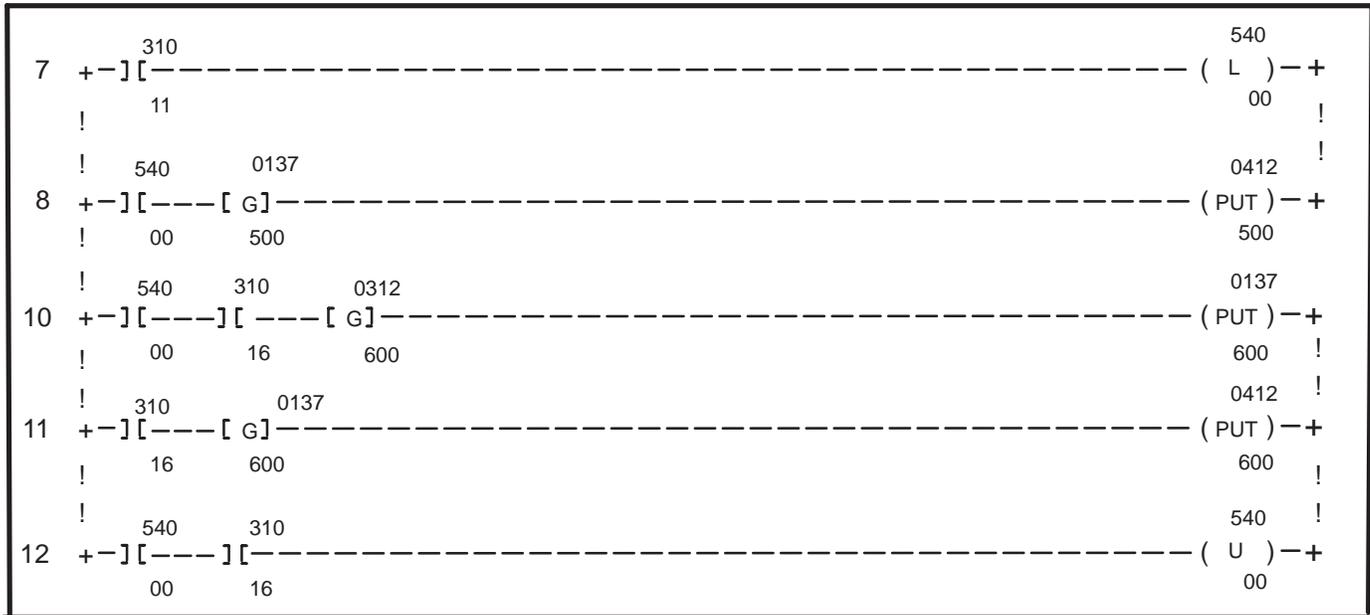

**Rung 7:**  
The input signal, function key F2 is being latched on.

**Rung 8:**  
The input signal (540/00) is retrieving the preset (137) of counter 037 and displaying it on the Keypad Module (output 412).


**Rung 10:**  
The existing preset value is now being displayed on the Keypad Module. To enter a new preset, depress the appropriate number keys followed by the ENTER key (310/16).

**Rung 11:**  
This rung verifies what was entered to show us the new preset. When the ENTER key was depressed (310/16), the new preset (137) was then displayed on the Keypad Module (412).

**Rung 12:**  
Output word 540 is unlatched when ENTER key is pressed.

**Part C: Displaying a  
16-Character Message for  
PLC-2**

Rungs 13 - 17 retrieve and display a message:

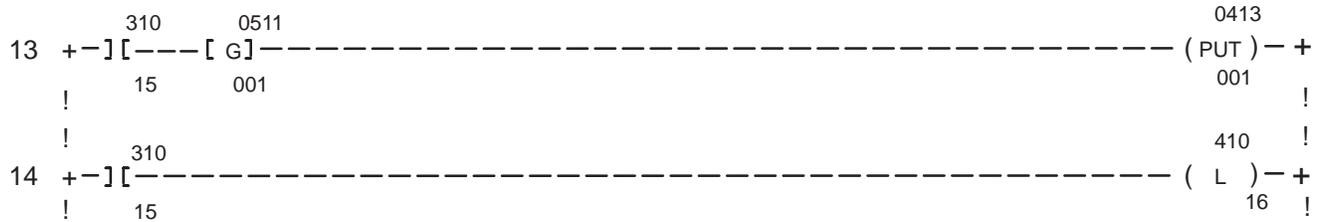


**Rung 13:**

When function key F6 is depressed, a number is retrieved from word 511 and put in the output image table location (413) reserved for a stored message number. (Refer to output image table.) Shown above - message number "1" is being moved to word 413.

**Rung 14:**

In order for the message to continually be displayed, the Display Message bit (410/16) of the output image table must be on. Rung 14 latches this bit on.

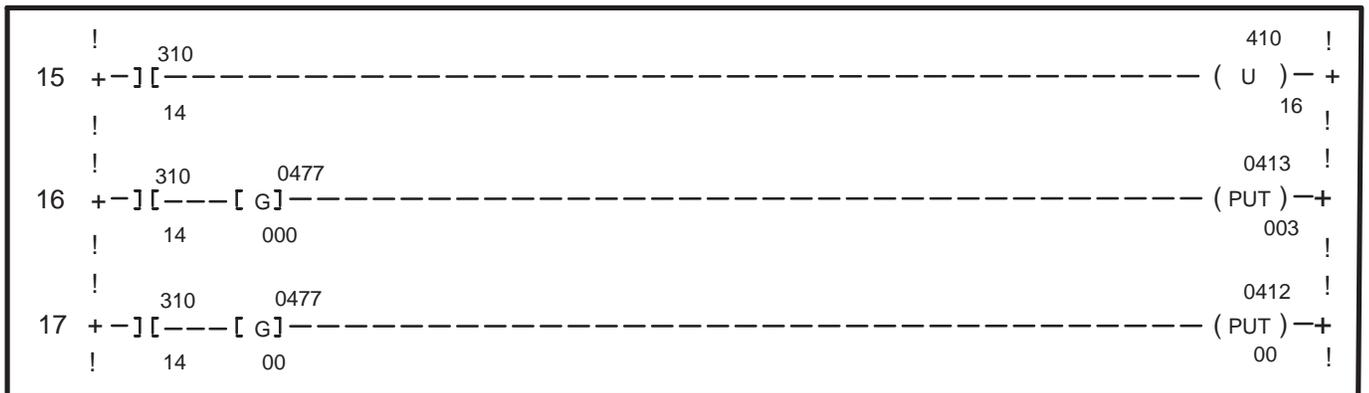

**Rung 15:**

When function key F5 is depressed the display

**Rung 16:**


message bit is released. Rung 16 and 17 put zeros

**Rung 17:**

in the data table words 412 and 413 so that the display is cleared when F5 is depressed.

### Part D: Displaying Message and Variable Data Simultaneously for PLC-2

In Part A and B we learned how to examine information from the PLC by using the Keypad. In order to have an 8-character message work with the variable data a message number must be put into the stored message word of the output image table at the same time the variables appear on the keypad display. Therefore, the following rung is all that is required for a message to be displayed:

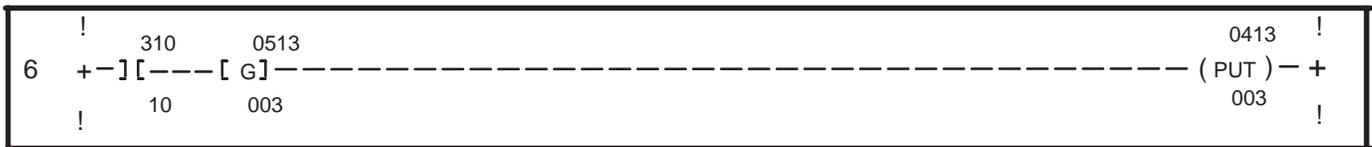


#### Rung 6:

This rung says that when function key F1 is depressed, message number 3 will be put into the stored message number location.

### Part E: Using Destination Bits to Retrieve or Change Data for PLC-2

Destination bits allow for the retrieval of data from an existing area in the data table where information is known to reside.

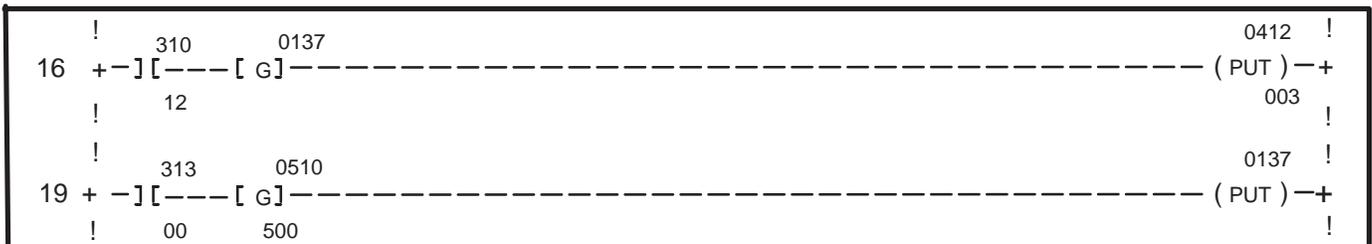

#### Rung 18:

When function key F3 is depressed, the preset (137) value from counter 037 will be displayed on the Keypad Module.

#### Rung 19:

Input signal 313/00 is a destination bit. To enable this destination bit, depress the ENTER key. The keypad will display >>—>>—. Now you enter a “1” for the first bit of destination bits available (which is 313/00 in the input image table of the Keypad Module). Depress the ENTER key again and rung 19 will get word 510 and take that numeric value and put it in the preset of counter 037.

**Note:** Word 510 is simply an arbitrary word. To use destination bits you need a table of data to draw information from. Our data base starts at word 510 for this example.

## Symbols and Abbreviations for I/O Image Tables

The figures on the following pages show the input and output tables for the Keypad Module.

The following symbols and abbreviations appear in the input and output tables. Refer to this list for identifying specific bits in the tables:

“-” Represents a “0”. No function is assigned for this bit location.

**H** Handshake bit. Refer to page 7–28 for more information.

**EN** Enter bit. This bit toggles when the ENTER key of the keypad module is depressed.

### **F1-F6**

**Function key bits.** These bits are input signals from the function keys. When one of the function keys is depressed the corresponding bit will toggle.

### **L1-L6**

**LEDs located on each function key.** These bits are output signals that feedback to acknowledge a function key was depressed. They can be used like pilot lights. When bit=1 the LED is ON, when bit=0 the LED is off.

**DM** Display Message. This bit allows a 16-character stored message to be displayed or ASCII data (No PLC numeric data), when DM=1. Refer to Chapters 6 & 7 for more information.

### **SMD**

**Stored Message Display number.** This is the output word location for the message number which is being displayed on the Keypad. When SMD=0, then ASCII data will be displayed.



**ATTENTION:** Any SMD value greater than 120 will cause a lock-up condition. To protect against this condition, a boundary check should be used in the PLC program to help insure a valid MSG # is sent.

---

## Decimal Point Control

### Dec. Pos.

**DEC**imal **POS**ition. The decimal position field holds a binary value (1–7) that is the number of positions to the right of the decimal point:

**Input Image table** – Indicates the number of places to the right of the decimal point as numeric data is being entered.

**Output Image table** – Controls the number of places to the right of the decimal point when the Keypad Module is displaying variable data.


**DC** Decimal point **C**ontrol. Decimal point control enables SDP. See Table 7.A.

### SDP

**S**cratchpad **D**ecimal point **P**osition. The binary value of these bits will control the number of places (1–7) to the right of the decimal point as numeric data is being entered. When this value is 0, the decimal point button in the keypad module will be active.

| DC<br>Decimal Point<br>Enable Bit<br>(Output Image) | SDP<br>Scratchpad Decimal<br>Point Position<br>(Output Image) | Decimal<br>Point Mode |
|---|---|-----------------------|
| 1   | 1 to 7  | Fixed                 |
| 1   | 0   | Variable              |
| 0   | don't care  | Disabled              |

**Figure 7.10**  
**Example of Decimal Point Control**

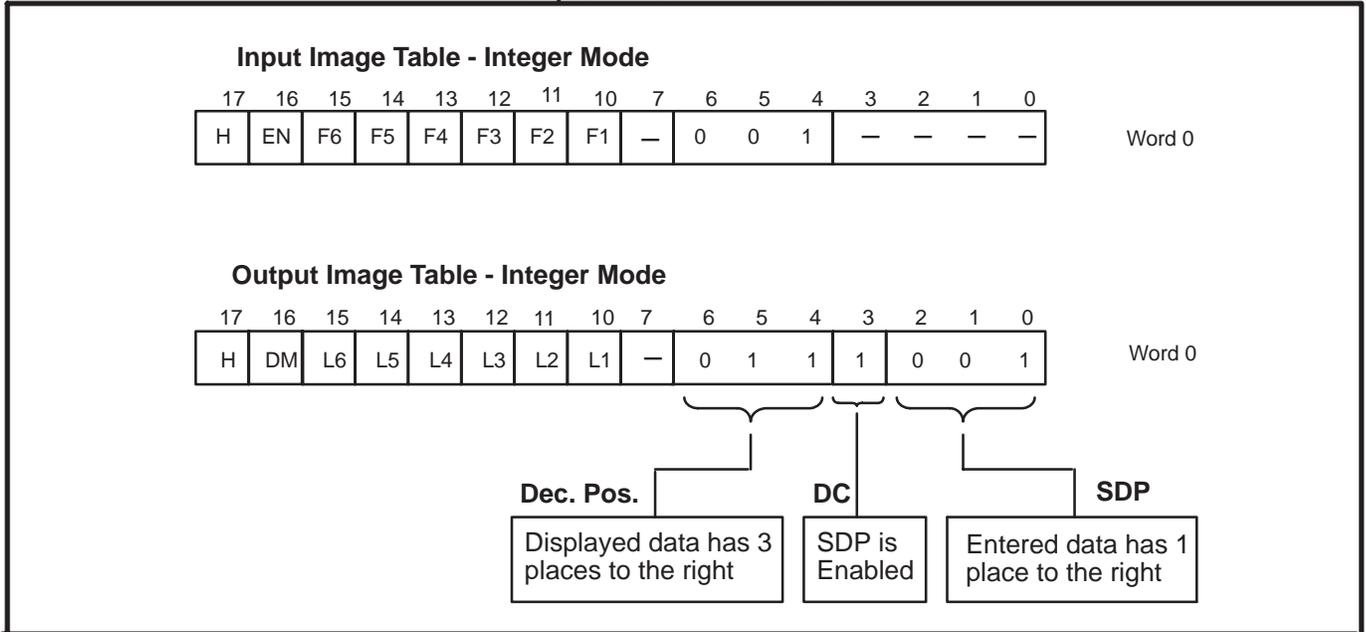

## When to Use the Handshake Mode

RediPANEL Modules have a standard TIMED feature that holds all push button depressions for a minimum of 100 milliseconds to allow the PLC controller to read the depression during its scan cycle. No special programming is needed for this function. Most system configurations can use this feature to help insure data capture of a push button depression.


As a general guideline, handshaking is not required. The few cases where it is required would be:

1. Very lengthy scan times. Lengthy scan times can occur when the block transfer instruction is used numerous times in the ladder program. Lengthy scan times can also occur when the ladder program is very large.
2. When the remote I/O link is approaching its physical limitation of 16 devices (RediPANEL push button modules, keypad modules, remote I/O racks).

To select the Handshake feature, enable (set ON) the module's DIP switch 7 on switch bank #2. Setting this switch OFF, gives you the TIMED feature, which is the default setting. Chapter 5 discusses switch settings for mode configuration. Figure 5.5 refers to Handshake enable and disable settings.

To use the Handshake feature, the PLC program must have a rung that accepts the handshake bit and allows communication to continue. Refer to Figure 7.11 for an example of this rung. If you have selected the Handshake feature, then your PLC program must contain this rung, or the module will not operate.


**Figure 7.11**  
**Ladder Logic Handshake Rung**

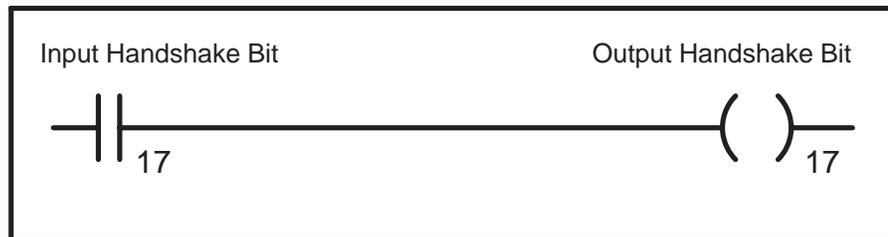

With the handshake feature enabled and the handshake rung in the user's program, the RediPANEL module holds all function key input signals high for a minimum of one complete PLC program scan. It keeps the signal(s) high for one complete cycle of the handshake input bit. The handshake input and output signals will continuously toggle independent of any function key closures. This ensures that the handshake function is operational even if no function keys have been pressed. The timing diagrams (Figure 7.12) further explain how this is accomplished.

**IMPORTANT:** The following diagrams are used for illustrative purposes only and are not intended to be precise timing diagrams. Exact timing diagrams vary from application to application and are dependent upon the number of remote I/O nodes, program scan time, etc.


**Figure 7.12**  
**Handshake Timing Diagrams**

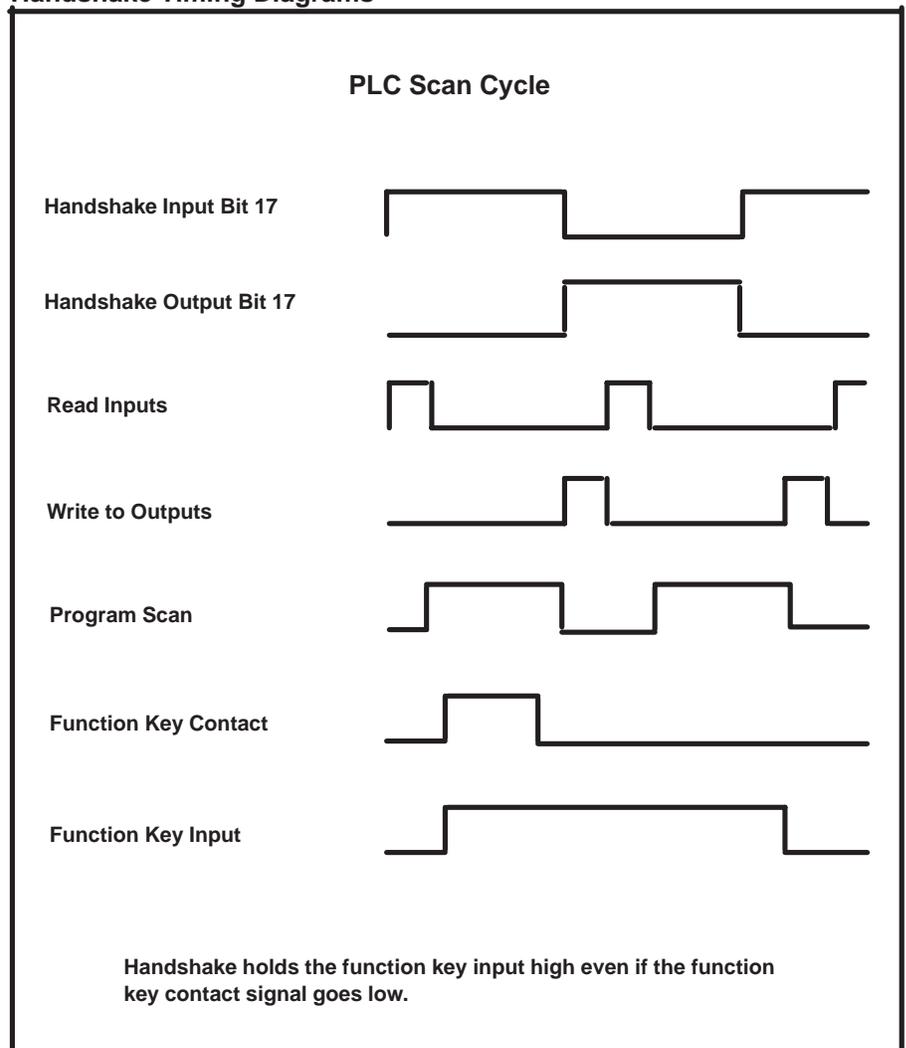

Input and Output Image Tables Integer Data – With Stored Message

1/2, 3/4 and Full Rack

Figure 7.13  
Integer Mode, 1/2, 3/4 and Full Rack with Stored Message Display

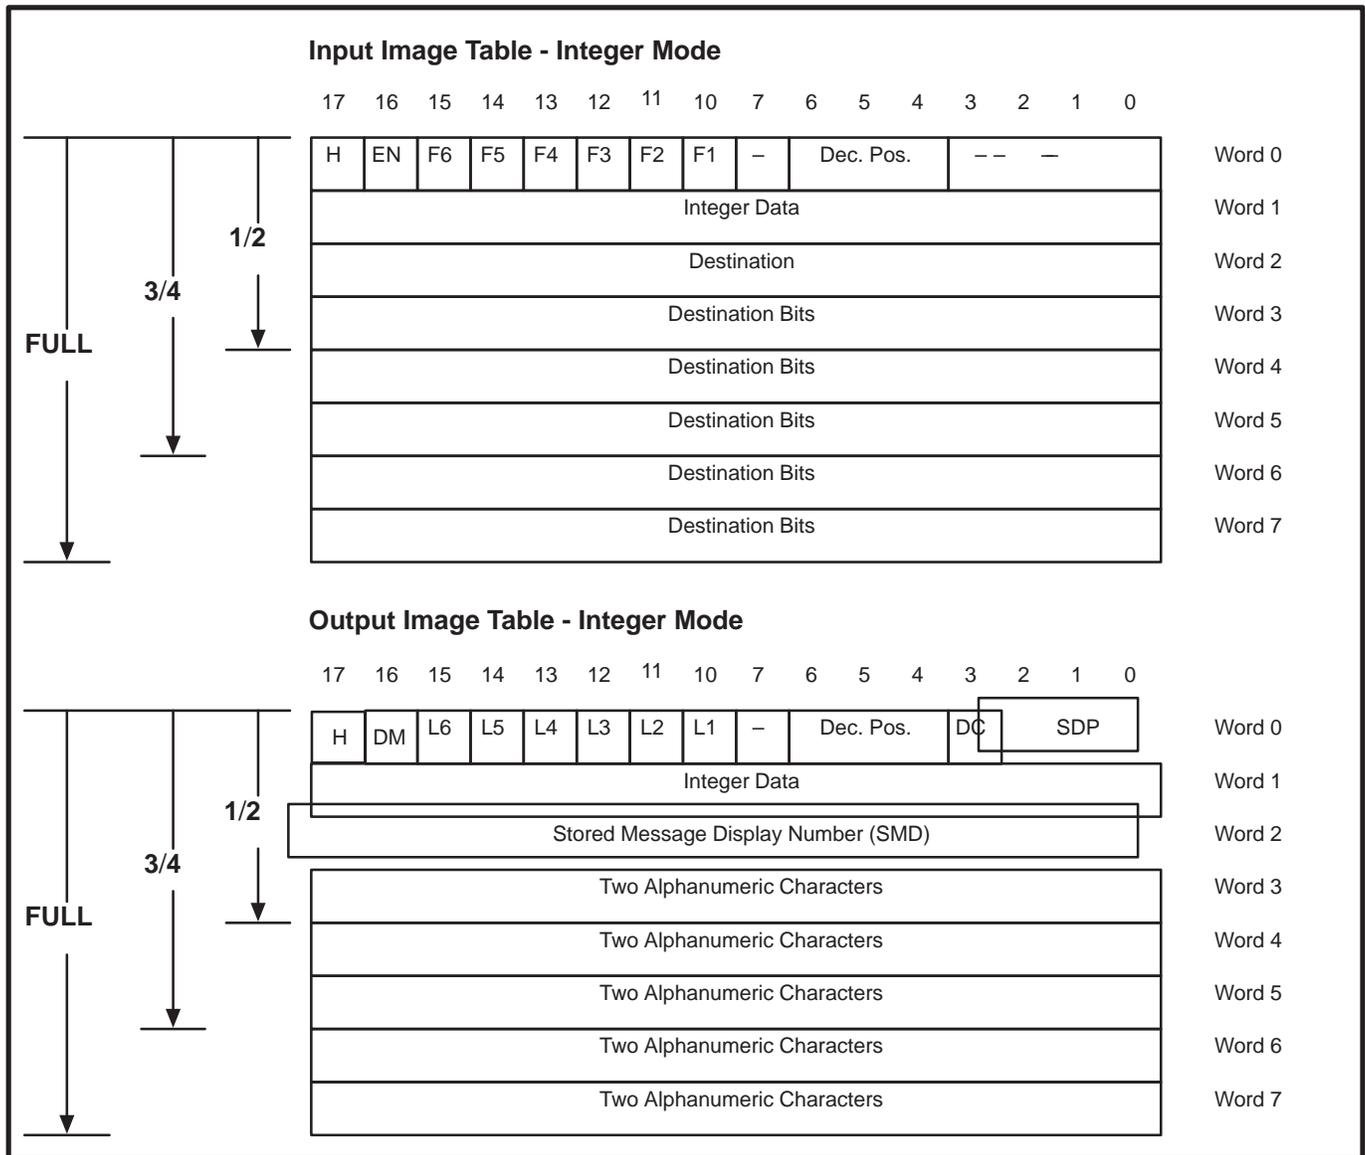


1/4 Rack Using Stored Messages Stored message display cannot be used with 1/4 rack configurations.

Input and Output Image Tables

BCD Data – With Stored Message

$3/4$  and Full Rack

Figure 7.14  
BCD Mode,  $3/4$  and Full Rack with Stored Message Display

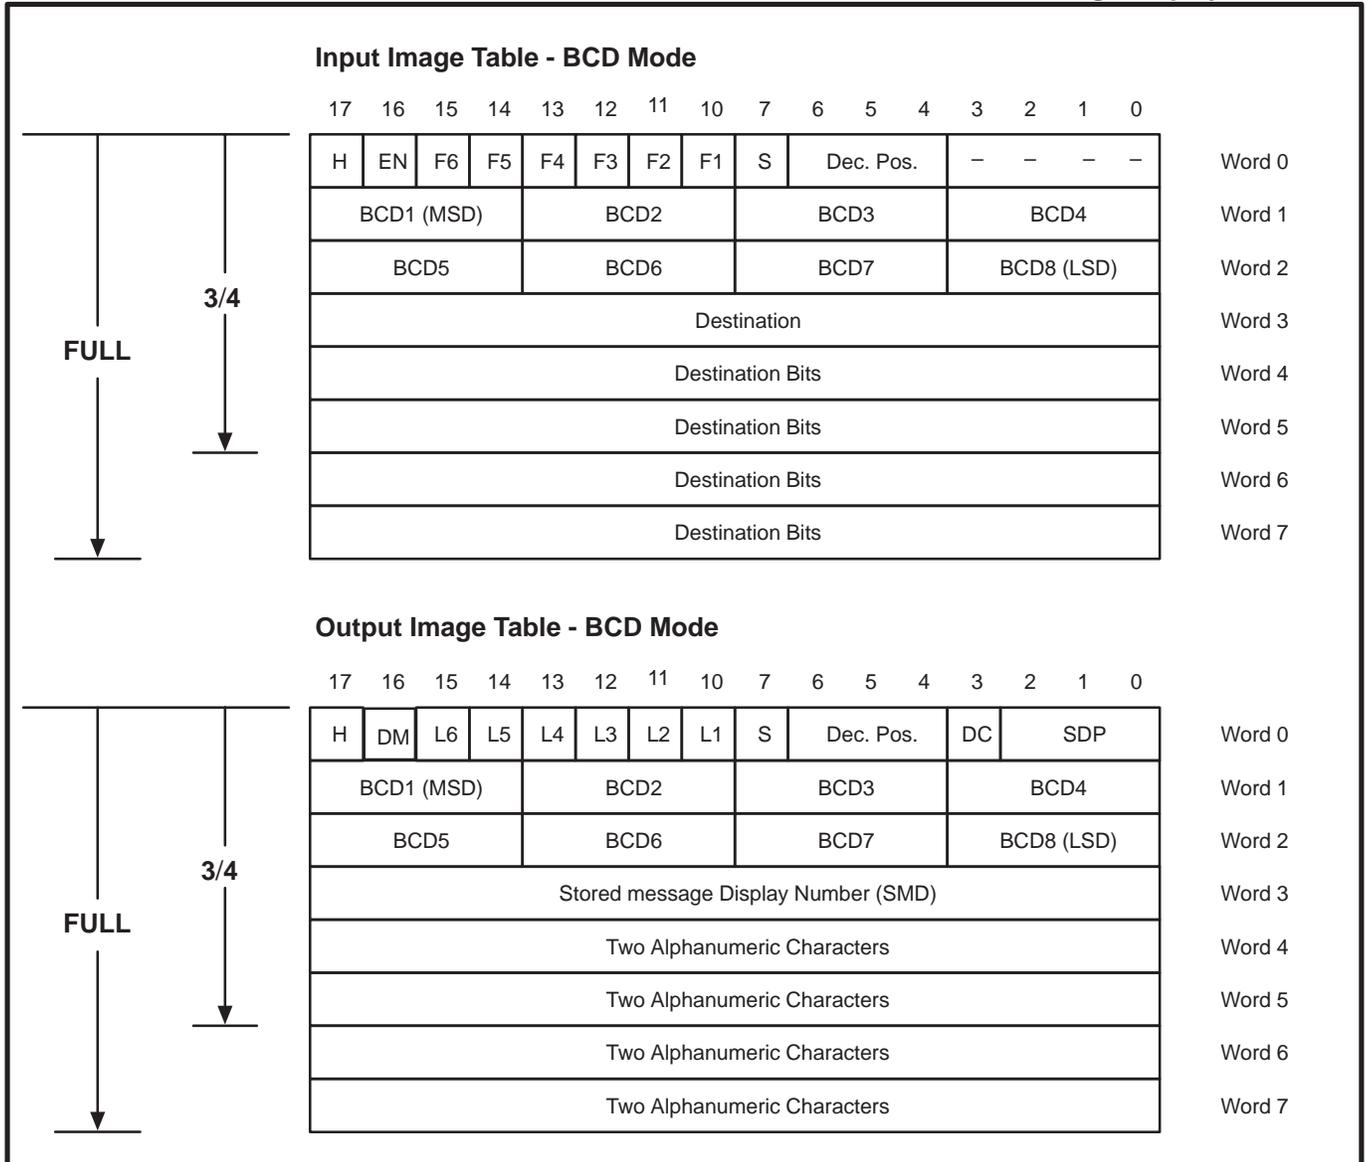


$1/4$  and  $1/2$  Rack Using Stored Messages

Stored message display cannot be used with  $1/4$  and  $1/2$  rack BCD configurations.

Input and Output Image Tables    Binary Data – With Stored Message

$1/2$ ,  $3/4$  and Full Rack

Figure 7.15  
Binary Mode,  $1/2$ ,  $3/4$  and Full Rack with Stored Message Display

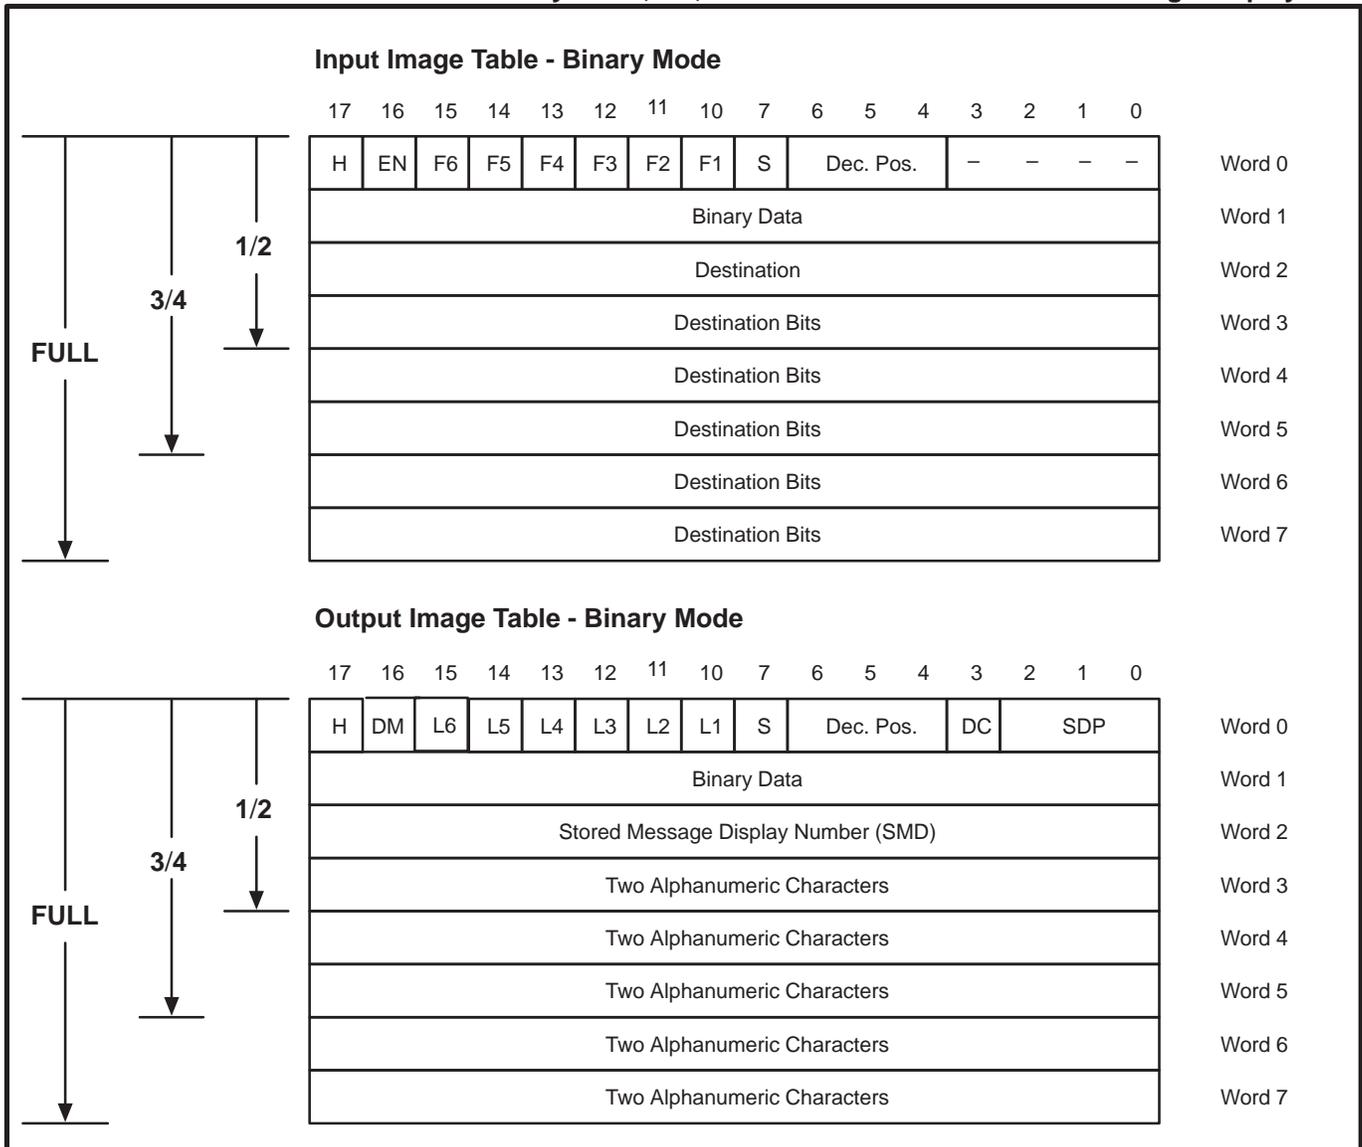


$1/4$  Rack Using Stored Messages    Stored message display cannot be used with  $1/4$  rack configurations.

Input and Output Image Tables

Integer Data – With Stored Message

1/2, 3/4 and Full Rack


Figure 7.16  
Integer Mode, 1/2, 3/4 and Full Rack

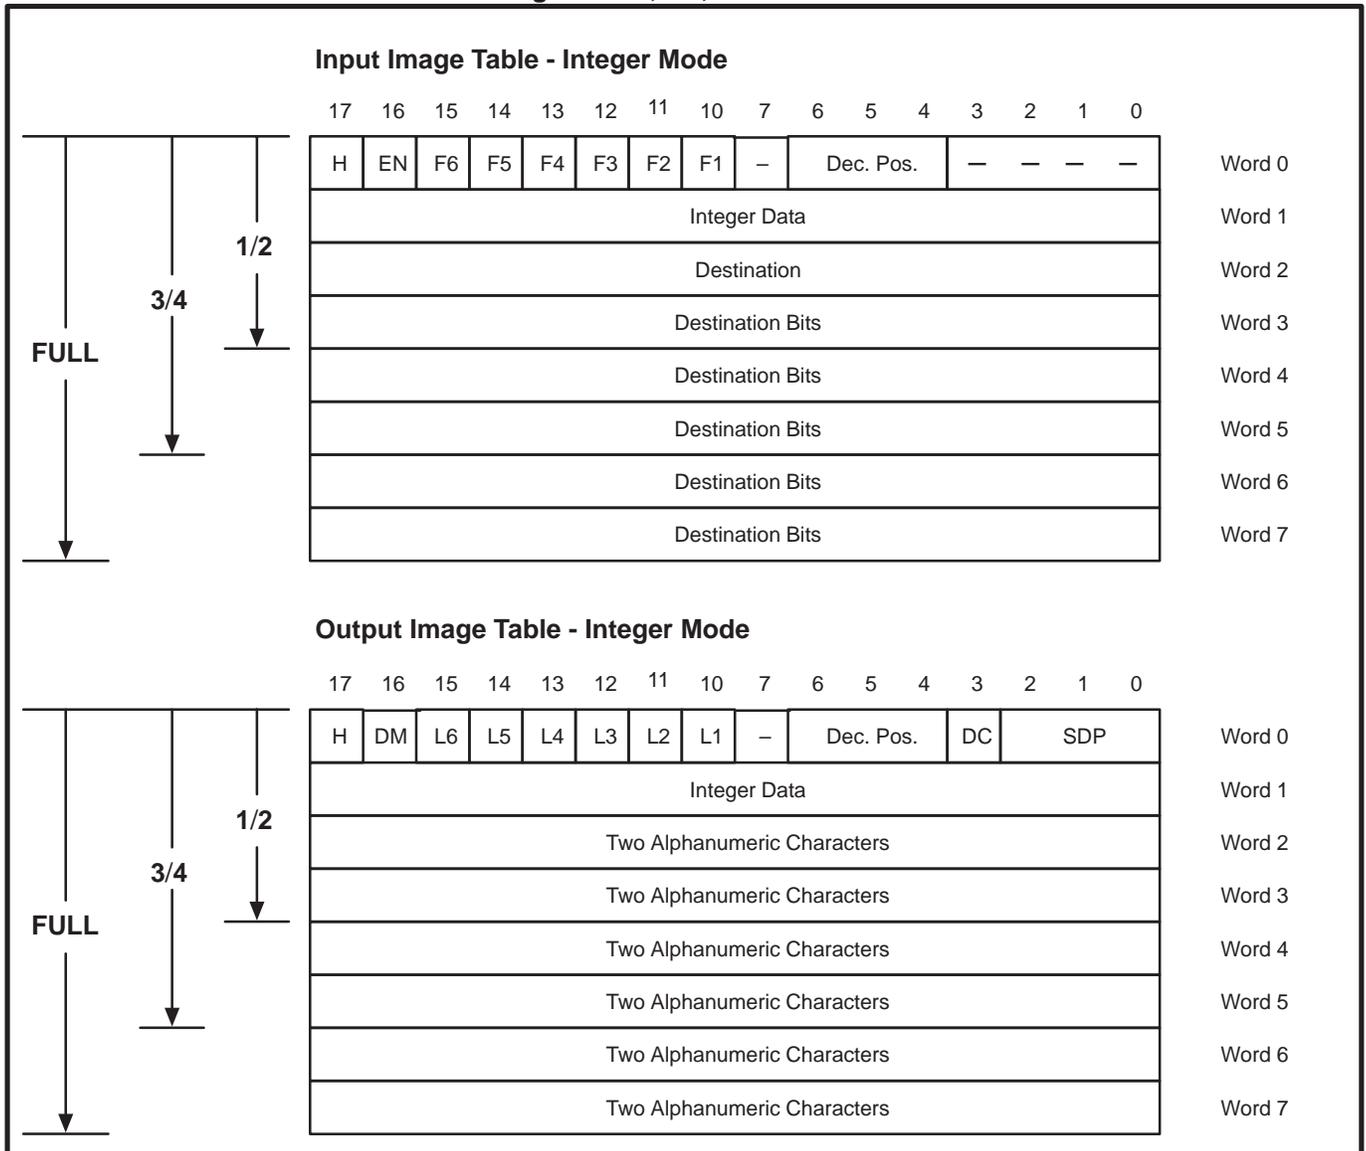

Input and Output Image Tables Integer Data – With Stored Message

<sup>1</sup>/<sub>4</sub> Rack  
Figure 7.17  
Integer Mode, 1/4 Rack

17

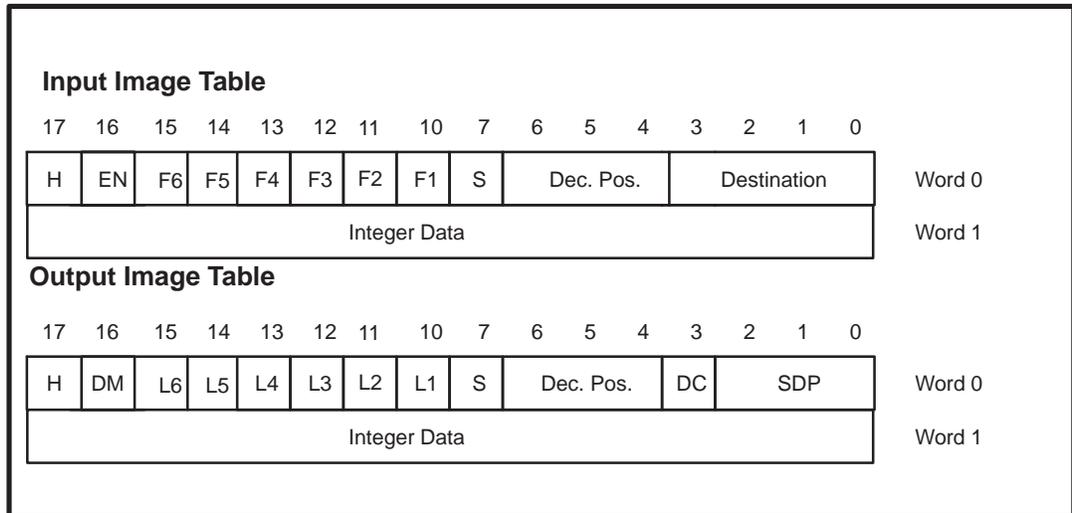


Input and Output Image Tables

Binary Data – With Stored Message

$3/4$  and Full Rack

Figure 7.18  
BCD Mode,  $3/4$  and Full Rack

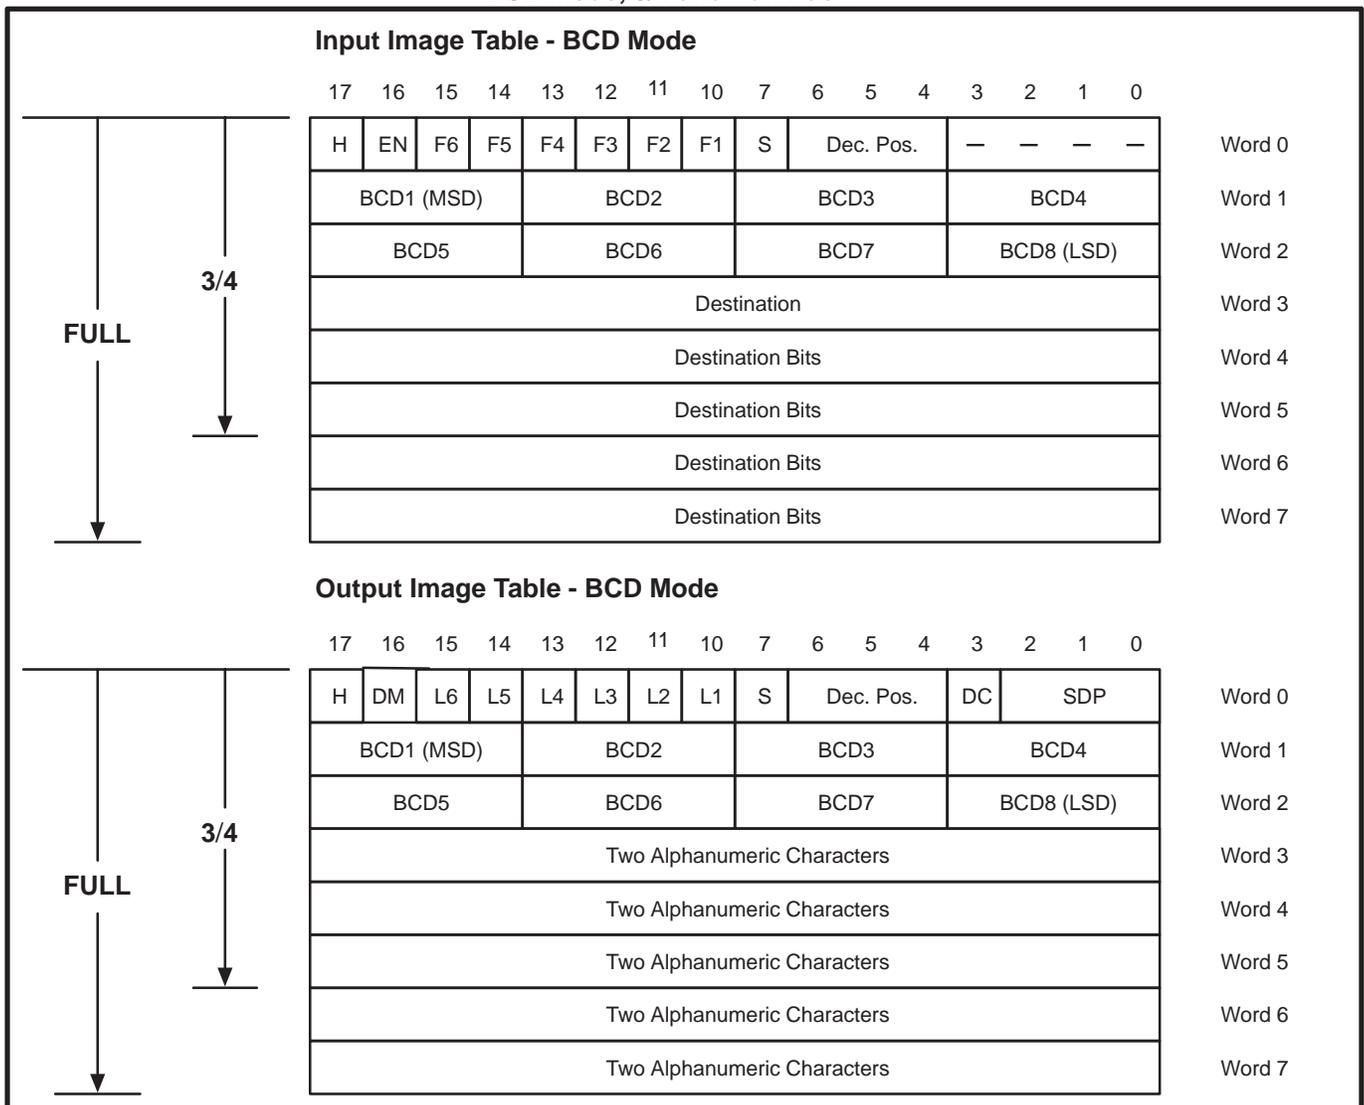

**ATTENTION:** If an invalid BCD number is entered in the least significant digit location in the Output Image Table an error will occur. To clear this error, a valid number must be placed in the Output Image Table and power to the Keypad Module must be recycled.

Input and Output Image Tables Binary Data – With Stored Message

**1/4 Rack**  
**Figure 7.19**  
**BCD Mode, 1/4 Rack**

| Input Image Table |    |    |    |      |    |    |    |            |   |   |   |            |   |   |        |
|-------------------|----|----|----|------|----|----|----|------------|---|---|---|------------|---|---|--------|
| 17                | 16 | 15 | 14 | 13   | 12 | 11 | 10 | 7          | 6 | 5 | 4 | 3          | 2 | 1 | 0      |
| H                 | EN | F6 | F5 | F4   | F3 | F2 | F1 | BCD1 (MSD) |   |   |   | BCD2       |   |   | Word 0 |
| BCD3              |    |    |    | BCD4 |    |    |    | BCD5       |   |   |   | BCD6 (LSD) |   |   | Word 1 |

| Output Image Table |    |    |    |      |    |    |    |            |   |   |   |            |   |   |        |
|--------------------|----|----|----|------|----|----|----|------------|---|---|---|------------|---|---|--------|
| 17                 | 16 | 15 | 14 | 13   | 12 | 11 | 10 | 7          | 6 | 5 | 4 | 3          | 2 | 1 | 0      |
| H                  | DM | L6 | L5 | L4   | L3 | L2 | L1 | BCD1 (MSD) |   |   |   | BCD2       |   |   | Word 0 |
| BCD3               |    |    |    | BCD4 |    |    |    | BCD5       |   |   |   | BCD6 (LSD) |   |   | Word 1 |

**1/2 Rack**  
**Figure 7.20**  
**BCD Mode, 1/2 Rack**

| Input Image Table |    |    |    |      |    |    |    |      |           |   |   |             |   |        |        |
|-------------------|----|----|----|------|----|----|----|------|-----------|---|---|-------------|---|--------|--------|
| 17                | 16 | 15 | 14 | 13   | 12 | 11 | 10 | 7    | 6         | 5 | 4 | 3           | 2 | 1      | 0      |
| H                 | EN | F6 | F5 | F4   | F3 | F2 | F1 | S    | Dec. Pos. |   |   | Destination |   |        | Word 0 |
| BCD1 (MSD)        |    |    |    | BCD2 |    |    |    | BCD3 |           |   |   | BCD4        |   |        | Word 1 |
| BCD5              |    |    |    | BCD6 |    |    |    | BCD7 |           |   |   | BCD8 (LSD)  |   |        | Word 2 |
| Destination Bits  |    |    |    |      |    |    |    |      |           |   |   |             |   | Word 3 |        |


| Output Image Table          |    |    |    |      |    |    |    |      |           |   |   |            |     |        |        |
|-----------------------------|----|----|----|------|----|----|----|------|-----------|---|---|------------|-----|--------|--------|
| 17                          | 16 | 15 | 14 | 13   | 12 | 11 | 10 | 7    | 6         | 5 | 4 | 3          | 2   | 1      | 0      |
| H                           | DM | L6 | L5 | L4   | L3 | L2 | L1 | S    | Dec. Pos. |   |   | DC         | SDP |        | Word 0 |
| BCD1 (MSD)                  |    |    |    | BCD2 |    |    |    | BCD3 |           |   |   | BCD4       |     |        | Word 1 |
| BCD5                        |    |    |    | BCD6 |    |    |    | BCD7 |           |   |   | BCD8 (LSD) |     |        | Word 2 |
| Two Alphanumeric Characters |    |    |    |      |    |    |    |      |           |   |   |            |     | Word 3 |        |

Input and Output Image Tables

Binary Data – No Stored Message

1/2, 3/4 and Full Rack

Figure 7.21  
Binary Mode, 1/2, 3/4 and Full Rack

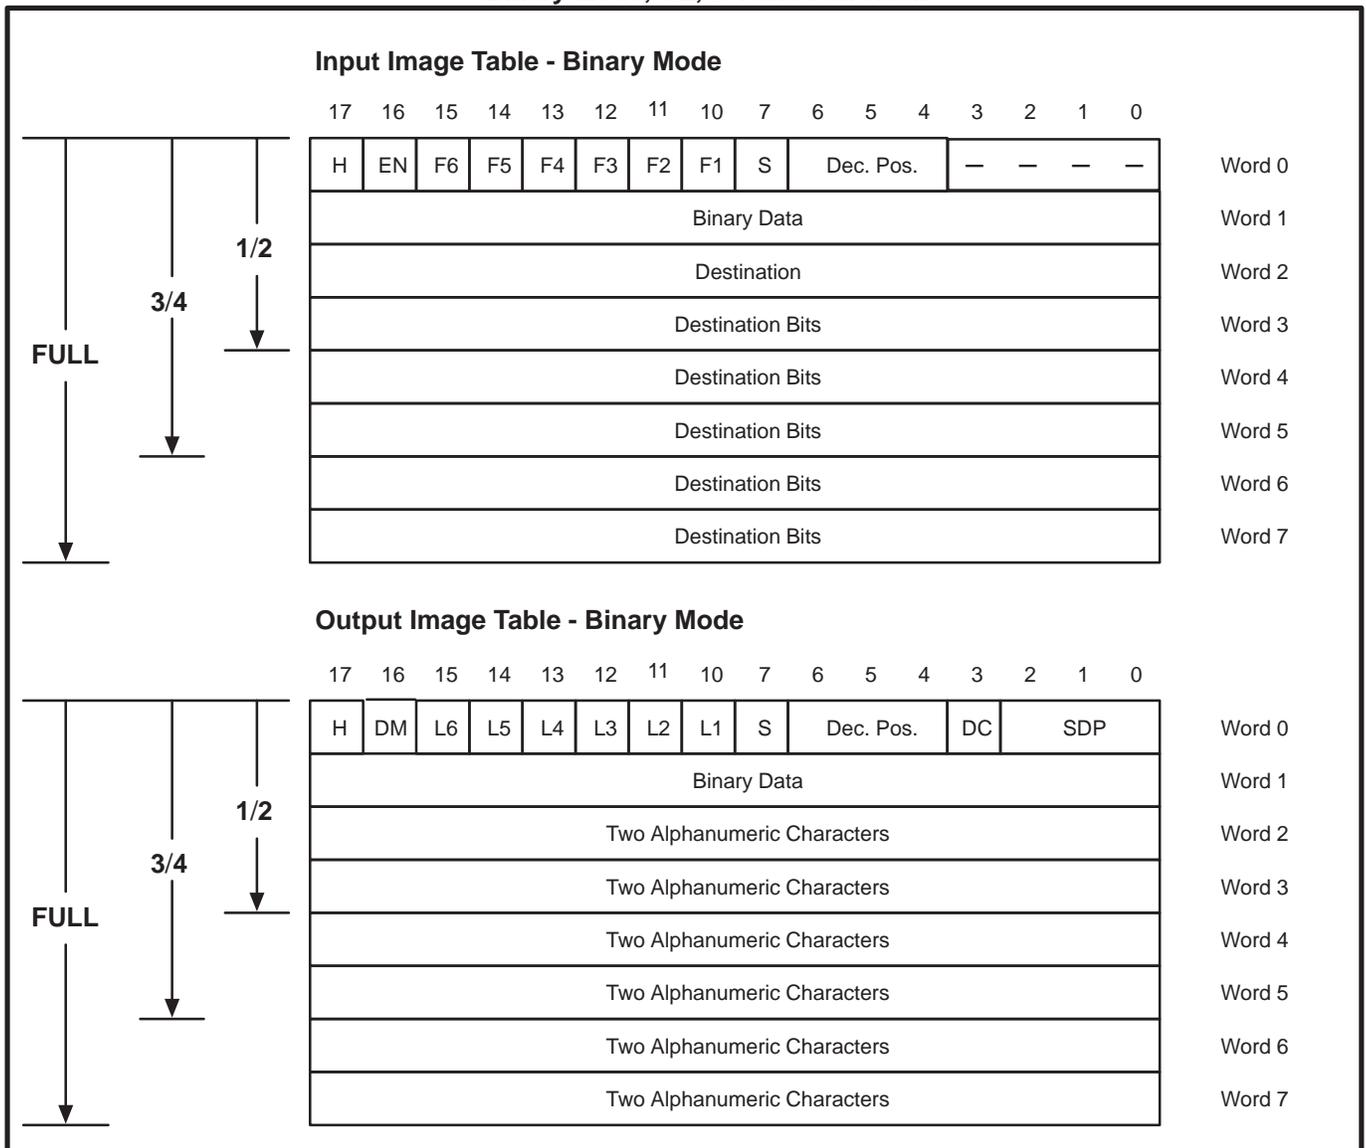

**Input and Output Image Tables    Binary Data – No Stored Message**

**1/4 Rack**


**Figure 7.22  
Binary Mode, 1/4 Rack**

| Input Image Table  |    |    |    |    |    |    |    |   |           |   |             |     |   |   |        |
|--------------------|----|----|----|----|----|----|----|---|-----------|---|-------------|-----|---|---|--------|
| 17                 | 16 | 15 | 14 | 13 | 12 | 11 | 10 | 7 | 6         | 5 | 4           | 3   | 2 | 1 | 0      |
| H                  | EN | F6 | F5 | F4 | F3 | F2 | F1 | S | Dec. Pos. |   | Destination |     |   |   | Word 0 |
| Binary Data        |    |    |    |    |    |    |    |   |           |   |             |     |   |   | Word 1 |
| Output Image Table |    |    |    |    |    |    |    |   |           |   |             |     |   |   |        |
| 17                 | 16 | 15 | 14 | 13 | 12 | 11 | 10 | 7 | 6         | 5 | 4           | 3   | 2 | 1 | 0      |
| H                  | DM | L6 | L5 | L4 | L3 | L2 | L1 | S | Dec. Pos. |   | DC          | SDP |   |   | Word 0 |
| Binary Data        |    |    |    |    |    |    |    |   |           |   |             |     |   |   | Word 1 |

### SLC-5/02 Programming Example

In the following example, a Bulletin 2705 RediPANEL displays stored messages. An alarm, connected to an output module, signals when communications with the RediPANEL are lost. The system consists of:

- SLC-5/02 Processor (Catalog No. 1747-L524) in slot 0
- Remote I/O Scanner (Catalog No. 1747-SN) in slot 1
- Output Module (Catalog No. 1746-OB8) in slot 2
- An alarm connected to the output module
- Bulletin 2705 RediPANEL

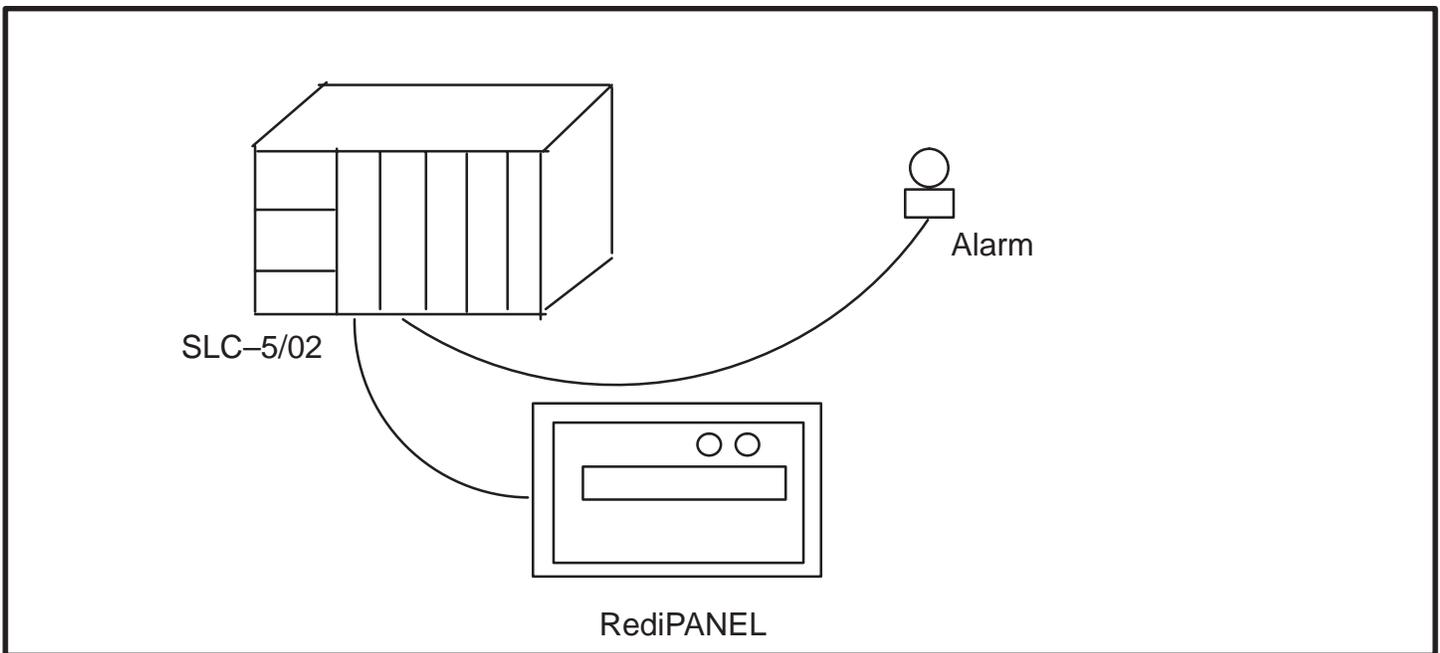

### SLC-5/02 Programming Examples

As shown in G file below, the RediPANEL, is configured as a 1/2 rack device beginning at rack 0, group 0.

#### G FILE

Device Address, Word 1  
Device Size, Word 2

| RIO Rack 3<br>Starting Group |   |   |   | RIO Rack 2<br>Starting Group |   |   |   | RIO Rack 1<br>Starting Group |   |   |   | RIO Rack 0<br>Starting Group |   |   |   |
|------------------------------|---|---|---|------------------------------|---|---|---|------------------------------|---|---|---|------------------------------|---|---|---|
| 6                            | 4 | 2 | 0 | 6                            | 4 | 2 | 0 | 6                            | 4 | 2 | 0 | 6                            | 4 | 2 | 0 |
| 0                            | 0 | 0 | 0 | 0                            | 0 | 0 | 0 | 0                            | 0 | 0 | 0 | 0                            | 0 | 0 | 1 |
| 0                            | 0 | 0 | 0 | 0                            | 0 | 0 | 0 | 0                            | 0 | 0 | 0 | 0                            | 0 | 1 | 1 |

The scanner input file is shown below. The output file is similar, it is addressed O:1.0 to O:1.3.

|               |                | Bit Number            | 15              | 14              | 13              | 12              | 11              | 10              | 9               | 8               | 7              | 6              | 5              | 4              | 3              | 2              | 1              | 0              | Input File |
|---------------|----------------|-----------------------|-----------------|-----------------|-----------------|-----------------|-----------------|-----------------|-----------------|-----------------|----------------|----------------|----------------|----------------|----------------|----------------|----------------|----------------|------------|
| <b>Rack 0</b> | Rack 0 Group 0 | Word 1                |                 |                 |                 |                 |                 |                 |                 |                 |                |                |                |                |                |                |                |                | I:1.0      |
|               | Rack 0 Group 1 | Word 1                |                 |                 |                 |                 |                 |                 |                 |                 |                |                |                |                |                |                |                |                | I:1.1      |
|               | Rack 0 Group 2 | Word 2                |                 |                 |                 |                 |                 |                 |                 |                 |                |                |                |                |                |                |                |                | I:1.2      |
|               | Rack 0 Group 3 | Word 3                |                 |                 |                 |                 |                 |                 |                 |                 |                |                |                |                |                |                |                |                | I:1.3      |
|               | Rack 0 Group 4 | Word 4                |                 |                 |                 |                 |                 |                 | not used        |                 |                |                |                |                |                |                |                |                | I:1.4      |
|               | Rack 0 Group 5 | Word 5                |                 |                 |                 |                 |                 |                 | not used        |                 |                |                |                |                |                |                |                |                | I:1.5      |
|               | Rack 0 Group 6 | Word 6                |                 |                 |                 |                 |                 |                 | not used        |                 |                |                |                |                |                |                |                |                | I:1.6      |
|               | Rack 0 Group 7 | Word 7                |                 |                 |                 |                 |                 |                 | not used        |                 |                |                |                |                |                |                |                |                | I:1.7      |
| <b>Rack 1</b> | Rack 1 Group 0 | Word 1                |                 |                 |                 |                 |                 |                 | not used        |                 |                |                |                |                |                |                |                |                | I:1.8      |
|               | Rack 1 Group 1 | Word 1                |                 |                 |                 |                 |                 |                 | not used        |                 |                |                |                |                |                |                |                |                | I:1.9      |
|               | Rack 1 Group 2 | Word 2                |                 |                 |                 |                 |                 |                 | not used        |                 |                |                |                |                |                |                |                |                | I:1.10     |
|               | Rack 1 Group 3 | Word 3                |                 |                 |                 |                 |                 |                 | not used        |                 |                |                |                |                |                |                |                |                | I:1.11     |
|               | Rack 1 Group 4 | Word 4                |                 |                 |                 |                 |                 |                 | not used        |                 |                |                |                |                |                |                |                |                | I:1.12     |
|               | Rack 1 Group 5 | Word 5                |                 |                 |                 |                 |                 |                 | not used        |                 |                |                |                |                |                |                |                |                | I:1.13     |
|               | Rack 1 Group 6 | Word 6                |                 |                 |                 |                 |                 |                 | not used        |                 |                |                |                |                |                |                |                |                | I:1.14     |
|               | Rack 1 Group 7 | Word 7                |                 |                 |                 |                 |                 |                 | not used        |                 |                |                |                |                |                |                |                |                | I:1.15     |
| <b>Rack 2</b> | Rack 2 Group 0 | Word 16               |                 |                 |                 |                 |                 |                 | not used        |                 |                |                |                |                |                |                |                |                | I:1.16     |
|               | Rack 2 Group 1 | Word 17               |                 |                 |                 |                 |                 |                 | not used        |                 |                |                |                |                |                |                |                |                | I:1.17     |
|               | Rack 2 Group 2 | Word 18               |                 |                 |                 |                 |                 |                 | not used        |                 |                |                |                |                |                |                |                |                | I:1.18     |
|               | Rack 2 Group 3 | Word 19               |                 |                 |                 |                 |                 |                 | not used        |                 |                |                |                |                |                |                |                |                | I:1.19     |
|               | Rack 2 Group 4 | Word 20               |                 |                 |                 |                 |                 |                 | not used        |                 |                |                |                |                |                |                |                |                | I:1.20     |
|               | Rack 2 Group 5 | Word 21               |                 |                 |                 |                 |                 |                 | not used        |                 |                |                |                |                |                |                |                |                | I:1.21     |
|               | Rack 2 Group 6 | Word 22               |                 |                 |                 |                 |                 |                 | not used        |                 |                |                |                |                |                |                |                |                | I:1.22     |
|               | Rack 2 Group 7 | Word 23               |                 |                 |                 |                 |                 |                 | not used        |                 |                |                |                |                |                |                |                |                | I:1.23     |
| <b>Rack 3</b> | Rack 3 Group 0 | Word 24               |                 |                 |                 |                 |                 |                 | not used        |                 |                |                |                |                |                |                |                |                | I:1.24     |
|               | Rack 3 Group 1 | Word 25               |                 |                 |                 |                 |                 |                 | not used        |                 |                |                |                |                |                |                |                |                | I:1.25     |
|               | Rack 3 Group 2 | Word 26               |                 |                 |                 |                 |                 |                 | not used        |                 |                |                |                |                |                |                |                |                | I:1.26     |
|               | Rack 3 Group 3 | Word 27               |                 |                 |                 |                 |                 |                 | not used        |                 |                |                |                |                |                |                |                |                | I:1.27     |
|               | Rack 3 Group 4 | Word 28               |                 |                 |                 |                 |                 |                 | not used        |                 |                |                |                |                |                |                |                |                | I:1.28     |
|               | Rack 3 Group 5 | Word 29               |                 |                 |                 |                 |                 |                 | not used        |                 |                |                |                |                |                |                |                |                | I:1.29     |
|               | Rack 3 Group 6 | Word 30               |                 |                 |                 |                 |                 |                 | not used        |                 |                |                |                |                |                |                |                |                | I:1.30     |
|               | Rack 3 Group 7 | Word 31               |                 |                 |                 |                 |                 |                 | not used        |                 |                |                |                |                |                |                |                |                | I:1.31     |
|               |                | Bit Number<br>(octal) | 17 <sub>8</sub> | 16 <sub>8</sub> | 15 <sub>8</sub> | 14 <sub>8</sub> | 13 <sub>8</sub> | 12 <sub>8</sub> | 11 <sub>8</sub> | 10 <sub>8</sub> | 7 <sub>8</sub> | 6 <sub>8</sub> | 5 <sub>8</sub> | 4 <sub>8</sub> | 3 <sub>8</sub> | 2 <sub>8</sub> | 1 <sub>8</sub> | 0 <sub>8</sub> |            |

## Address Conversion

The addresses for the Input and Output files are provided in an octal format. You must convert the bit addresses to decimal to accommodate the SLC-5/02. Refer to the following.

Bit Address

|         |   |   |   |   |   |   |   |    |    |    |    |    |    |    |    |          |
|---------|---|---|---|---|---|---|---|----|----|----|----|----|----|----|----|----------|
| Decimal | 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8  | 9  | 10 | 11 | 12 | 13 | 14 | 15 | SLC-5/02 |
| Octal   | 1 | 2 | 3 | 4 | 5 | 6 | 7 | 10 | 11 | 12 | 13 | 14 | 15 | 16 | 17 | PLC-5    |

## Scanner Configuration


The BAUD rate is 115.2K. DIP switch 1 should be in the OFF position, DIP switch 2 should be ON.

The G file size is set to 3 using the Speciality I/O Configuration function. The M0 and M1 file sizes are set to 32 in the Advanced Set Up function.

Since only the first four words of the input and output files contain valid information, the scanned input and output words can be set to 4. Reducing the number of scanned input and output words decreases your SLC scan time.

### Example Program

The example program is shown below. Each time a function key is pressed on the RediPANEL, its associated message is displayed. This program also monitors the scanner's Enabled Device Fault bit (M1:1.0/0). If communications are lost, an alarm is activated.

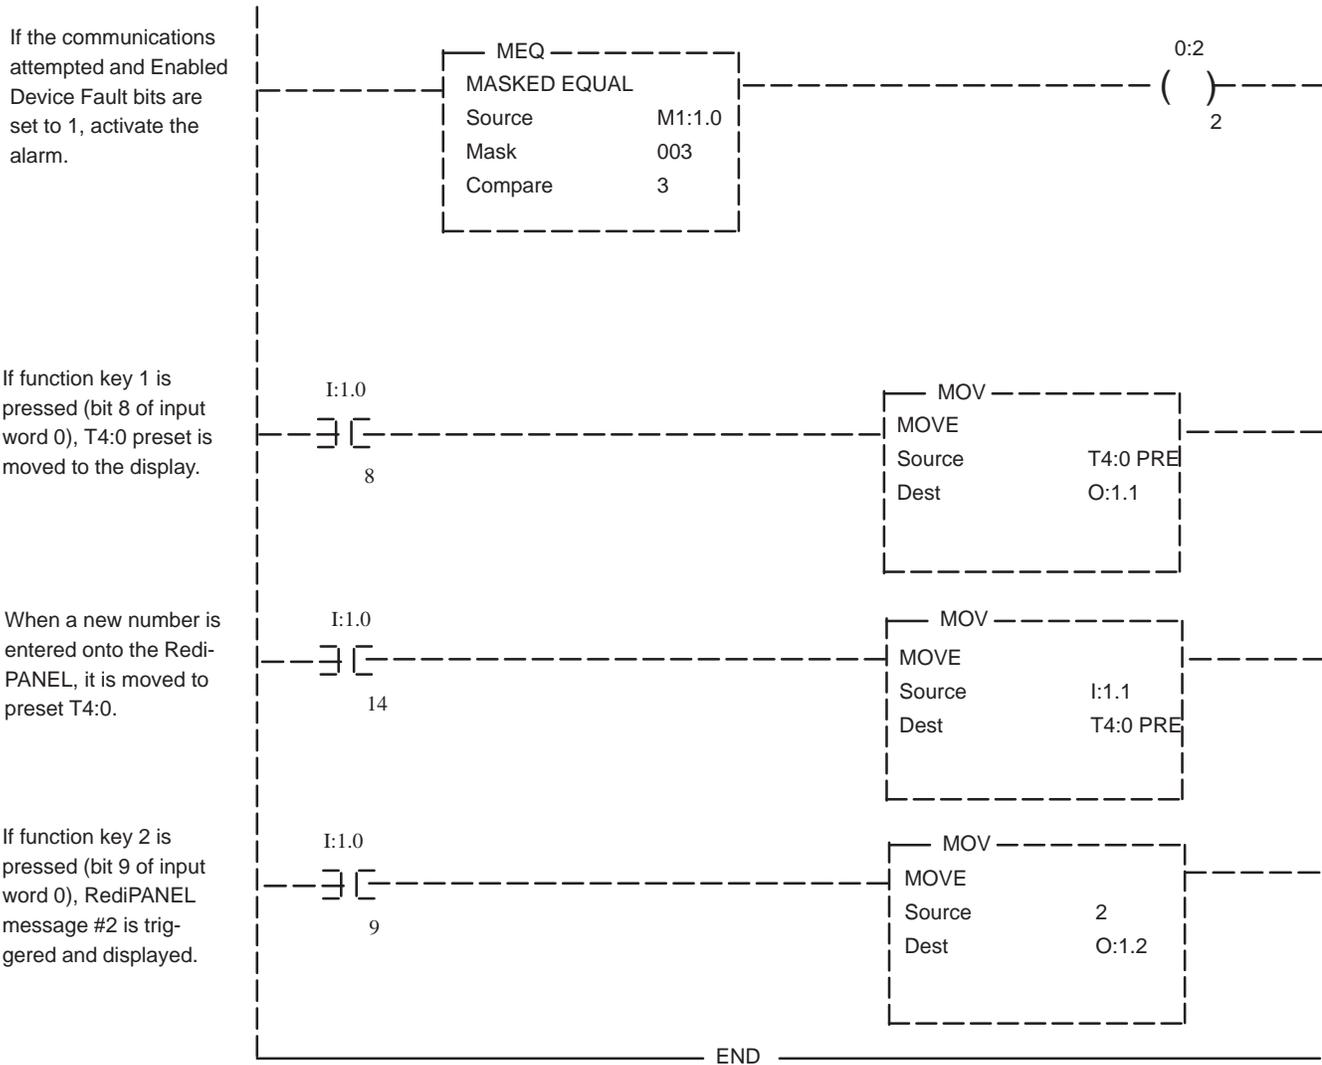

If the communications attempted and Enabled Device Fault bits are set to 1, activate the alarm.

If function key 1 is pressed (bit 8 of input word 0), T4:0 preset is moved to the display.

When a new number is entered onto the RediPANEL, it is moved to preset T4:0.

If function key 2 is pressed (bit 9 of input word 0), RediPANEL message #2 is triggered and displayed.

## Maintenance and Troubleshooting

### Chapter Objectives

This chapter describes how to use the Comm/Fault LED indicators, and explains the power-up sequence error message display, plus addresses basic troubleshooting questions on the RediPANEL Keypad Module.

### Using the Comm/Fault LED Indicators

Two LED indicators are located on the right top corner of the module - a green LED labeled COMM and a red LED labeled FAULT.

#### ***The FAULT Indicator***

Any software or hardware faults not related to communications are indicated by the red LED labeled FAULT. The LED can be in one of three states:

1. OFF
2. ON
3. Blinking

#### ***FAULT OFF***

**When FAULT indicator is OFF:**

1. Module is operating correctly and no faults have been found.
2. The module is not receiving input power.

#### ***FAULT ON***

**When FAULT indicator is ON:**

1. The module has just been powered up. The FAULT indicator momentarily is ON during the power up sequence.
2. A fault has been detected. Such a fault would be internal to the module - there is no way to clear this fault condition. Keypad Module power should be recycled.

#### ***FAULT Blinking***

**When FAULT indicator is blinking:**

1. DIP switch fault:
  - Check for valid data type.
  - Make sure you have programmed the PLC for handshaking before enabling the handshake bit on the Keypad Module.
2. The calculated size and rack address combination is not valid. For example, the module is addressed for the “last module group”, group 3, of a logical rack and its size was calculated to be a half rack. The functional configurations which result in a size of two quarter racks are indicated in Chapter 5.

### ***The COMM Indicator***

Any communication faults or errors are indicated by the green LED labeled COMM. The LED can be in one of three states:

1. OFF
2. ON
3. Blinking

### ***COMM OFF***

#### **When COMM indicator is OFF:**

1. The module is not receiving input power.
2. The module is operating correctly, but no communications is occurring at this time. Check the Remote I/O Link wiring.
3. The module is the last rack, but the DIP switch indicating this state is not in the OFF position.

### ***COMM ON***

#### **When COMM indicator is ON:**

1. The module is operating correctly and no communications faults have been found.

### ***COMM Blinking***

#### **When COMM indicator is blinking:**

The COMM indicator blinks if the PLC is in the program or test mode.

## **Power-Up Sequence Error Message Display**

If you receive an error message during power-up, clear the error and recycle power to the module. Since error conditions may “stack up”, you may have to repeat the power-up, clear error, power-up cycle several times to clear all errors.

## **Basic Troubleshooting Questions**

Since the Keypad Module is part of an integrated system, you must evaluate the entire system when a fault is detected. Start your troubleshooting by asking these basic questions:

- Is the rack address set properly? Refer to Chapter 5.
- Are the baud rates of the Keypad Module and the Scanner Module the same? Refer to Chapter 5.
- Is the Keypad Module the last module in a physical rack, and has it been identified as the last rack? Refer to Chapter 5.
- Is the communication connector securely plugged in at both the Keypad Module end and the Scanner Module end?

- Have you changed the settings of any of the DIP switches? New DIP switch settings will not be acknowledged until power is recycled. Refer to Chapter 5.
- If you do not have the communications LED ON and all of your DIP switches seem correct – check the remote I/O link wiring. You may need to reverse the blue and clear wires.
- If your 120 Volt AC is intermittent be sure your 120/240 Volt AC selectable switch is set properly.

## Specifications

### Chapter Objectives

This chapter lists the specifications for the Bulletin 2705 Keypad Module.

### Specifications

#### FUNCTION

Provides keypad interface for data entry and display in Remote I/O Serial Data Link.

#### POWER AND ENVIRONMENTAL

**Power Supply:** Integral power supply in each module.

#### Operating ranges:

##### Series A, B, C, D

90–132 Volts AC, 47–63Hz

180–265 Volts AC, 47–63Hz

18–30 Volts DC

##### Series E

90–265 Volts AC, 47–63Hz

18–30 Volts DC

#### Input Current and Power Ratings:

24 Volts DC, 15VA, 625 milliamperes

120 Volts AC, 15VA, 125 milliamperes

#### Temperature Range:

Operating: 0°C to +60°C

Storage: -40°C to +85°C

Humidity: 5%-95% non-condensing

Note: Operating temperature at 0°C is based on the absence of freezing moisture or liquids.

#### COMMUNICATIONS

**Remote I/O Serial Data Link:** Communicates with the Allen–Bradley PLC family via the following scanner modules:

| Scanner Cat. No.      | PLC                    |
|-----------------------|------------------------|
| 1771–SN               | PLC–2–MINI, 5/10, 5/12 |
| 1772–SD2 <sup>①</sup> | PLC–2/30               |
| 1775–S4A,B,S5         | PLC–3                  |
| 1775–SR,SR5           | PLC–3/10               |
| Integral              | PLC–5/15, 5/25         |
| 5250–RS               | PLC–5/250              |
| 1747–SN               | SLC–5/02               |

<sup>①</sup> Scanner 1772–SD2, Rev 3, or later.

#### Communication Media:

Allen–Bradley 1770–CD (Belden Cable 9463)

**Baud Rates:**

Selectable. 230.4K baud (2500 ft), 115.2K baud (5000 ft) or 57.6K baud (10,000 ft)

**Interconnect:** 3-terminal plug and socket

**CONSTRUCTION - NEMA Type 4X**

Approximate Weight – 6 lbs (2.7 kg)

**KEYBOARD COMPATIBILITY**

Series A: IBM-compatible XT-style keyboard, DIN 5-pin plug.

Series B or later: IBM-compatible AT/XT-style keyboard, also.

## Appendix A

This appendix describes the error messages displayed by the Keypad Module. It also lists the display characters and their corresponding hexadecimal values as an aid.

### Error Messages

The following list shows error messages and their explanations. Items with the bullet (•) in the left margin are messages that refer to hardware or software faults that cannot be corrected by programming or changing the configuration settings.

- **SYSTEM ERROR**

A hardware failure has been detected on the Numeric Keypad Module.

- **EPROM CRC ERROR**

This error indicates that the power up diagnostics have detected a CRC error while testing the EPROM memory of the Numeric Keypad Node Module.

- **INTERNAL RAM ERR**

This error indicates that the power up diagnostics have detected an error in the RAM contained on the module's CPU processor.

- **EXTERNAL RAM ERROR**

This error indicates that the power up diagnostics have detected an error in the RAM that is external to the module's CPU processor.

- **INT/TIMER1 ERROR**

This error indicates that the power up diagnostics have detected an error with the interrupt/timer circuitry.

**DATA TYPE ERROR**

This error indicates that the data type set up is incompatible with the other DIP switch selections.

**RACK CONFIG ERR**

This error indicates a rack configuration error, i.e. (address switches, data type, SMD enabled). This is caused by incorrect setting of DIP switches on the module.

**COMM SETUP ERR**

This error indicates that there was an error during the setup of communications.

**COMM START ERROR**

This error indicates that an error was detected when the Numeric Keypad Module attempted to start communications.

### **OVERFLOW**

This error indicates that the user attempted to enter a number that was larger than what the module's configuration could handle.

### **PLC SENT NON-BCD**

This error indicates that the PLC sent a non-BCD digit when one was expected. This is generally a programming error on the PLC.

### **EEPROM CRC ERROR**

This error indicates that the power up diagnostics detected a CRC error on the EEPROM used for the stored messages. This error can be eliminated by entering a Control E and responding 'Y' to the ERROR FIX? prompt when in the Message Editor. It also is corrected by editing a message.

**Note:** Fixing the error does not mean that the cause of the error has been corrected.

### **MESSAGE ERROR**

This error message is displayed whenever an invalid message number is called up for edit.

**BAD MSG NUMBER** This error is displayed when the PLC attempts to display a message that cannot be entered in the EEPROM. i.e., a message greater than 120.

- **WATCHDOG FAILURE** This error indicates that the power up diagnostics detected an error with the watchdog circuitry.

## Display Characters

Figure A.1 shows the 14–segment character set for the module display. The numbers next to each figure are the hexadecimal values for the characters.

**Figure A.1**  
**14–Segment Display Characters**

|      |      |      |      |      |      |      |       |
|------|------|------|------|------|------|------|-------|
| 00   | 08 H | 10 P | 18 X | 20   | 28 < | 30 / | 38 8  |
| 01 A | 09 I | 11 Q | 19 Y | 21 ▽ | 29 > | 31   | 39 9  |
| 02 B | 0A J | 12 R | 1A Z | 22   | 2A * | 32 2 | 3A —  |
| 03 C | 0B K | 13 S | 1B [ | 23 H | 2B + | 33 3 | 3B /  |
| 04 D | 0C L | 14 T | 1C \ | 24 S | 2C ; | 34 4 | 32C / |
| 05 E | 0D M | 15 U | 1D   | 25 R | 2D — | 35 5 | 3D =  |
| 06 F | 0E N | 16 V | 1E ^ | 26 R | 2E . | 36 6 | 3E \  |
| 07 G | 0F O | 17 W | 1F _ | 27 / | 2F / | 37 7 | 3F P  |

**A**

Address, Rack, 5-1, 5-2  
 Applicable PLCs and Scanners, 4-2  
 Applications, Keypad Module, 2-2  
 Architecture, Remote I/O, 4-2  
 ASCII Data, 2-3, 6-2  
 ASCII Message Display, 6-2

**B**

BAD MSG NUMBER, A-2  
 Basic Troubleshooting, 8-3  
 Baud Rate, 3-5, 5-4  
 BCD, Datatype, 2-4, 5-4  
 Binary, Datatype, 2-4, 5-4  
 Bulletin 2705 RediPANEL Keypad Modules, 2-1

**C**

Calculating Rack Size, 4-7  
 COMM (Communications)  
   Blinking, 8-2  
   Indicator, 8-2  
   OFF, 8-2  
   ON, 8-2  
 COMM SETUP ERR, A-1  
 COMM START ERROR, A-1  
 COMM 1 Fault, 8-1  
 Commands, Editing, 6-8  
 Communication Faults, 8-1  
 Communications, 4-1  
 Compatible PLCs and Scanners., 4-5  
 Configuring Keypad Module, 4-1  
   Appropriate Scanner, 4-1  
   Calculating Rack Size, 4-7  
   Number of Chassis and Amount of I/O, 4-8  
 Configuration, Remote I/O, 4-8  
 Connecting to a Remote I/O Link, 3-5  
   Cable Length, 3-5  
   Cable Type, 3-5  
 Connecting to a Scanner Module, 3-6  
   Cable Type, 3-6  
   Wiring Connections, 3-6

**D**

Data Entry, 6-3

Decimal Modes, 6-4  
 Destination Entry, 6-4  
 Polarity (minus sign), 6-4  
 Split Display, 6-4  
 Data Type, 2-4, 5-4  
   BCD, 2-4, 5-4  
   Binary, 2-4, 5-4  
   Integer, 2-4, 5-4  
 DATA TYPE ERROR, A-1  
 Datatype, 5-4  
 DC (Decimal Point Control), 7-26  
 Dec. Pos. (Decimal Position), 7-26  
 Decimal Point Control, 7-26  
   DC (Decimal Point Control), 7-26  
   Dec. Pos. (Decimal Position), 7-26  
   SDP (Scratched Decimal Position), 7-26  
 Decimal Point Key, 2-3  
 DELETE Key, 6-5  
 Destination Bits, 5-4  
 Destination Entry, 6-4  
   DELETE Key, 2-3, 6-5  
   ENTER Key, 2-3, 6-5  
 Minus Key, 2-3, 6-5  
 Destination Function, Using the, 7-9  
 DIP Switches, 5-1  
   Switch Bank #1, 5-2  
   Switch Bank #2, 5-4  
   Switch Bank #3, 5-5  
 Display Characters, A-3  
 Display, Keypad, 6-1  
 Display Message, 7-25  
 Display Stored Message, 2-4, 6-2  
 Displaying a Full Line Stored Message, 7-6  
 Displaying Numeric Data, 7-4

**E**

Editing Commands, 6-8  
 Editing Messages, 6-7  
 Editor, Message, 6-6  
 EEPROM CRC ERROR, A-2  
 EEPROM, Storing Messages on, 6-5  
 Electrical Precautions, 3-1  
 Electromagnetic Interference, 3-1, 3-2  
 Emergency Stop Switches, 3-1  
 Enclosures, NEMA, 3-1  
 ENTER Key, 6-5

Entering Messages, 6–7  
 Editing, 6–7  
 Editing Commands, 6–8  
 Storing, 6–7  
 Entering or Changing Data, 7–7  
 EPROM CRC ERROR, A–1  
 Error Messages, A–1
 

- BAD MSG NUMBER, A–2
- COMM SETUP ERR, A–1
- COMM START ERROR, A–1
- DATA TYPE ERROR, A–1
- EEPROM CRC ERROR, A–2
- EPROM CRC ERROR, A–1
- EXTERNAL RAM ERROR, A–1
- INTERNAL RAM ERR, A–1
- INT/TIMER1 ERROR, A–1
- MESSAGE ERROR, A–2
- OVERFLOW, A–1
- PLC SENT NON–BCD, A–2
- RACK CONFIG ERR, A–1
- SYSTEM ERROR, A–1
- WATCHDOG FAILURE, A–2

 EXTERNAL RAM ERROR, A–1

## F

Fault
 

- Blinking, 8–1
- Indicator, 8–1
- LEDs, 8–1
- OFF, 8–1
- ON, 8–1

 Features, Keypad Module, 2–1, 2–3  
 First I/O Group, 5–2  
 Format and Communication
 

- Parameters, 5–1, 5–4

 Full Line Stored Message,
 

- Displaying, 7–6

 Function Keys, 7–25  
 Functions, Keypad Module, 2–1

## G

Grounding, 3–1  
 Group, First I/O, 5–2

## H

Handshake, 2–4, 5–4, 7–28  
 Horizontal Mounting, 3–2  
 Hexadecimal/ASCII Values, A–3

## I

Image Tables, I/O, 7–30  
 Indicator, Fault, 8–1  
 Information Display, 2–3  
 Input and Output Image Tables, 7–30  
 Integer, Datatype, 2–4, 5–4  
 INTERNAL RAM ERR, A–1  
 INT/TIMER1 ERROR, A–1  
 I/O Image Tables, 7–30
 

- Symbols and Abbreviations, 7–25

 I/O, Remote Link, 2–1

## K

Keyboard Style, 5–5  
 Keypad Display, 6–1  
 Keypad Layout, 6–3  
 Keypad Modules, 1–2
 

- Applications, 2–2
- Configuring, 4–1
- Data Input, 2–3
- Features, 2–1, 2–3
- Functions, 2–1
- Programming, 7–1

 Keypad Output Display, 6–1
 

- ASCII Data, 6–2, 2–3
- ASCII Message Display, 6–2
- Display Stored Message, 2–4, 6–2
- Numeric Data, 6–2

 Keys
 

- Decimal Point, 2–3
- DELETE, 6–5
- ENTER, 6–5
- Minus, 6–5
- Numeric, 2–3, 6–3

 Keyswitch, 2–4, 5–4

## L

Last Device, 5–4  
 Last State, 2–4, 5–4  
 Link, Remote I/O, 1–2

## M

Maintenance and Troubleshooting,
 

- 8–1

 Mechanical Installation
 

- Dimensions, 3–4
- Procedures, 3–4

- Message, Display, 7–25
  - Message Display, ASCII, 6–2
  - Message Editor, 6–6
  - MESSAGE ERROR, A–2
  - Messages, 6–5
    - ASCII Display, 6–2
    - Editing, 6–7
    - Entering, 6–7
    - Error, A–1
    - Keyboard, 6–6
  - Minus Key (Polarity), 6–4, 6–5
  - Move Instruction 7–4
- N**
- NEMA Enclosures, 3–1
    - Convection Cooling, 3–2
    - Horizontal Mounting, 3–2
    - Installation, 3–3
    - Module Spacing, 3–3
    - Vertical Stacking, 3–2
  - NEMA Rating, 2–1
  - Networking, Remote I/O, 1–2
  - Numeric Data, 6–2
  - Numeric Data, Displaying, 7–4
- O**
- Operator Data Input, 2–3
  - Output Display, Keypad, 6–1
  - OVERFLOW, A–1
- P**
- PLC, 1–2
  - PLC SENT NON–BCD, A–2
  - PLC–2 Programming Example, 7–16
    - Accumulated Values of Counter, 7–21
    - Displaying 16–Character Message, 7–23
    - Displaying Message and Variable Data, 7–24
    - Example Program, 7–17
    - Preset Value of Counter, 7–22
    - Program Set–up, 7–19
    - Using Destination Bits to Retrieve/Change Data, 7–24
  - PLC–5 Programming Example, 7–2
    - Displaying a Full Line Stored Message, 7–6
    - Displaying Numeric Data, 7–4
    - Entering or Changing Data, 7–7
    - I/O Image Tables, 7–3
    - System Configuration, 7–2
    - Triggering a Stored Message, 7–5
    - Using the Destination Function, 7–9
  - Power Requirements, 3–1
  - Power Source
    - Module Type, 3–1
    - Switch Settings, 3–1
  - Power–up Sequence
    - Error Message Display, 8–2
  - Programming Examples
    - PLC–2, 7–16
    - PLC–5, 7–2
- R**
- Rack Address, 5–1, 5–2
  - RACK CONFIG ERR, A–1
  - Rack Size, Calculating, 4–7
  - Rating, NEMA, 2–1
  - Remote I/O
    - Architecture, 4–2
    - Communications, 2–4
    - Configuration, 4–8
    - Connecting to, 3–5
    - Link, 1–2
    - Networking, 1–2
- S**
- Scanner Module, Connecting to, 3–6
  - Scanners, Applicable PLCs and, 4–2
  - SDP (Scratched Decimal Position), 7–26
  - Security Keyswitch, 2–3, 2–4
  - Serial Data Link Cable, 3–5
  - Setting DIP Switches, 5–2
  - SMD and Destination Format, 5–5
  - Specifications, 9–1
  - Split Display, 5–5, 6–4
  - Stored Message, 2–4, 5–5
  - Stored Message Display, 2–4, 7–5, 7–25
  - Storing Messages on EEPROM, 6–5
  - Switch Bank #1
    - First I/O Group, 5–2
    - Rack Address, 5–2
  - Switch Bank #2
    - Baud Rate, 3–5, 5–4
    - Datatype, 5–4
    - Destination Bits, 5–4

- Handshake, 2–4, 5–4
- Keyswitch, 2–4, 5–4
- Last Device, 5–4
- Last State, 2–4, 5–4
- Switch Bank #3
  - Keyboard Style, 5–5
  - SMD and Destination Format, 5–5
  - Split Display, 5–5
  - Stored Message, 2–4, 5–5
- Symbols and Abbreviations for I/O
  - Image Tables, 7–25
  - DM (Display Message), 7–25
  - EN (Enter), 7–25
  - H (Handshake Bit), 7–25
  - F1–F6 (Function Keys), 7–25
  - L1–L6 (LEDs), 7–25
  - SMD (Stored Message Display), 2–4, 7–25
- SYSTEM ERROR, A–1
- T**
  - Triggering a Stored Message, 7–5
- Troubleshooting, 8–3
- Typical Switch Settings, 5–2
- U**
  - Using PLC–5s and a Sub I/O
    - Scanner, 7–11
    - Continuous, 7–13
    - Control Block, 7–13
    - Data File, 7–13
    - Group, 7–12
    - Instruction Parameters, 7–12
    - Length, 7–13
    - Module, 7–12
    - Programming Example, 7–13, 7–15
    - Rack, 7–12
  - Using the Destination Function, 7–9
- W**
  - WATCHDOG FAILURE, A–2
  - Wiring, 3–1



Rockwell Automation helps its customers receive a superior return on their investment by bringing together leading brands in industrial automation, creating a broad spectrum of easy-to-integrate products. These are supported by local technical resources available worldwide, a global network of system solutions providers, and the advanced technology resources of Rockwell.



## Worldwide representation.

Argentina • Australia • Austria • Bahrain • Belgium • Bolivia • Brazil • Bulgaria • Canada • Chile • China, People's Republic of • Colombia • Costa Rica • Croatia • Cyprus • Czech Republic • Denmark • Dominican Republic • Ecuador • Egypt • El Salvador • Finland • France • Germany • Ghana • Greece • Guatemala • Honduras • Hong Kong • Hungary • Iceland • India • Indonesia • Iran • Ireland • Israel • Italy • Jamaica • Japan • Jordan • Korea • Kuwait • Lebanon • Macau • Malaysia • Malta • Mexico • Morocco • The Netherlands • New Zealand • Nigeria • Norway • Oman • Pakistan • Panama • Peru • Philippines • Poland • Portugal • Puerto Rico • Qatar • Romania • Russia • Saudi Arabia • Singapore • Slovakia • Slovenia • South Africa, Republic of • Spain • Sweden • Switzerland • Taiwan • Thailand • Trinidad • Tunisia • Turkey • United Arab Emirates • United Kingdom • United States • Uruguay • Venezuela

Rockwell Automation Headquarters, 1201 South Second Street, Milwaukee, WI 53204-2496 USA, Tel: (1) 414 382-2000 Fax: (1) 414 382-4444

Rockwell Automation European Headquarters, Avenue Hermann Debroux, 46, 1160 Brussels, Belgium, Tel: (32) 2 663 06 00, Fax: (32) 2 663 06 40

Rockwell Automation Asia Pacific Headquarters, 27/F Citicorp Centre, 18 Whitfield Road, Causeway Bay, Hong Kong, Tel: (852) 2887 4788, Fax: (852) 2508 1846

World Wide Web: <http://www.ab.com>